

FOREWORD

This document is Part 3 of IEC Standard 1131 for programmable controllers. The current status of the various Parts of IEC 1131 is as follows:

- Part 1 - General Information (IS)
- Part 2 - Equipment and Test Requirements (IS)
- Part 3 - Programming Languages (This Part - DIS)
- Part 4 - User Guidelines (CD)
- Part 5 - Messaging Service (CD)

This document was prepared by Task Force 3 (Programming Languages) of Working Group 7 (Programmable Controllers) of IEC Subcommittee 65B (formerly SC65A/WG6).

Annexes A, B, C, D, and E of this document are normative. It is anticipated that, as industrial practice matures, a normative annex H will be developed.

A Type 2 Technical Report (TR) will provide "pre-standardization" guidance for the implementation and application of the programming languages defined in this document, including such issues as operating system/program interaction and requirements for programming support environments.

CONTENTS

Clause/subclause	Page
1. General	9
1.1 Scope.....	9
1.2 Normative references	9
1.3 Definitions	10
1.4 Overview and general requirements	14
1.4.1 Software model.....	15
1.4.2 Communication model.....	15
1.4.3 Programming model	19
1.5 Compliance.....	21
1.5.1 Programmable controller systems.....	21
1.5.2 Programs	23
2. Common elements	24
2.1 Use of printed characters	24
2.1.1 Character set	24
2.1.2 Identifiers	25
2.1.3 Keywords	26
2.1.4 Use of spaces	26
2.1.5 Comments	26
2.2 External representation of data	27
2.2.1 Numeric literals	27
2.2.2 Character string literals.....	28
2.2.3 Time literals	29
2.2.3.1 Duration	29
2.2.3.2 Time of day and date.....	30
2.3 Data types.....	30
2.3.1 Elementary data types.....	30
2.3.2 Generic data types	32
2.3.3 Derived data types.....	33
2.3.3.1 Declaration	33
2.3.3.2 Initialization	33
2.3.3.3 Usage	36
2.4 Variables.....	37
2.4.1 Representation	37
2.4.1.1 Single-element variables	37
2.4.1.2 Multi-element variables.....	38
2.4.2 Initialization	39
2.4.3 Declaration.....	39
2.4.3.1 Type assignment	40
2.4.3.2 Initial value assignment	42
2.5 Program organization units.....	44
2.5.1 Functions	44
2.5.1.1 Representation	45
2.5.1.2 Execution control	46
2.5.1.3 Declaration	47
2.5.1.4 Typing, overloading, and type conversion.....	48
2.5.1.5 Standard functions.....	50

CONTENTS (continued)

Clause/subclause	Page
2.5.1.5.1 Type conversion functions	50
2.5.1.5.2 Numerical functions.....	52
2.5.1.5.3 Bit string functions.....	54
2.5.1.5.4 Selection and comparison functions	54
2.5.1.5.5 Character string functions	58
2.5.1.5.6 Functions of time data types	59
2.5.1.5.7 Functions of enumerated data types.....	59
2.5.2 Function blocks	61
2.5.2.1 Representation.....	61
2.5.2.2 Declaration	63
2.5.2.3 Standard function blocks.....	70
2.5.2.3.1 Bistable elements.....	70
2.5.2.3.2 Edge detection	72
2.5.2.3.3 Counters.....	73
2.5.2.3.4 Timers	74
2.5.2.3.5 Communication function blocks	76
2.5.3 Programs.....	76
2.6 Sequential Function Chart (SFC) elements	77
2.6.1 General.....	77
2.6.2 Steps	77
2.6.3 Transitions.....	79
2.6.4 Actions.....	83
2.6.4.1 Declaration	83
2.6.4.2 Association with steps.....	86
2.6.4.3 Action blocks	87
2.6.4.4 Action qualifiers	88
2.6.4.5 Action control.....	88
2.6.5 Rules of evolution.....	93
2.6.6 Compatibility of SFC elements.....	104
2.6.7 Compliance requirements	104
2.7 Configuration elements	105
2.7.1 Configurations, resources, and access paths.....	107
2.7.2 Tasks.....	110
3. Textual languages.....	118
3.1 Common elements	118
3.2 Language IL (Instruction List).....	119
3.2.1 Instructions	119
3.2.2 Operators, modifiers and operands	119
3.2.3 Functions and function blocks.....	121
3.3 Language ST (Structured Text).....	122
3.3.1 Expressions.....	122
3.3.2 Statements	124
3.3.2.1 Assignment statements.....	125
3.3.2.2 Function and function block control statements.....	125
3.3.2.3 Selection statements.....	126
3.3.2.4 Iteration statements.....	126
4. Graphic languages	128
4.1 Common elements	128
4.1.1 Representation of lines and blocks.....	128
4.1.2 Direction of flow in networks	128

CONTENTS (continued)

Clause/subclause	Page
4.1.3 Evaluation of networks	130
4.1.4 Execution control elements	132
4.2 Language LD (Ladder Diagram).....	134
4.2.1 Power rails.....	134
4.2.2 Link elements and states.....	134
4.2.3 Contacts.....	135
4.2.4 Coils.....	135
4.2.5 Functions and function blocks	135
4.2.6 Order of network evaluation	135
4.3 Language FBD (Function Block Diagram)	138
4.3.1 General.....	138
4.3.2 Combination of elements.....	138
4.3.3 Order of network evaluation	138
 ANNEX A - Specification method for textual languages (normative)	 139
A.1 Syntax	139
A.1.1 Terminal symbols.....	139
A.1.2 Non-terminal symbols	139
A.1.3 Production rules	140
A.2 Semantics.....	140
 ANNEX B - Formal specifications of language elements (normative).....	 141
B.0 Programming model.....	141
B.1 Common elements	142
B.1.1 Letters, digits and identifiers	142
B.1.2 Constants	142
B.1.2.1 Numeric literals	142
B.1.2.2 Character strings.....	143
B.1.2.3 Time literals	143
B.1.2.3.1 Duration.....	143
B.1.2.3.2 Time of day and date	144
B.1.3 Data types	144
B.1.3.1 Elementary data types	144
B.1.3.2 Generic data types	145
B.1.3.3 Derived data types	145
B.1.4 Variables	146
B.1.4.1 Directly represented variables	146
B.1.4.2 Multi-element variables	147
B.1.4.3 Declaration and initialization	147
B.1.5 Program organization units	149
B.1.5.1 Functions.....	149
B.1.5.2 Function blocks	150
B.1.5.3 Programs.....	150
B.1.6 Sequential function chart elements.....	151
B.1.7 Configuration elements	152
B.2 Language IL (Instruction List)	153
B.2.1 Instructions and operands.....	153
B.2.2 Operators	153

CONTENTS (continued)

Clause/subclause	Page
B.3 Language ST (Structured Text)	154
B.3.1 Expressions	154
B.3.2 Statements	154
B.3.2.1 Assignment statements	154
B.3.2.2 Subprogram control statements	155
B.3.2.3 Selection statements	155
B.3.2.4 Iteration statements	155
ANNEX C - Delimiters and Keywords (normative)	156
ANNEX D - Implementation-dependent parameters (normative)	160
ANNEX E - Error Conditions (normative)	162
ANNEX F - Examples (informative)	163
F.1 Function WEIGH	163
F.2 Function block CMD_MONITOR	164
F.3 Function block FWD_REV_MON	167
F.4 Function block STACK_INT	173
F.5 Function block MIX_2_BRIX	178
F.6 Analog signal processing	182
F.6.1 Function block LAG1	182
F.6.2 Function block DELAY	183
F.6.3 Function block AVERAGE	184
F.6.4 Function block INTEGRAL	185
F.6.5 Function block DERIVATIVE	186
F.6.6 Function block HYSTERESIS	186
F.6.7 Function block LIMITS_ALARM	187
F.6.8 Structure ANALOG_LIMITS	188
F.6.9 Function block ANALOG_MONITOR	189
F.6.10 Function block PID	190
F.6.11 Function block DIFFEQ	191
F.6.12 Function block RAMP	192
F.6.13 Function block TRANSFER	193
F.7 Program GRAVEL	194
F.8 Program AGV	203
ANNEX G - Index (informative)	207
ANNEX H - Software compliance testing (informative)	220
1 - Character set features	25
2 - Identifier features	25
3 - Comment feature	26
4 - Numeric literals	27
5 - Character string literal feature	28
6 - Two-character combinations in character strings	28
7 - Duration literal features	29
8 - Date and time of day literals	30
9 - Examples of date and time of day literals	30
10 - Elementary data types	31

CONTENTS (continued)

Clause/subclause	Page
11 - Hierarchy of generic data types	32
12 - Data type declaration features	34
13 - Default initial values	34
14 - Data type initial value declaration features	35
15 - Location and size prefix features for directly represented variables.....	38
16 - Variable declaration keywords	40
17 - Variable type assignment features.....	40
18 - Variable initial value assignment features.....	42
19 - Graphical negation of Boolean signals.....	45
20 - Use of EN input and ENO output	47
21 - Typed and overloaded functions	49
22 - Type conversion function features	51
23 - Standard functions of one numeric variable.....	52
24 - Standard arithmetic functions.....	53
25 - Standard bit shift functions	54
26 - Standard bitwise Boolean functions	55
27 - Standard selection functions	56
28 - Standard comparison functions.....	57
29 - Standard character string functions	58
30 - Functions of time data types	60
31 - Functions of enumerated data types.....	60
32 - Examples of function block I/O parameter usage	62
33 - Function block declaration features	65
34 - Standard bistable function blocks	71
35 - Standard edge detection function blocks	72
36 - Standard counter function blocks.....	73
37 - Standard timer function blocks.....	74
38 - Standard timer function blocks - timing diagrams	74
39 - Program declaration features	76
40 - Step features	78
41 - Transitions and transition conditions.....	80
42 - Declaration of actions.....	84
43 - Step/action association	86
44 - Action block features	87
45 - Action qualifiers	88
46 - Sequence evolution.....	94
47 - Compatible SFC features	104
48 - SFC minimal compliance requirements	104
49 - Configuration and resource declaration features	108
50 - Task features.....	111
51 - Examples of instruction fields.....	119
52 - Instruction List (IL) operators	120
53 - Function block invocation features for IL language.....	121
54 - Standard function block input operators for IL language	121
56 - ST language statements	124
57 - Representation of lines and blocks	129
58 - Graphic execution control elements.....	133
59 - Power rails.....	134

CONTENTS (continued)

Clause/subclause	Page
60 - Link elements	135
61 - Contacts	136
62 - Coils	137

LIST OF TABLES

Table	Page
-------	------

LIST OF FIGURES

Figure	Page
1 - Software model.....	16
2 - Communication model.....	17
3 - Combination of programmable controller language elements	20
4 - Examples of function usage	44
5 - Use of formal parameter names.....	46
6 - Examples of function declarations	48
7 - Examples of explicit type conversion with overloaded functions	49
8 - Examples of explicit type conversion with typed functions	50
9 - Function block instantiation example	62
10 - Examples of function block declarations	64
11 - Graphical use of function block names as variables.....	66
12 - Examples of use of input/output variables	69
13 - Semaphore usage example	70
14 - ACTION_CONTROL function block - External interface.....	89
15 - ACTION_CONTROL function block body	90
16 - Action control example	91
17 - SFC evolution rules	100
18 - SFC errors	102
19 - Configuration example	105
20 - Examples of CONFIGURATION and RESOURCE declaration features.....	109
21 - Synchronization of function blocks.....	115
22 - EXIT statement example	126
23 - Feedback path example	131
24 - Boolean OR Examples	138

LIST OF TABLES

Table	Page
-------	------

1. General**1.1 Scope**

This part of IEC 1131 applies to the printed and displayed representation, using characters of the ISO/IEC 646 character set, of the programming languages to be used for Programmable Controllers as defined in Part 1 of IEC 1131. Graphic and semigraphic representation of the language elements which are defined in this part is allowed, but is not defined in this part.

The functions of program entry, testing, monitoring, operating system, etc., are specified in Part 1 of IEC 1131.

1.2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this part of IEC 1131. At the time of publication, the editions indicated were valid. All normative documents are subject to revision, and parties to agreements based on this part of IEC 1131 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

IEC 50: International Electrotechnical Vocabulary (IEV)

IEC 559: 1989, Binary floating-point arithmetic for microprocessors systems

IEC 617-12: 1991, Graphical symbols for diagrams, Part 12: Binary logic elements

IEC 617-13: 1978, Graphical symbols for diagrams, Part 13: Analogue elements

IEC 848: 1988, Preparation of function charts for control systems

ISO/AFNOR: 1989, Dictionary of computer science, ISBN 2-12-4869111-6

ISO/IEC 646: 1991, Information technology - ISO 7-bit coded character set for information processing interchange

ISO 8601:1988, Data elements and Interchange formats - Information interchange - Representations of dates and times

ISO 7185: 1990, Information technology - Programming languages - Pascal

ISO 7498: 1984, Information processing systems - Open systems interconnection - Basic reference model

LIST OF TABLES (continued)

Table	Page
-------	------

1.3 Definitions

For the purposes of this part of IEC 1131, the following definitions apply. Definitions applying to all parts of IEC 1131 are given in part 1.

NOTES

1 Terms defined in this subclause are *italicized* where they appear in the bodies of definitions.

2 The notation "(ISO)" following a definition indicates that the definition is taken from the ISO/AFNOR *Dictionary of computer science*.

3 The ISO/AFNOR *Dictionary of computer science* and the *International Electrotechnical Vocabulary* should be consulted for terms not defined in this standard.

1.3.1. **absolute time:** The combination of time of day and date information.

1.3.2. **access path:** The association of a symbolic name with a variable for the purpose of open communication.

1.3.3. **action:** A Boolean variable, or a collection of operations to be performed, together with an associated control structure, as specified in 2.6.4.

1.3.4. **action block:** A graphical language element which utilizes a Boolean input variable to determine the value of a Boolean output variable or the enabling condition for an *action*, according to a predetermined control structure as defined in 2.6.4.5.

1.3.5. **aggregate:** A structured collection of data objects forming a *data type*. (ISO)

1.3.6. **argument:** Synonymous with *input parameter* or *output parameter*.

1.3.7. **array:** An *aggregate* that consists of data objects, with identical attributes, each of which may be uniquely referenced by *subscripting*. (ISO)

1.3.8. **assignment:** A mechanism to give a value to a variable or to an *aggregate*. (ISO)

1.3.9. **based number:** A number represented in a specified base other than ten.

1.3.10. **bistable function block:** A *function block* with two stable states controlled by one or more inputs.

1.3.11. **bit string:** A data element consisting of one or more bits.

1.3.12. **body:** That portion of a *program organization unit* which specifies the operations to be performed on the declared *operands* of the program organization unit when its execution is *invoked*.

1.3.13. **call:** A language construct for *invoking* the execution of a *function* or *function block*.

1.3.14. **character string:** An *aggregate* that consists of an ordered sequence of characters.

1.3.15. **comment:** A language construct for the inclusion of text in a program and having no impact on the execution of the program. (ISO)

LIST OF TABLES (continued)

Table	Page
1.3.16. compile: To translate a <i>program organization unit</i> or <i>data type</i> specification into its machine language equivalent or an intermediate form.	
1.3.17. configuration: A language element corresponding to a <i>programmable controller system</i> as defined in IEC 1131-1.	
1.3.18. counter function block: A <i>function block</i> which accumulates a value for the number of changes sensed at one or more specified <i>inputs</i> .	
1.3.19. data type: A set of values together with a set of permitted operations. (ISO)	
1.3.20. date and time: The date within the year and the time of day, represented according to ISO 8601.	
1.3.21. declaration: The mechanism for establishing the definition of a <i>language element</i> . A declaration normally involves attaching an identifier to the language element, and allocating attributes such as <i>data types</i> and algorithms to it.	
1.3.22. delimiter: A character or combination of characters used to separate program <i>language elements</i> .	
1.3.23. direct representation: A means of representing a variable in a programmable controller program from which a manufacturer-specified correspondence to a physical or <i>logical location</i> may be determined directly.	
1.3.24. double word: A data element containing 32 bits.	
1.3.25. evaluation: The process of establishing a value for an expression or a <i>function</i> , or for the <i>outputs</i> of a network or <i>function block</i> , during program execution.	
1.3.26. execution control element: A <i>language element</i> which controls the flow of program execution.	
1.3.27. falling edge: The change from 1 to 0 of a Boolean variable.	
1.3.28. function: A <i>program organization unit</i> which, when executed, yields exactly one data element (which may be multi-valued, e.g., an <i>array</i> or <i>structure</i>), and whose <i>invocation</i> can be used in textual languages as an <i>operand</i> in an expression.	
1.3.29. function block instance (function block): An <i>instance</i> of a <i>function block type</i> .	
1.3.30. function block type: A programmable controller programming <i>language element</i> consisting of: (i) the definition of a data structure partitioned into input, output, and internal variables; and (ii) a set of operations to be performed upon the elements of the data structure when an <i>instance</i> of the function block type is <i>invoked</i> .	
1.3.31. function block diagram: One or more networks of graphically represented <i>functions</i> , <i>function blocks</i> , data elements, <i>labels</i> , and connective elements.	
1.3.32. generic data type: A <i>data type</i> which represents more than one type of data, as specified in 2.3.2.	
1.3.33. global scope: Scope of a declaration applying to all program organization units within a <i>resource</i> or <i>configuration</i> .	

LIST OF TABLES (continued)

Table	Page
1.3.34. global variable: A variable whose <i>scope</i> is <i>global</i> .	
1.3.35. hierarchical addressing: The <i>direct representation</i> of a data element as a member of a physical or logical hierarchy, e.g., a point within a module which is contained in a rack, which in turn is contained in a cubicle, etc.	
1.3.36. identifier: A combination of letters, numbers, and underline characters, as specified in 2.1.2, which begins with a letter or underline and which names a <i>language element</i> .	
1.3.37. initial value: The value assigned to a variable at system start-up.	
1.3.38. input parameter (input): A parameter which is used to supply an argument to a <i>program organization unit</i> .	
1.3.39. instance: An individual, named copy of the data structure associated with a <i>function block type</i> or <i>program type</i> , which persists from one <i>invocation</i> of the associated operations to the next.	
1.3.40. instance name: An <i>identifier</i> associated with a specific <i>instance</i> .	
1.3.41. instantiation: The creation of an <i>instance</i> .	
1.3.42. integer literal: A <i>literal</i> which directly represents a value of type SINT, INT, DINT, LINT, BOOL, BYTE, WORD, DWORD, or LWORD, as defined in 2.3.1.	
1.3.43. invocation: The process of initiating the execution of the operations specified in a <i>program organization unit</i> .	
1.3.44. keyword: A lexical unit that characterizes a <i>language element</i> , e.g., "IF".	
1.3.45. label: A language construction naming an instruction, network, or group of networks, and including an <i>identifier</i> .	
1.3.46. language element: Any item identified by a symbol on the left-hand side of a production rule in the formal specification given in annex B of this part of IEC 1131.	
1.3.47. literal: A lexical unit that directly represents a value. (ISO)	
1.3.48. local scope: The <i>scope</i> of a <i>declaration</i> or <i>label</i> applying only to the <i>program organization unit</i> in which the declaration or label appears.	
1.3.49. logical location: The location of a <i>hierarchically addressed</i> variable in a schema which may or may not bear any relation to the physical structure of the programmable controller's inputs, outputs, and memory.	
1.3.50. long real: A real number represented in a <i>long word</i> .	
1.3.51. long word: A 64-bit data element.	
1.3.52. memory (user data storage): A functional unit to which the user program can store data and from which it can retrieve the stored data.	
1.3.53. named element: An element of a <i>structure</i> which is named by its associated <i>identifier</i> .	

LIST OF TABLES (continued)

Table	Page
1.3.54. off-delay (on-delay) timer function block: A <i>function block</i> which delays the <i>falling (rising) edge</i> of a Boolean <i>input</i> by a specified duration.	
1.3.55. operand: A <i>language element</i> on which an operation is performed.	
1.3.56. operator: A symbol that represents the action to be performed in an operation.	
1.3.57. output parameter (output): A <i>parameter</i> which is used to return the result(s) of the <i>evaluation</i> of a <i>program organization unit</i> .	
1.3.58. overloaded: With respect to an operation or <i>function</i> , capable of operating on data of different types, as specified in 2.5.1.4.	
1.3.59. power flow: The symbolic flow of electrical power in a ladder diagram, used to denote the progression of a logic solving algorithm.	
1.3.60. program (verb): To design, write, and test user programs.	
1.3.61. program organization unit: A <i>function</i> , <i>function block</i> , or program. NOTE - This term may refer to either a <i>type</i> or an <i>instance</i> .	
1.3.62. real literal: A <i>literal</i> representing data of type REAL or LREAL.	
1.3.63. resource: A <i>language element</i> corresponding to a "signal processing function" and its "man-machine interface" and "sensor and actuator interface functions", if any, as defined in IEC 1131-1.	
1.3.64. retentive data: Data stored in such a way that its value remains unchanged after a power down / power up sequence.	
1.3.65. return: A language construction within a <i>program organization unit</i> designating an end to the execution sequences in the unit.	
1.3.66. rising edge: The change from 0 to 1 of a Boolean variable.	
1.3.67. scope: That portion of a <i>language element</i> within which a <i>declaration</i> or <i>label</i> applies.	
1.3.68. semantics: The relationships between the symbolic elements of a programming language and their meanings, interpretation and use.	
1.3.69. semigraphic representation: Representation of graphic information by the use of a limited set of characters.	
1.3.70. single data element: A data element consisting of a single value.	
1.3.71. step: A situation in which the behavior of a <i>program organization unit</i> with respect to its <i>inputs</i> and <i>outputs</i> follows a set of rules defined by the associated <i>actions</i> of the step.	
1.3.72. structured data type: An <i>aggregate</i> data type which has been declared using a STRUCT or FUNCTION_BLOCK declaration.	
1.3.73. subscripting: A mechanism for referencing an <i>array</i> element by means of an array reference and one or more expressions that, when evaluated, denote the position of the element.	
1.3.74. symbolic representation: The use of <i>identifiers</i> to name variables.	

LIST OF TABLES (continued)

Table	Page
1.3.75. task : An <i>execution control element</i> providing for periodic or triggered execution of a group of associated <i>program organization units</i> .	
1.3.76. time literal : A <i>literal</i> representing data of type TIME, DATE, TIME_OF_DAY, or DATE_AND_TIME.	
1.3.77. transition : The condition whereby control passes from one or more predecessor <i>steps</i> to one or more successor steps along a directed link.	
1.3.78. unsigned integer : An <i>integer literal</i> not containing a leading plus (+) or minus (-) sign.	
1.3.79. wired OR : A construction for achieving the Boolean OR function in the LD language by connecting together the right ends of horizontal connectives with vertical connectives.	
1.3.1. 1.3.80. single-element variable : A <i>variable</i> which represents a <i>single data element</i> .	

1.4 Overview and general requirements

This part of IEC 1131 specifies the syntax and semantics of a unified suite of programming languages for programmable controllers (PCs). These consist of two textual languages, IL (Instruction List) and ST (Structured Text), and two graphical languages, LD (Ladder Diagram) and FBD (Function Block Diagram).

Sequential Function Chart (SFC) elements are defined for structuring the internal organization of programmable controller *programs* and *function blocks*. Also, *configuration elements* are defined which support the installation of programmable controller *programs* into programmable controller systems.

In addition, features are defined which facilitate communication among programmable controllers and other components of automated systems.

The programming language elements defined in this part may be used in an interactive programming environment. The specification of such environments is beyond the scope of this part; however, such an environment shall be capable of producing textual or graphic program documentation in the formats specified in this part.

The material in this part is arranged in "bottom-up" fashion, that is, simpler language elements are presented first, in order to minimize forward references in the text. The remainder of this subclause provides an overview of the material presented in this part and incorporates some general requirements.


1.4.1 Software model

The basic high-level language elements and their interrelationships are illustrated in figure 1. These consist of elements which are *programmed* using the languages defined in this part, that is, *programs* and *function blocks*; and *configuration elements*, namely, *configurations*, *resources*, *tasks*, *global variables*, and *access paths*, which support the installation of programmable controller *programs* into programmable controller systems.

LIST OF TABLES (continued)

Table

Page

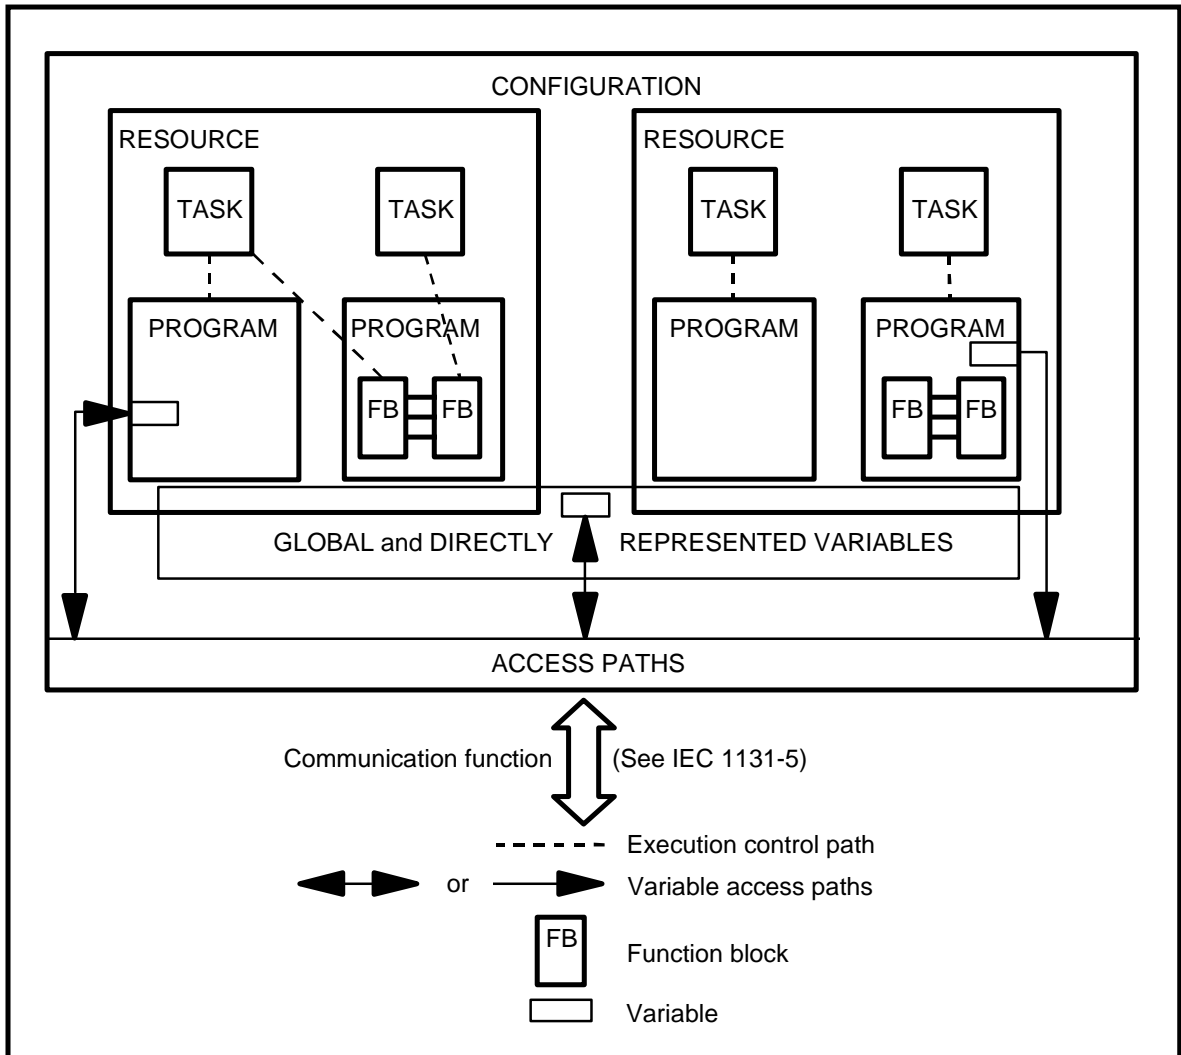

NOTES

- 1 This figure is illustrative only. The graphical representation is not normative.
- 2 In a configuration with a single resource, the resource need not be explicitly represented.

Figure 1 - Software model

A *configuration* is the language element which corresponds to a *programmable controller system* as defined in IEC 1131-1. A *resource* corresponds to a "signal processing function" and its "man-machine interface" and "sensor and actuator interface" functions (if any) as defined in IEC 1131-1. A *configuration* contains one or more *resources*, each of which contains one or more *programs* executed under the control of zero or more *tasks*. A *program* may contain zero or more *function blocks* or other language elements as defined in this part.

LIST OF TABLES (continued)

Table	Page
-------	------

Configurations and *resources* can be started and stopped via the "operator interface", "programming, testing, and monitoring", or "operating system" functions defined in IEC 1131-1. The starting of a *configuration* shall cause the initialization of its *global variables* according to the rules given in 2.4.2, followed by the starting of all the *resources* in the configuration. The starting of a *resource* shall cause the initialization of all the *variables* in the resource, followed by the enabling of all the *tasks* in the resource. The stopping of a *resource* shall cause the disabling of all its *tasks*, while the stopping of a *configuration* shall cause the stopping of all its *resources*. Mechanisms for the control of *tasks* are defined in 2.7.2, while mechanisms for the starting and stopping of *configurations* and *resources* via communication functions are defined in IEC 1131-5.

Programs, *resources*, *global variables*, *access paths* (and their corresponding access privileges), and *configurations* can be loaded or deleted by the "communication function" defined in IEC 1131-1. The loading or deletion of a *configuration* or *resource* shall be equivalent to the loading or deletion of all the elements it contains.

Access paths and their corresponding access privileges are defined in 2.7.1.

The mapping of the language elements defined in this subclause on to communication objects is defined in IEC 1131-5.


1.4.2 Communication model

Figure 2 illustrates the ways that values of variables can be communicated among software elements.

As shown in figure 2a, variable values within a program can be communicated directly by connection of the output of one program element to the input of another. This connection is shown explicitly in graphical languages and implicitly in textual languages.

Variable values can be communicated between programs in the same configuration via *global variables* such as the variable *x* illustrated in figure 2b. These variables shall be declared as GLOBAL in the configuration, and as EXTERNAL in the programs, as specified in 2.4.3.

As illustrated in figure 2c, the values of variables can be communicated between different parts of a program, between programs in the same or different configurations, or between a programmable controller program and a non-programmable controller system, using the communication function blocks defined in IEC 1131-5 and described in 2.5.2.3.5. In addition, programmable controllers or non-programmable controller systems can transfer data which is made available by *access paths*, as illustrated in figure 2d, using the mechanisms defined in IEC 1131-5.

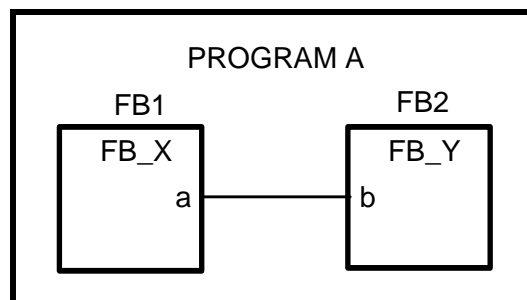

LIST OF TABLES (continued)

Table

Page

Figure 2a - Data flow connection within a program

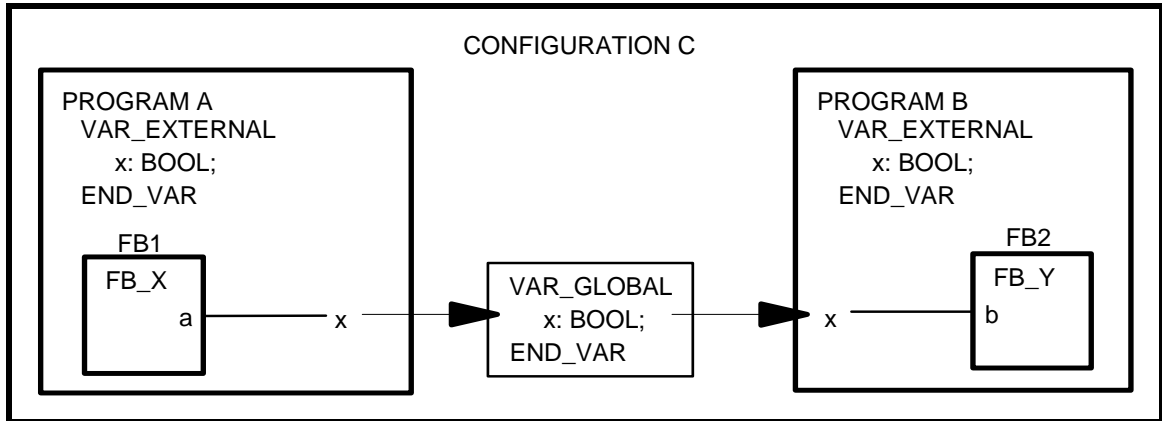


Figure 2b - Communication via GLOBAL variables

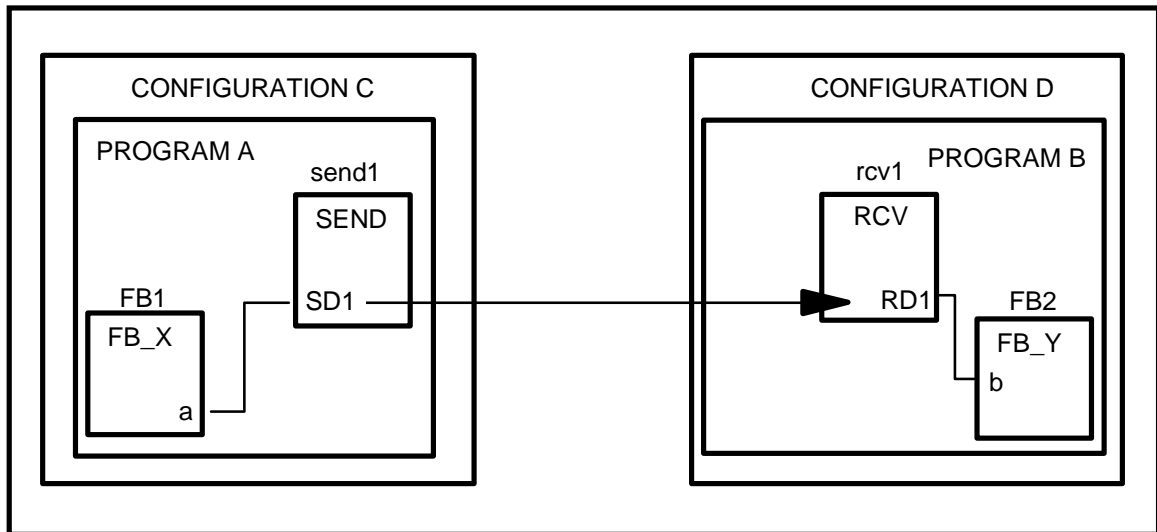


Figure 2c - Communication function blocks

LIST OF TABLES (continued)

Table

Page

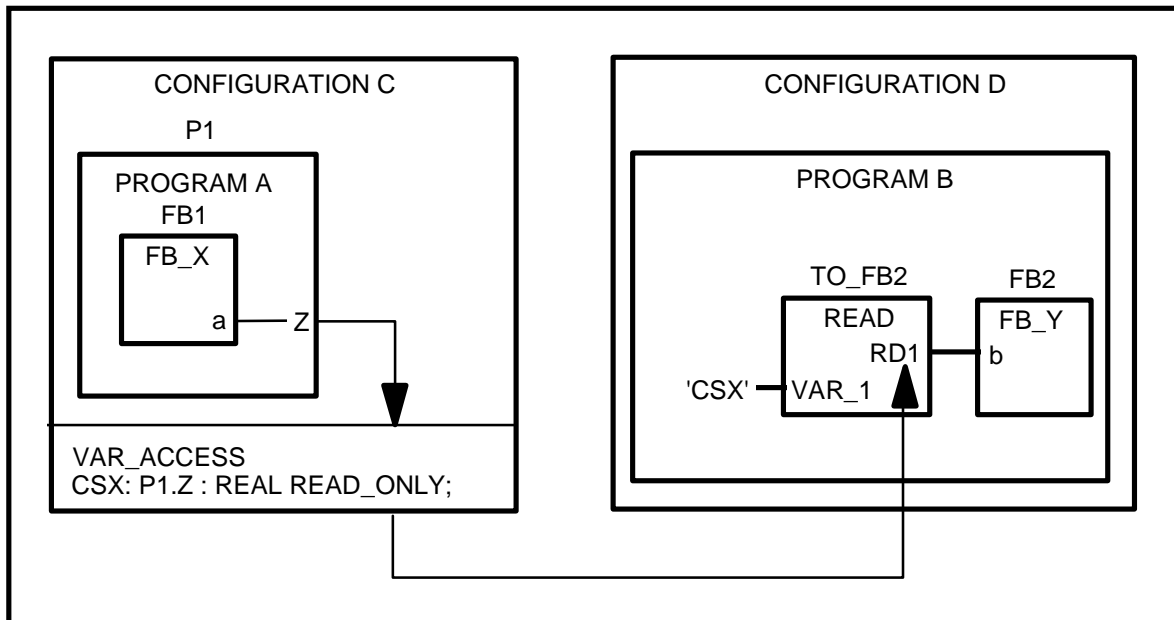


Figure 2d - Communication via access paths

NOTES

- 1 This figure is illustrative only. The graphical representation is not normative.
- 2 In these examples, configurations c and d are each considered to have a single resource.
- 3 The details of the communication function blocks are not shown in this figure. See 2.5.2.3.5 and IEC 1131-5.
- 4 As specified in 2.7, access paths can be declared on directly represented variables, global variables, or program input, output, or internal variables.
- 5 IEC 1131-5 specifies the means by which both PC and non-PC systems can use access paths for reading and writing of variables.

Figure 2 - Communication model

LIST OF TABLES (continued)

Table	Page
1.4.3 Programming model	

The elements of programmable controller programming languages, and the subclauses in which they appear in this part, are classified as follows:

- Data types (2.3)
- Program organization units (2.5)
 - Functions (2.5.1)
 - Function blocks (2.5.2)
 - Programs (2.5.3)
- Sequential Function Chart (SFC) elements (2.6)
- Configuration elements (2.7)
 - Global variables (2.7.1)
 - Resources (2.7.1)
 - Tasks (2.7.2)
 - Access paths (2.7.1)

As shown in figure 3, the combination of these elements shall obey the following rules:

- 1) Derived *data types* shall be declared as specified in 2.3.3, using the standard data types specified in 2.3.1 and 2.3.2 and any previously derived data types.
- 2) Derived *functions* can be declared as specified in 2.5.1.3, using standard or derived data types, the standard functions defined in 2.5.1.5, and any previously derived functions. This declaration shall use the mechanisms defined for the IL, ST, LD or FBD language.
- 3) Derived *function blocks* can be declared as specified in 2.5.2.2, using standard or derived data types and functions, the standard function blocks defined in 2.5.2.3, and any previously derived function blocks. This declaration shall use the mechanisms defined for the IL, ST, LD, or FBD language, and can include Sequential Function Chart (SFC) elements as defined in 2.6.
- 4) A *program* shall be declared as specified in 2.5.3, using standard or derived data types, functions, and function blocks. This declaration shall use the mechanisms defined for the IL, ST, LD, or FBD language, and can include Sequential Function Chart (SFC) elements as defined in 2.6.
- 5) *Programs* can be combined into *configurations* using the elements defined in 2.7, that is, *global variables, resources, tasks, and access paths*.


Reference to "previously derived" data types, functions, and function blocks in the above rules is intended to imply that once such a derived element has been declared, its definition is available, e.g., in a "library" of derived elements, for use in further derivations. Therefore, the declaration of a derived element type shall not be contained within the declaration of another derived element type.

A programming language other than one of those defined in this standard may be used in the declaration of a *function* or *function block*. The means by which a user program written in one of the languages defined in this standard invokes the execution of, and accesses the data associated with, such a derived function or function block shall be as defined in this standard.

LIST OF TABLES (continued)

Table

Page

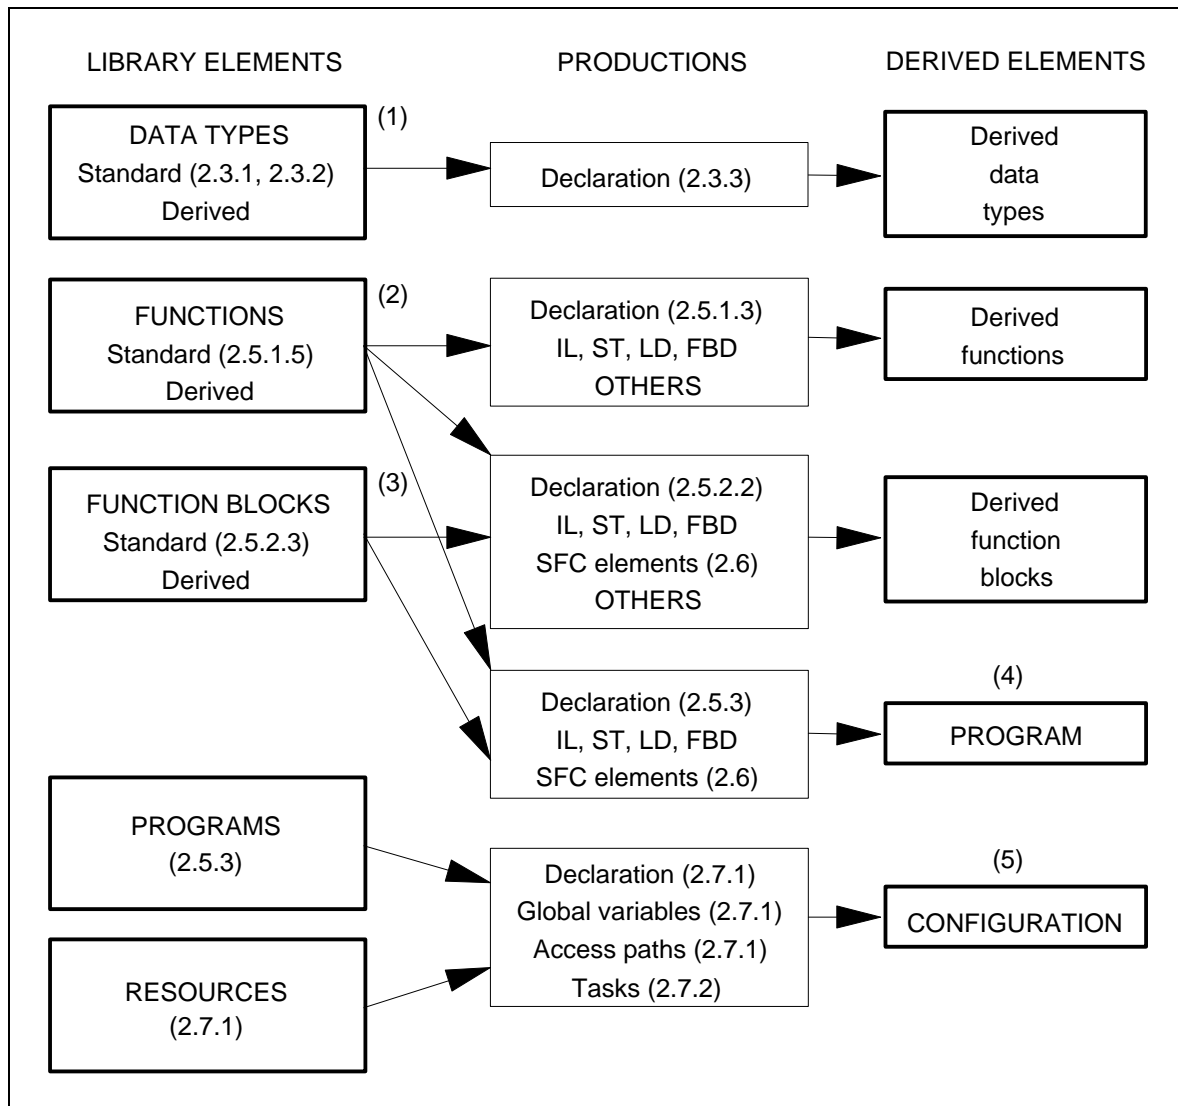

NOTES

1 The parenthesized numbers (1) to (5) refer to corresponding paragraphs in 1.4.3.

2 *Data types* are used in all productions. For clarity, the corresponding linkages are omitted in this figure.

Figure 3 - Combination of programmable controller language elements

LD - Ladder Diagram (4.2)

FBD - Function Block Diagram (4.3)

IL - Instruction List (3.2)

ST - Structured Text (3.3)

OTHERS - Other programming languages (1.4.3)

LIST OF TABLES (continued)

Table Page

1.5 Compliance

This subclause defines the requirements which shall be met by programmable controller systems and programs which claim compliance with this part of IEC 1131.

1.5.1 Programmable controller systems

A programmable controller system, as defined in IEC 1131-1, which claims to comply, wholly or partially, with the requirements of this part of IEC 1131 shall do so only as described below.

A compliance statement shall be included in the documentation accompanying the system, or shall be produced by the system itself. The form of the compliance statement shall be:

"This system complies with the requirements of IEC 1131-3, for the following language features:",

followed by a set of compliance tables in the following format:

Table title

Table No.	Feature No.	Features description
...

Table and feature numbers and descriptions are to be taken from the tables given in the relevant subclauses of this part of IEC 1131. Table titles are to be taken from the following table.

Table title	For features in:
Common elements	Clause 2
Common textual elements	Subclause 3.1
IL language elements	Subclauses 3.2.1 to 3.2.3
ST language elements	Subclauses 3.3.1 to 3.3.2.4
Common graphical elements	Subclauses 4.1 to 4.1.4
LD language elements	Subclauses 4.2 to 4.2.6
FBD language elements	Subclauses 4.3 to 4.3.3

A programmable controller system complying with the requirements of this part with respect to a language defined in this part:

- a) shall not require the inclusion of substitute or additional language elements in order to accomplish any of the features specified in this part;
- b) shall be accompanied by a document that specifies the values of all implementation-dependent parameters as listed in annex D;

LIST OF TABLES (continued)

Table		Page
c)	shall be able to determine whether or not a user's language element violates any requirement of this part, where such a violation is not designated an error in annex E, and report the result of this determination to the user. In the case where the system does not examine the whole program organization unit, the user shall be notified that the determination is incomplete whenever no violations have been detected in the portion of the program organization unit examined;	

LIST OF TABLES (continued)

Table		Page
d)	shall treat each user violation that is designated an error in annex E in at least one of the following ways: 1) there shall be a statement in an accompanying document that the error is not reported; 2) the system shall report during preparation of the program for execution that an occurrence of that error is possible; 3) the system shall report the error during preparation of the program for execution; 4) the system shall report the error during execution of the program and initiate appropriate system- or user-defined error handling procedures; and if any violations that are designated as errors are treated in the manner described in d)1) above, then a note referencing each such treatment shall appear in a separate section of the accompanying document;	
e)	shall be accompanied by a document that separately describes any features accepted by the system that are prohibited or not specified in this part. Such features shall be described as being "extensions to the <language> language as defined in IEC 1131-3";	
f)	shall be able to process in a manner similar to that specified for errors any use of any such extension;	
g)	shall be able to process in a manner similar to that specified for errors any use of one of the implementation-dependent features specified in annex D;	
h)	shall not use any of the standard data type, function or function block names defined in this part for manufacturer-defined features whose functionality differs from that described in this part;	
i)	shall be accompanied by a document defining, in the form specified in annex A, the formal syntax of all textual language elements supported by the system.	

The phrase "be able to" is used in this subclause to permit the implementation of a software switch with which the user may control the reporting of errors.

In cases where compilation or program entry is aborted due to some limitation of tables, etc., an incomplete determination of the kind "no violations were detected, but the examination is incomplete" will satisfy the requirements of this subclause.

LIST OF TABLES (continued)

Table	Page
-------	------

1.5.2 Programs

A programmable controller program complying with the requirements of IEC 1131-3:

- a) shall use only those features specified in this part for the particular language used;
- b) shall not use any features identified as extensions to the language;
- c) shall not rely on any particular interpretation of implementation-dependent features.

The results produced by a complying program shall be the same when processed by any complying system which supports the features used by the program, except as these results are influenced by program execution timing, the use of implementation-dependent features (as listed in annex D) in the program, and the execution of error handling procedures.

LIST OF TABLES (continued)

Table Page

2. Common elements

This clause defines textual and graphic elements which are common to all the programmable controller programming languages specified in this Part of IEC 1131.

2.1 Use of printed characters

2.1.1 Character set

Textual languages and textual elements of graphic languages shall be represented in terms of the "Basic code table" of the ISO/IEC 646 character set.

The encoding of characters from national or extended (8-bit) character sets shall be consistent with ISO/IEC 646.

The *required character set* shown as feature 1 in table 1 consists of all the characters in columns 3 to 7 of the "Basic code table" given as table 1 in ISO/IEC 646, except for lower-case letters and those character positions which are reserved or optionally available for use in national character sets.

The manufacturer shall support one option (a or b) for each of features (3a,b) to (6a,b) of table 1, according to the following rules:

- The "pound sign" (£) shall be used in place of the "number sign" (#) when the former occupies character position 2/3 of a national implementation of the ISO/IEC 646 character set.
- The "currency sign" shall be used in place of the "dollar sign" (\$) when the former occupies character position 2/4 of a national implementation of the ISO/IEC 646 character set.
- When the 7/12 character position in the ISO/IEC 646 character set is used by another character in a national set, the "exclamation mark" (!) at position 2/1 shall be used to represent vertical lines.
- For delimitation of subscripts, the left and right parentheses "()" shall be used in place of the left and right brackets "[]" when the latter occupy character positions of a national implementation of the ISO/IEC 646 character set.

NOTE - The use of characters from national character sets is a typical extension of this standard.

LIST OF TABLES (continued)

Table

Page

Table 1 - Character set features

No.	Description
1	Required character set (see 2.1.1)
2	Lower case characters
3a	Number sign (#) OR
3b	Pound sign (£)
4a	Dollar sign (\$) OR
4b	Currency sign
5a	Vertical bar () OR
5b	Exclamation mark (!)
6a	Subscript delimiters: Left and right brackets "[]" OR
6b	Left and right parentheses "()"
NOTE - When lower-case letters (feature 2) are supported, the case of letters shall not be significant in language elements (except within terminal symbols as defined in annexes A and B, comments as defined in 2.1.5, string literals as defined in 2.2.2, and variables of type STRING as defined in 2.3.1), e.g., the identifiers "abcd", "ABCD", and "aBCd" shall be interpreted identically.	

2.1.2 Identifiers

An *identifier* is a string of letters, digits, and underline characters which shall begin with a letter or underline character.

Underlines shall be significant in identifiers, e.g., "A_BCD" and "AB_CD" shall be interpreted as different identifiers. Multiple leading or multiple embedded underlines are not allowed.

Identifiers shall not contain imbedded space (SP) characters.

At least six characters of uniqueness shall be supported in all systems which support the use of identifiers, e.g., "ABCDE1" shall be interpreted as different from "ABCDE2" in all such systems.

Identifier features and examples are shown in table 2.

Table 2 - Identifier features

No.	Feature description	Examples
1	Upper case and numbers	IW215 IW215Z QX75 IDENT
2	Upper and lower case, numbers, embedded underlines	All the above plus: LIM_SW_5 LimSw5 abcd ab_Cd

LIST OF TABLES (continued)

Table

Page

3	Upper and lower case, numbers, leading or embedded underlines	All the above plus: _MAIN _12V7
---	---	---------------------------------

LIST OF TABLES (continued)

Table Page

2.1.3 Keywords

Keywords are unique combinations of characters utilized as individual syntactic elements as defined in annex B. All keywords used in this part are listed in annex C. Keywords shall not contain imbedded spaces. The keywords listed in annex C shall not be used for any other purpose, e.g., variable names or extensions as defined in 1.5.1.

NOTE - National standards organizations can publish tables of translations of the keywords given in annex C.

2.1.4 Use of spaces

The user shall be allowed to insert one or more spaces (code position 2/0 in the ISO/IEC 646 character set) anywhere in the text of programmable controller programs except within keywords, literals, identifiers, directly represented variables as described in subclause 2.4.1.1, or delimiter combinations (e.g., for comments as defined below).

2.1.5 Comments

User comments shall be delimited at the beginning and end by the special character combinations "(" and ")", respectively, as shown in table 3. Except in the IL language as defined in 3.2, comments shall be permitted anywhere in the program where spaces are allowed, except within character string literals as defined in 2.2.2. Comments shall have no syntactic or semantic significance in any of the languages defined in this part.

Nested comments are not allowed, e.g., (* (* NESTED *) *).

Table 3 - Comment feature

No.	Feature description	Examples
1	Comments	<pre> (***** * A framed comment * *****) </pre>

2.2 External representation of data

External representations of data in the various programmable controller programming languages shall consist of numeric literals, character strings, and time literals.

2.2.1 Numeric literals

There are two classes of numeric literals: integer literals and real literals. A numeric literal is defined as a decimal number or a based number. The maximum number of digits for each kind of numeric literal shall be sufficient to express the entire range and precision of values of all the data types which are represented by the literal in a given implementation.

LIST OF TABLES (continued)

Table Page

Single underline characters () inserted between the digits of a numeric literal shall not be significant. No other use of underline characters in numeric literals is allowed.

Decimal literals shall be represented in conventional decimal notation. Real literals shall be distinguished by the presence of a decimal point. An exponent indicates the integer power of ten by which the preceding number is to be multiplied to obtain the value represented. Decimal literals and their exponents can contain a preceding sign (+ or -).

Integer literals can also be represented in base 2, 8, or 16. The base shall be in decimal notation. For base 16, an extended set of digits consisting of the letters A through F shall be used, with the conventional significance of decimal 10 through 15, respectively. Based numbers shall not contain a leading sign (+ or -).

Boolean data shall be represented by integer literals with the value zero (0) or one (1), or the keywords FALSE or TRUE, respectively.

Numeric literal features and examples are shown in table 4.

Table 4 - Numeric literals

No.	Feature description	Examples
1	Integer literals	-12 0 123_456 +986
2	Real literals	-12.0 0.0 0.4560 3.14159_26
3	Real literals with exponents	-1.34E-12 or -1.34e-12 1.0E+6 or 1.0e+6 1.234E6 or 1.234e6
4	Base 2 literals	2#1111_1111 (255 decimal) 2#1110_0000 (240 decimal)
5	Base 8 literals	8#377 (255 decimal) 8#340 (240 decimal)
6	Base 16 literals	16#FF or 16#ff (255 decimal) 16#E0 or 16#e0 (240 decimal)
7	Boolean zero and one	0 1
8	Boolean FALSE and TRUE	FALSE TRUE
NOTE - The keywords FALSE and TRUE correspond to Boolean values of 0 and 1, respectively.		

2.2.2 Character string literals

A character string literal is a sequence of zero or more characters prefixed and terminated by the single quote character ('). In character strings, the three-character combination of the dollar sign (\$) followed by two hexadecimal digits shall be interpreted as the hexadecimal representation of the eight-bit character code, as shown in table 5. Additionally, two-character combinations beginning with the dollar sign shall be interpreted as shown in table 6 when they occur in character strings.

LIST OF TABLES (continued)

Table

Page

Table 5 - Character string literal feature

No.	Example	Explanation
1	"	Empty string (length zero)
	'A'	String of length one containing the single character A
	' '	String of length one containing the "space" character
	'\$'	String of length one containing the "single quote" character
	'\$R\$L' '\$0D\$0A'	Strings of length two containing CR and LF characters
	'\$\$1.00'	String of length five which would print as "\$1.00"

Table 6 - Two-character combinations in character strings

No.	Combination	Interpretation when printed
2	\$\$	Dollar sign
3	'\$'	Single quote
4	\$L or \$l	Line feed
5	\$N or \$n	Newline
6	\$P or \$p	Form feed (page)
7	\$R or \$r	Carriage return
8	\$T or \$t	Tab
NOTE - The "newline" character provides an implementation-independent means of defining the end of a line of data for both physical and file I/O; for printing, the effect is that of ending a line of data and resuming printing at the beginning of the next line.		

2.2.3 Time literals

The need to provide external representations for two distinct types of time-related data is recognized: *duration* data for measuring or controlling the elapsed time of a control event, and *time of day* data (which may also include date information) for synchronizing the beginning or end of a control event to an absolute time reference.

Duration and time of day literals shall be delimited on the left by the keywords defined in 2.2.3.1 and 2.2.3.2.

LIST OF TABLES (continued)

Table

Page

2.2.3.1 Duration

Duration data shall be delimited on the left by the keyword T#, TIME#, t#, or time#. The representation of duration data in terms of days, hours, minutes, seconds, and milliseconds, or any combination thereof, shall be supported as shown in table 7. The least significant time unit can be written in real notation without exponent.

The units of duration literals can be separated by underline characters.

"Overflow" of the most significant unit of a duration literal is permitted, e.g., the notation T#25h_15m is permitted.

Time units, e.g., seconds, milliseconds, etc., can be represented in upper- or lower- case letters.

Table 7 - Duration literal features

No.	Feature description	Examples
1a	Duration literals without underlines: short prefix	T#14ms T#-14ms T#14.7s T#14.7m T#14.7h t#14.7d t#25h15m t#5d14h12m18s3.5ms
1b	long prefix	TIME#14ms TIME#-14ms time#14.7s
2a	Duration literals with underlines: short prefix	t#25h_15m t#5d_14h_12m_18s_3.5ms
2b	long prefix	TIME#25h_15m time#5d_14h_12m_18s_3.5ms

2.2.3.2 Time of day and date

Prefix keywords for time of day and date literals shall be as shown in table 8. As illustrated in table 9, representation of time-of-day and date information shall be as specified in ISO 8601.

Table 8 - Date and time of day literals

No.	Feature description	Prefix Keyword
1	Date literals (long prefix)	DATE#
2	Date literals (short prefix)	D#
3	Time of day literals (long prefix)	TIME_OF_DAY#
4	Time of day literals (short prefix)	TOD#
5	Date and time literals (long prefix)	DATE_AND_TIME#

LIST OF TABLES (continued)

Table

Page

6	Date and time literals (short prefix)	DT#
---	--	-----

LIST OF TABLES (continued)

Table

Page

Table 9 - Examples of date and time of day literals

Long prefix notation	Short prefix notation
DATE#1984-06-25 date#1984-06-25	D#1984-06-25 d#1984-06-25
TIME_OF_DAY#15:36:55.36 time_of_day#15:36:55.36	TOD#15:36:55.36 tod#15:36:55.36
DATE_AND_TIME#1984-06-25-15:36:55.36 date_and_time#1984-06-25-15:36:55.36	DT#1984-06-25-15:36:55.36 dt#1984-06-25-15:36:55.36

2.3 Data types

A number of elementary (pre-defined) data types are recognized by this standard. Additionally, generic data types are defined for use in the definition of overloaded functions (see 2.5.1.4). A mechanism for the user or manufacturer to specify additional data types is also defined.

2.3.1 Elementary data types

The elementary data types, keyword for each data type, number of bits per data element, and range of values for each elementary data type shall be as shown in table 10.

LIST OF TABLES (continued)

Table

Page

Table 10 - Elementary data types

No.	Keyword	Data type	Bits	Range
1	BOOL	Boolean	1	Note 8
2	SINT	Short integer	8	Note 2
3	INT	Integer	16	Note 2
4	DINT	Double integer	32	Note 2
5	LINT	Long integer	64	Note 2
6	USINT	Unsigned short integer	8	Note 3
7	UINT	Unsigned integer	16	Note 3
8	UDINT	Unsigned double integer	32	Note 3
9	ULINT	Unsigned long integer	64	Note 3
10	REAL	Real numbers	32	Note 4
11	LREAL	Long reals	64	Note 5
12	TIME	Duration	Note 1	Note 6
13	DATE	Date (only)	Note 1	Note 6
14	TIME_OF_DAY or TOD	Time of day (only)	Note 1	Note 6
15	DATE_AND_TIME or DT	Date and time of Day	Note 1	Note 6
16	STRING	Variable-length character string	Note 1	Note 7
17	BYTE	Bit string of length 8	8	Note 7
18	WORD	Bit string of length 16	16	Note 7
19	DWORD	Bit string of length 32	32	Note 7
20	LWORD	Bit string of length 64	64	Note 7

NOTES

- 1 The length of these data elements is implementation-dependent.
- 2 The range of values for variables of this data type is from $-(2^{(\text{Bits}-1)})$ to $(2^{(\text{Bits}-1)})-1$.
- 3 The range of values for variables of this data type is from 0 to $(2^{\text{Bits}})-1$.
- 4 The range of values for variables of this data type shall be as defined in IEC 559 for the basic single width floating-point format.
- 5 The range of values for variables of this data type shall be as defined in IEC 559 for the basic double width floating-point format.
- 6 The range of values for variables of this data type is implementation-dependent.
- 7 A numeric range of values does not apply to this data type.
- 8 The possible values of variables of this data type shall be 0 and 1, corresponding to the keywords FALSE and TRUE, respectively.

LIST OF TABLES (continued)

Table

Page

2.3.2 Generic data types

In addition to the data types shown in table 10, the hierarchy of generic data types shown in table 11 can be used in the specification of inputs and outputs of standard functions and function blocks (see subclause 2.5.1.4). Generic data types are identified by the prefix "ANY".

Table 11 - Hierarchy of generic data types

<p>ANY</p> <ul style="list-style-type: none"> ANY_NUM <ul style="list-style-type: none"> ANY_REAL <ul style="list-style-type: none"> LREAL REAL ANY_INT <ul style="list-style-type: none"> LINT, DINT, INT, SINT ULINT, UDINT, UINT, USINT ANY_BIT <ul style="list-style-type: none"> LWORD, DWORD, WORD, BYTE, BOOL STRING ANY_DATE <ul style="list-style-type: none"> DATE_AND_TIME DATE TIME_OF_DAY TIME Derived (see notes)
<p>NOTES</p> <ol style="list-style-type: none"> 1 The use of generic data types in non-standard functions or function blocks is beyond the scope of this Standard. 2 The generic type of a <i>subrange</i> derived type (feature 3 of table 12) shall be ANY_INT. 3 The generic type of a <i>directly derived</i> type (feature 1 of table 12) shall be the same as the generic type of the elementary type from which it is derived. 4 The generic type of all other derived types defined in table 12 shall be ANY.

2.3.3 Derived data types

2.3.3.1 Declaration

Derived (i.e., user- or manufacturer-specified) data types can be declared using the TYPE...END_TYPE textual construction shown in table 12. These derived data types can then be used, in addition to the elementary data types defined in 2.3.1, in variable declarations as defined in 2.4.3.

LIST OF TABLES (continued)

Table	Page
-------	------

An *enumerated* data type declaration specifies that the value of any data element of that type can only take on one of the values given in the associated list of identifiers, as illustrated in table 12.

A *subrange* declaration specifies that the value of any data element of that type can only take on values between and including the specified upper and lower limits, as illustrated in table 12.

A STRUCT declaration specifies that data elements of that type shall contain sub-elements of specified types which can be accessed by the specified names. For instance, an element of data type ANALOG_CHANNEL_CONFIGURATION as declared in table 12 will contain a RANGE sub-element of type ANALOG_SIGNAL_RANGE, a MIN_SCALE sub-element of type ANALOG_DATA, and a MAX_SCALE element of type ANALOG_DATA.

An ARRAY declaration specifies that a sufficient amount of data storage shall be allocated for each element of that type to store all the data which can be indexed by the specified index subrange(s). Thus, any element of type ANALOG_16_INPUT_CONFIGURATION as shown in table 12 contains (among other elements) sufficient storage for 16 CHANNEL elements of type ANALOG_CHANNEL_CONFIGURATION. Mechanisms for access to array elements are defined in 2.4.1.2.

2.3.3.2 Initialization

The default initial value of an *enumerated* data type shall be the first identifier in the associated enumeration list, or a value specified by the assignment operator ":=". For instance, as shown in tables 12 and 14, the default initial values of elements of data types ANALOG_SIGNAL_TYPE and ANALOG_SIGNAL_RANGE are SINGLE_ENDED and UNIPOLAR_1_5V, respectively.

For data types with *subranges*, the default initial values shall be the first (lower) limit of the subrange, unless otherwise specified by an assignment operator. For instance, as declared in table 12, the default initial value of elements of type ANALOG_DATA is -4095, while the default initial value for the FILTER_PARAMETER sub-element of elements of type ANALOG_16_INPUT_CONFIGURATION is zero. In contrast, the default initial value of elements of type ANALOG_DATAZ as declared in table 14 is zero.

For other derived data types, the default initial values, unless specified otherwise by the use of the assignment operator ":= " in the TYPE declaration, shall be the default initial values of the underlying elementary data types as defined in table 13. Further examples of the use of the assignment operator for initialization are given in 2.4.2.

The default maximum length of elements of type STRING shall be an implementation-dependent value unless specified otherwise by a parenthesized maximum length (which shall not exceed the implementation-dependent default value) in the associated declaration. For example, if type STR10 is declared by

```
TYPE STR10 : STRING[10] := 'ABCDEF'; END_TYPE
```

the maximum length, default initial value, and default initial length of data elements of type STR10 are 10 characters, 'ABCDEF', and 6 characters, respectively.

LIST OF TABLES (continued)

Table

Page

Table 12 - Data type declaration features

No.	Feature/textual example
1	Direct derivation from elementary types, e.g.: TYPE R : REAL ; END_TYPE
2	Enumerated data types, e.g.: TYPE ANALOG_SIGNAL_TYPE : (SINGLE_ENDED, DIFFERENTIAL) ; END_TYPE
3	Subrange data types, e.g.: TYPE ANALOG_DATA : INT (-4095..4095) ; END_TYPE
4	Array data types, e.g.: TYPE ANALOG_16_INPUT_DATA : ARRAY [1..16] OF ANALOG_DATA ; END_TYPE
5	Structured data types, e.g.: TYPE ANALOG_CHANNEL_CONFIGURATION : STRUCT RANGE : ANALOG_SIGNAL_RANGE ; MIN_SCALE : ANALOG_DATA ; MAX_SCALE : ANALOG_DATA ; END_STRUCT ; ANALOG_16_INPUT_CONFIGURATION : STRUCT SIGNAL_TYPE : ANALOG_SIGNAL_TYPE ; FILTER_PARAMETER : SINT (0..99) ; CHANNEL : ARRAY [1..16] OF ANALOG_CHANNEL_CONFIGURATION ; END_STRUCT ; END_TYPE
NOTE - For examples of the use of these types in variable declarations, see 2.3.3.3, 2.4.1.2, and table 17.	

Table 13 - Default initial values

Data type(s)	Initial value
BOOL, SINT, INT, DINT, LINT	0
USINT, UINT, UDINT, ULINT	0
BYTE, WORD, DWORD, LWORD	0
REAL, LREAL	0.0
TIME	T#0S
DATE	D#0001-01-01
TIME_OF_DAY	TOD#00:00:00
DATE_AND_TIME	DT#0001-01-01-00:00:00

LIST OF TABLES (continued)

Table

Page

STRING	" (the empty string)
--------	----------------------

LIST OF TABLES (continued)

Table

Page

Table 14 - Data type initial value declaration features

No.	Feature/textual example
1	Initialization of directly derived types, e.g.: TYPE FREQ : REAL := 50.0 ; END_TYPE
2	Initialization of enumerated data types, e.g.: TYPE ANALOG_SIGNAL_RANGE : (BIPOLAR_10V, (* -10 to +10 VDC *) UNIPOLAR_10V, (* 0 to +10 VDC *) UNIPOLAR_1_5V, (* + 1 to + 5 VDC *) UNIPOLAR_0_5V, (* 0 to + 5 VDC *) UNIPOLAR_4_20_MA, (* + 4 to +20 mADC *) UNIPOLAR_0_20_MA (* 0 to +20 mADC *)) := UNIPOLAR_1_5V ; END_TYPE
3	Initialization of subrange data types, e.g.: TYPE ANALOG_DATAZ : INT (-4095..4095) := 0 ; END_TYPE
4	Initialization of array data types, e.g.: TYPE ANALOG_16_INPUT_DATAI : ARRAY [1..16] OF ANALOG_DATA := [8(-4095), 8(4095)] ; END_TYPE
5	Initialization of structured data type elements, e.g.: TYPE ANALOG_CHANNEL_CONFIGURATIONI : STRUCT RANGE : ANALOG_SIGNAL_RANGE ; MIN_SCALE : ANALOG_DATA := -4095 ; MAX_SCALE : ANALOG_DATA := 4095 ; END_STRUCT ; END_TYPE
6	Initialization of derived structured data types, e.g.: TYPE ANALOG_CHANNEL_CONFIGZ : ANALOG_CHANNEL_CONFIGURATIONI(MIN_SCALE := 0, MAX_SCALE := 4000); END_TYPE

2.3.3.3 Usage

The usage of variables which are declared (as defined in 2.4.3.1) to be of derived data types shall conform to the following rules:

- (1) A single-element variable, as defined in 2.4.1.1, of a derived type, can be used anywhere that a variable of its "parent's" type can be used, e.g. variables of the types R and FREQ as shown in tables 12 and 14 can be used anywhere that a variable of type REAL could be used, and variables of type ANALOG_DATA can be used anywhere that a variable of type INT could be used.

This rule can be applied recursively. For example, given the declarations below, the variable R3 of type R2 can be used anywhere a variable of type REAL can be used:

LIST OF TABLES (continued)

Table		Page
-------	--	------

```

TYPE R1 : REAL := 1.0 ; END_TYPE
TYPE R2 : R1 ; END_TYPE
VAR R3: R2; END_VAR

```

- (2) An element of a multi-element variable, as defined in 2.4.1.2, can be used anywhere the "parent" type can be used, e.g., given the declaration of ANALOG_16_INPUT_DATA in table 12 and the declaration

```
VAR INS : ANALOG_16_INPUT_DATA ; END_VAR
```

the variables INS[1] through INS[16] can be used anywhere that a variable of type INT could be used.

This rule can also be applied recursively, e.g., given the declarations of ANALOG_16_INPUT_CONFIGURATION, ANALOG_CHANNEL_CONFIGURATION, and ANALOG_DATA in table 12 and the declaration

```
VAR CONF : ANALOG_16_INPUT_CONFIGURATION ; END_VAR
```

the variable CONF.CHANNEL[2].MIN_SCALE can be used anywhere that a variable of type INT could be used.

2.4 Variables

In contrast to the external representations of data described in 2.2, *variables* provide a means of identifying data objects whose contents may change, e.g., data associated with the inputs, outputs, or memory of the programmable controller. A variable can be declared to be one of the elementary types defined in 2.3.1, or one of the derived types which are declared as defined in 2.3.3.1.

2.4.1 Representation

2.4.1.1 Single-element variables

A *single-element variable* is defined as a variable which represents a single data element of one of the elementary types defined in 2.3.1; a derived enumeration or subrange type as defined in 2.3.3.1; or a derived type whose "parentage", as defined recursively in 2.3.3.3, is traceable to an elementary, enumeration or subrange type. This subclause defines the means of representing such variables *symbolically*, or alternatively in a manner which *directly* represents the association of the data element with physical or logical locations in the programmable controller's input, output, or memory structure.

Identifiers, as defined in 2.1.2, shall be used for symbolic representation of variables.

Direct representation of a single-element variable shall be provided by a special symbol formed by the concatenation of the percent sign "%" (position 2/5 in the ISO/IEC 646 code table), a *location prefix* and a *size prefix* from table 15, and one or more unsigned integers, separated by periods ".".

Examples of directly represented variables are:

%QX75 and %Q75	Output bit 75
%IW215	Input word location 215
%QB7	Output byte location 7
%MD48	Double word at memory location 48

LIST OF TABLES (continued)

Table	Page
%IW2.5.7.1	See explanation below

The manufacturer shall specify the correspondence between the direct representation of a variable and the physical or logical location of the addressed item in memory, input or output. When a direct representation is extended with additional integer fields separated by periods, it shall be interpreted as a *hierarchical* physical or logical address with the leftmost field representing the highest level of the hierarchy, with successively lower levels appearing to the right. For instance, the variable %IW2.5.7.1 may represent the first "channel" (word) of the seventh "module" in the fifth "rack" of the second "I/O bus" of a programmable controller system.

The use of hierarchical addressing to permit a program in one programmable controller system to access data in another programmable controller shall be considered a language extension.

The use of directly represented variables is only permitted in *programs*, as defined in 2.5.3, and in *configurations* and *resources* as defined in 2.7.1. The maximum number of levels of hierarchical addressing is an implementation-dependent parameter.

Table 15 - Location and size prefix features for directly represented variables

No.	Prefix	Meaning	Default data type
1	I	Input location	
2	Q	Output location	
3	M	Memory location	
4	X	Single bit size	BOOL
5	None	Single bit size	BOOL
6	B	Byte (8 bits) size	BYTE
7	W	Word (16 bits) size	WORD
8	D	Double word (32 bits) size	DWORD
9	L	Long (quad) word (64 bits) size	LWORD
NOTE - National standards organizations can publish tables of translations of these prefixes.			

2.4.1.2 Multi-element variables

The *multi-element variable* types defined in this standard are *arrays* and *structures*.

An *array* is a collection of data elements of the same data type referenced by one or more *subscripts* enclosed in brackets and separated by commas. In the ST language defined in subclause 3.3, a subscript shall be an expression yielding a value corresponding to one of the sub-types of generic type ANY_INT as defined in table 11. The form of subscripts in the IL language defined in subclause 3.2, and the graphic languages defined in clause 4, is restricted to *single-element variables* or *integer literals*.

An example of the use of array variables in the ST language as defined in 3.3 is:

LIST OF TABLES (continued)

Table	Page
OUTARY[%MB6,SYM] := INARY[0] + INARY[7] - INARY[%MB6] * %IW62 ;	

The maximum number of subscripts, and the maximum range of subscript values, which may be used to access array variables is an implementation-dependent parameter.

A *structured variable* is a variable which is declared to be of a type which has previously been specified to be a *data structure*, i.e., a data type consisting of a collection of named elements.

An element of a structured variable shall be represented by two or more identifiers or array accesses separated by single periods ".". The first identifier represents the name of the structured element, and subsequent identifiers represent the sequence of component names to access the particular data element within the data structure.

For instance, if the variable MODULE_5_CONFIG has been declared to be of type ANALOG_16_INPUT_CONFIGURATION as shown in table 12, the following statements in the ST language defined in 3.3 would cause the value SINGLE_ENDED to be assigned to the element SIGNAL_TYPE of the variable MODULE_5_CONFIG, while the value BIPOLAR_10V would be assigned to the RANGE sub-element of the fifth CHANNEL element of MODULE_5_CONFIG:

```
MODULE_5_CONFIG.SIGNAL_TYPE := SINGLE_ENDED;
MODULE_5_CONFIG.CHANNEL[5].RANGE := BIPOLAR_10V;
```

The maximum number of levels of structure element addressing is an implementation-dependent parameter.

2.4.2 Initialization

When a configuration element (*resource* or *configuration*) is "started" as defined in 1.4.1, each of the variables associated with the configuration element and its *programs* can take on one of the following initial values:

- the value the variable had when the configuration element was "stopped" (a *retained* value);
- a user-specified initial value;
- the default initial value for the variable's associated data type.

The user can declare that a variable is to be *retentive* by using the RETAIN qualifier specified in table 16, when this feature is supported by the implementation.

The initial value of a variable upon starting of its associated configuration element shall be determined according to the following rules:

- 1) If the starting operation is a "warm restart" as defined in IEC 1131-1, the initial values of *retentive* variables shall be their *retained* values as defined above.
- 2) If the operation is a "cold restart" as defined in IEC 1131-1, the initial values of *retentive* variables shall be the user-specified initial values, or the default value, as defined in 2.3.3.2, for the associated data type of any variable for which no initial value is specified by the user.

LIST OF TABLES (continued)

Table	Page
3) Non-retained variables shall be initialized to the user-specified initial values, or to the default value, as defined in 2.3.3.2, for the associated data type of any variable for which no initial value is specified by the user.	
4) Variables which represent <i>inputs</i> of the <i>programmable controller system</i> as defined in IEC 1131-1 shall be initialized in an implementation-dependent manner.	

2.4.3 Declaration

Each programmable controller program organization unit type declaration (i.e., each declaration of a *program*, *function*, or *function block*, as defined in 2.5) shall contain at its beginning at least one *declaration part* which specifies the types (and, if necessary, the physical or logical location) of the variables used in the organization unit. This declaration part shall have the textual form of one of the keywords VAR, VAR_INPUT, or VAR_OUTPUT as defined in table 16, followed in the case of VAR by zero or one occurrence of the qualifier RETAIN or the qualifier CONSTANT, and in the case of VAR_OUTPUT by zero or one occurrence of the qualifier RETAIN, followed by one or more declarations separated by semicolons and terminated by the keyword END_VAR. When a programmable controller supports the declaration by the user of initial values for variables, this declaration shall be accomplished in the declaration part(s) as defined in this subclause.

The *scope* (range of validity) of the declarations contained in the declaration part shall be *local* to the program organization unit in which the declaration part is contained. That is, the declared variables shall not be accessible to other program organization units except by explicit parameter passing via variables which have been declared as *inputs* or *outputs* of those units. The one exception to this rule is the case of variables which have been declared to be *global*, as defined in 2.7.1. Such variables are only accessible to a program organization unit via a VAR_EXTERNAL declaration. The type of a variable declared in a VAR_EXTERNAL block shall agree with the type declared in the VAR_GLOBAL block of the associated *program*, *configuration* or *resource*.

LIST OF TABLES (continued)

Table

Page

Table 16 - Variable declaration keywords

Keyword	Variable usage
VAR	Internal to organization unit
VAR_INPUT	Externally supplied, not modifiable within organization unit
VAR_OUTPUT	Supplied by organization unit to external entities
VAR_IN_OUT	Supplied by external entities Can be modified within organization unit NOTE - Examples of the use of these variables are given in figures 11b and 12
VAR_EXTERNAL	Supplied by configuration via VAR_GLOBAL (2.7.1) Can be modified within organization unit
VAR_GLOBAL	Global variable declaration (2.7.1)
VAR_ACCESS	Access path declaration (2.7.1)
RETAIN	Retentive variables (see preceding text)
CONSTANT	Constant (variable cannot be modified)
AT	Location assignment (2.4.3.1)
NOTE - The usage of these keywords is a feature of the program organization unit or configuration element in which they are used; see 2.5 and 2.7.	

2.4.3.1 Type assignment

As shown in table 17, the VAR...END_VAR construction shall be used to specify data types and retentivity for directly represented variables. This construction shall also be used to specify data types, retentivity, and (where necessary, in *programs* only) the physical or logical location of symbolically represented single- or multi-element variables. The usage of the VAR_INPUT, VAR_OUTPUT, and VAR_IN_OUT constructions is defined in 2.5.

The assignment of a physical or logical address to a symbolically represented variable shall be accomplished by the use of the AT keyword. Where no such assignment is made, automatic allocation of the variable to an appropriate location in the programmable controller memory shall be provided.

Table 17 - Variable type assignment features

No.	Feature/examples
1	Declaration of directly represented, non-retentive variables

LIST OF TABLES (continued)

Table			Page
	VAR AT %IW6.2 : WORD; AT %MW6 : INT ; END_VAR	16-bit string (note 2) 16-bit integer, initial value = 0	
2	Declaration of directly represented retentive variables		
	VAR RETAIN AT %QW5 : WORD ; END_VAR	At cold restart, %QW5 will be initialized to a 16-bit string with value 0	
3	Declaration of locations of symbolic variables		
	VAR_GLOBAL LIM_SW_S5 AT %IX27 : BOOL; CONV_START AT %QX25 : BOOL; TEMPERATURE AT %IW28: INT ; END_VAR	Assigns input bit 27 to the Boolean variable LIM_SW_5 (note 2) Assigns output bit 25 to the Boolean variable CONV_START Assigns input word 28 to the integer variable TEMPERATURE (note 2)	
4	Array location assignment		
	VAR INARY AT %IW6 : ARRAY [0..9] OF INT ; END_VAR	Declares an array of 10 integers to be allocated to contiguous input locations starting at %IW6 (note 2)	
5	Automatic memory allocation of symbolic variables		
	VAR CONDITION_RED : BOOL; IBOUNCE : WORD ; MYDUB : DWORD ; AWORD, BWORD, CWORD : INT; MYSTR: STRING[10] ; END_VAR	Allocates a memory bit to the Boolean variable CONDITION_RED. Allocates a memory word to the 16-bit string variable IBOUNCE. Allocates a double memory word to the 32-bit-string variable MYDUB. Allocates 3 separate memory words for the integer variables AWORD, BWORD, and CWORD. Allocates memory to contain a string with a maximum length of 10 characters. After initialization, the string has length 0 and contains the empty string ".	
6	Array declaration		
	VAR THREE : ARRAY[1..5,1..10,1..8] OF INT; END_VAR	Allocates 400 memory words for a three-dimensional array of integers	
7	Retentive array declaration		
	VAR RETAIN RTBT: ARRAY[1..2,1..3] OF INT; END_VAR	Declares retentive array RTBT with "cold restart" initial values of 0 for all elements	
8	Declaration of structured variables		

LIST OF TABLES (continued)

Table	Page
VAR MODULE_8_CONFIG : ANALOG_16_INPUT_CONFIGURATION; END_VAR	Declaration of a variable of derived data type (see table 12)
<p>NOTES</p> <p>1 Features 1 to 4 can only be used in PROGRAM and VAR_GLOBAL declarations, as defined in 2.5.3 and 2.7.1 respectively.</p> <p>2 Initialization of system inputs is implementation-dependent; see 2.4.2.</p>	

LIST OF TABLES (continued)

Table Page

2.4.3.2 Initial value assignment

The VAR...END_VAR construction shown in table 18 shall be used to specify initial values of directly represented variables. This construction shall also be used to assign initial values of symbolically represented single- or multi-element variables (the usage of the VAR_INPUT, VAR_OUTPUT, and VAR_IN_OUT constructions is defined in 2.5).

Initial values cannot be given in VAR_EXTERNAL declarations.

During initialization of arrays, the rightmost subscript of an array shall vary most rapidly with respect to filling the array from the list of initialization variables.

Parentheses can be used as a repetition factor in array initialization lists, e.g., "2(1,2,3)" is equivalent to the initialization sequence "1,2,3,1,2,3".

If the number of initial values given in the initialization list exceeds the number of array entries, the excess (rightmost) initial values shall be ignored. If the number of initial values is less than the number of array entries, the remaining array entries shall be filled with the default initial values for the corresponding data type. In either case, the user shall be warned of this condition during preparation of the program for execution.

When a variable is declared to be of a derived, structured data type as defined in 2.3.3.1, initial values for the elements of the variable can be declared in a parenthesized list following the data type identifier, as shown in table 18. Elements for which initial values are not listed in the initial value list shall have the default initial values declared for those elements in the data type declaration.

Table 18 - Variable initial value assignment features

No.	Feature/examples	
1	Initialization of directly represented, non-retentive variables	
	<pre>VAR AT %QX5.1 : BOOL :=1; AT %MW6 : INT := 8 ; END_VAR</pre>	Boolean type, initial value =1 Initializes a memory word to integer 8
2	Initialization of directly represented retentive variables	
	<pre>VAR RETAIN AT %QW5 : WORD := 16#FF00 ; END_VAR</pre>	At cold restart, the 8 most significant bits of the 16-bit string at output word 5 are to be initialized to 1 and the 8 least significant bits to 0
3	Location and initial value assignment to symbolic variables	
	<pre>VAR VALVE_POS AT %QW28 : INT := 100; END_VAR</pre>	Assigns output word 28 to the integer variable VALVE_POS, with an initial value of 100
4	Array location assignment and initialization	
	<pre>VAR OUTARY AT %QW6 : ARRAY [0..9] OF INT := [10(1)] ; END_VAR</pre>	Declares an array of 10 integers to be allocated to contiguous output locations starting at %QW6, each with an initial value of 1
5	Initialization of symbolic variables	

LIST OF TABLES (continued)

Table

Page

	<pre>VAR MYBIT : BOOL := 1 ; OKAY : STRING[10] := 'OK'; END_VAR</pre>	<p>Allocates a memory bit to the Boolean variable MYBIT with an initial value of 1.</p> <p>Allocates memory to contain a string with a maximum length of 10 characters. After initialization, the string has length 2 and contains the two-byte sequence of characters 'OK' in the ISO/IEC 646 character set, in an order appropriate for printing as a character string.</p>
6	Array initialization	
	<pre>VAR BITS : ARRAY[0..7] OF BOOL := [1,1,0,0,0,1,0,0] ; TBT : ARRAY [1..2,1..3] OF INT := [1,2,3(4),6] ; END_VAR</pre>	<p>Allocates 8 memory bits to contain initial values BITS[0]:= 1, BITS[1] := 1, ..., BITS[6]:= 0, BITS[7] := 0.</p> <p>Allocates a 2-by-3 integer array TBT with initial values TBT[1,1]:=1, TBT[1,2]:=2, TBT[1,3]:=4, TBT[2,1]:=4, TBT[2,2]:=4, TBT[2,3]:=6.</p>
7	Retentive array declaration and initialization	
	<pre>VAR RETAIN RTBT : ARRAY(1..2,1..3) OF INT := [1,2,3(4)]; END_VAR</pre>	<p>Declares retentive array RTBT with "cold restart" initial values of: RTBT[1,1] := 1, RTBT[1,2] := 2, RTBT[1,3] := 4, RTBT[2,1] := 4, RTBT[2,2] := 4, RTBT[2,3] := 0.</p>
8	Initialization of structured variables	
	<pre>VAR MODULE_8_CONFIG : ANALOG_16_INPUT_CONFIGURATION (SIGNAL_TYPE := DIFFERENTIAL, CHANNEL := [4((RANGE := UNIPOLAR_1_5)), (RANGE := BIPOLAR_10_V, MIN_SCALE := 0, MAX_SCALE := 500)]); END_VAR</pre>	<p>Initialization of a variable of derived data type (see table 12)</p> <p>NOTE - This example illustrates the declaration of a non-default initial value for the fifth element of the CHANNEL array of the variable MODULE_8_CONFIG.</p>
9	Initialization of constants	
	<pre>VAR CONSTANT PI : REAL := 3.141592 ; END_VAR</pre>	
<p>NOTE - Features 1 to 4 can only be used in PROGRAM and VAR_GLOBAL declarations, as defined in 2.5.3 and 2.7.1 respectively.</p>		

2.5 Program organization units

The program organization units defined in this Part of IEC 1311 are the *function*, *function block*, and *program*. These program organization units can be delivered by the manufacturer, or programmed by the user by the means defined in this part of the standard.

Program organization units shall not be *recursive*; that is, the invocation of a program organization unit shall not cause the invocation of another program organization unit of the same type.

LIST OF TABLES (continued)

Table

Page

2.5.1 Functions

For the purposes of programmable controller programming languages, a *function* is defined as a program organization unit which, when executed, yields exactly one data element (which can be multi-valued, e.g., an array or structure), and whose invocation can be used in textual languages as an operand in an expression. For example, the SIN and COS functions could be used as shown in figure 4.

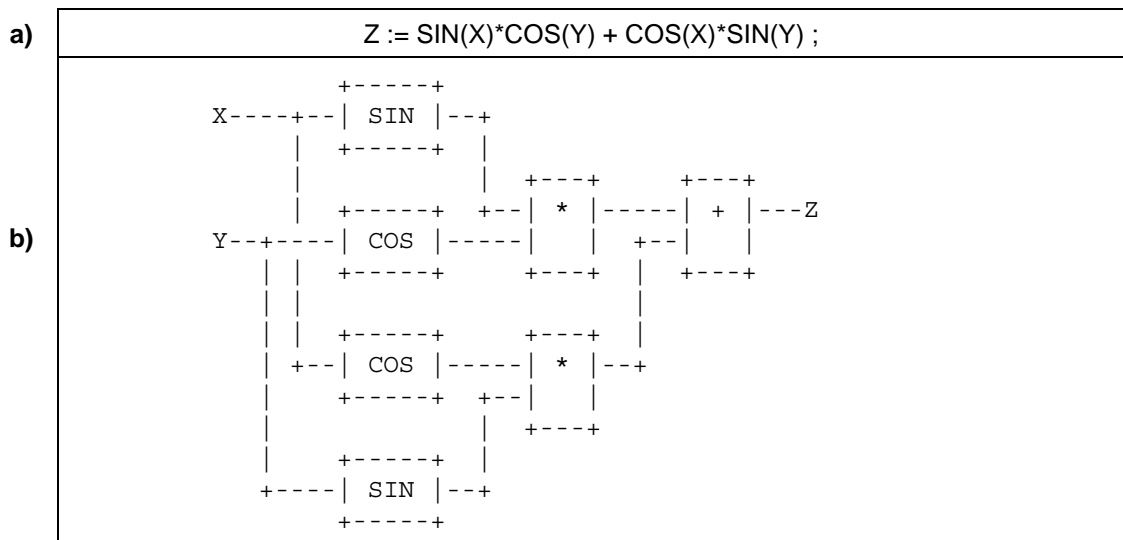


Figure 4 - Examples of function usage
a) Structured Text (ST) language; see subclause 3.3
b) Function Block Diagram (FBD) language; see subclause 4.3

Functions shall contain no internal state information, i.e., invocation of a function with the same arguments (input parameters) shall always yield the same value (output).

Any function type which has already been declared can be used in the declaration of another program organization unit, as shown in figure 3.

LIST OF TABLES (continued)

Table Page

2.5.1.1 Representation

Functions and their invocation can be represented either graphically or textually.

In the graphic languages defined in clause 4 of this part, functions shall be represented as graphic blocks according to the following rules:

- 1) The form of the block shall be rectangular or square.
- 2) The size and proportions of the block may vary depending on the number of inputs and other information to be displayed.
- 3) The direction of processing through the block shall be from left to right (input parameters on the left and output parameter on the right).
- 4) The function name or symbol, as specified below, shall be located inside the block.
- 5) Provision shall be made for formal input parameter names appearing at the inside left of the block when the block represents:
 - one of the standard functions defined in subclause 2.5.1.5, when the given graphical form includes the formal parameter names; or
 - any additional function declared as specified in subclause 2.5.1.3.
- 6) Since the name of the function is used for the assignment of its output value as specified in 2.5.1.3, no formal output parameter name shall be shown at the right side of the block.
- 7) Actual parameter connections shall be shown by signal flow lines.
- 8) Negation of Boolean signals shall be shown by placing an open circle just outside of the input or output line intersection with the block. In the ISO/IEC 646 character set, this shall be represented by the upper case alphabetic "O", as shown in table 19.
- 9) The output of a graphically represented function shall be represented by a single line at the right side of the block, even though the output may be a multi-element variable.

Table 19 - Graphical negation of Boolean signals

No.	Feature	Representation
1	Negated input	<pre> +----+ ---O --- +----+ </pre>
2	Negated output	<pre> +----+ ---- O--- +----+ </pre>
NOTE - If either of these features is supported for functions, it shall also be supported for function blocks as defined in 2.5.2, and vice versa.		

LIST OF TABLES (continued)

Table	Page
Figure 5 illustrates both the graphical and equivalent textual use of functions, including the use of a standard function (ADD) with no defined formal parameter names, and another standard function (SHL) with defined formal parameter names.	

LIST OF TABLES (continued)

Table

Page

Example	Explanation
<pre> +-----+ ADD B--- ---A C--- D--- +-----+ </pre>	Graphical use of "ADD" function (See 2.5.1.5.2) (FBD language; see 4.3) (No formal parameter names)
A := ADD(B, C, D);	Textual use of "ADD" function (ST language; see 3.3)
<pre> +-----+ SHL B--- IN ---A C--- N +-----+ </pre>	Graphical use of "SHL" function (See 2.5.1.5.3) (FBD language; see 4.3) (Formal parameter names)
A := SHL(IN := B, N := C);	Textual use of "SHL" function (ST language; see 3.3)

Figure 5 - Use of formal parameter names

Features for the textual invocation of functions are defined in table 19a. Textual invocation of a function shall consist of the function name followed by a list of comma-separated parameters. In the ST language defined in subclause 3.3, this list shall be delimited on the left and right by parentheses. In features 1 and 3 of table 19a, this list shall contain exactly the same number of parameters, in exactly the same order and types as given in the function definition. In features 1 and 2 of table 19a, this list has the form of a set of assignments of actual values to the formal parameter names. In feature 2 of table 19a, any parameter not assigned a value in the list shall have the default value, if any, assigned in the function specification, or the default value for the associated data type.

TABLE 19a - Textual invocation of functions

No.	Feature			Example
	Parameter assignment	Parameter order	Number of parameters	
1	yes	fixed	fixed	A := LIMIT(MN:=1, IN:= B, MX:= 5);
2	yes	any	any	A := LIMIT(IN := B, MX := 5);
3	no	fixed	fixed	A := ADD(B,C,D);

NOTES:

1 Feature #3 is required for invocation of any of the standard functions defined in subclause 2.5.1.5 without formal names for one or more input parameters.

LIST OF TABLES (continued)

Table	Page
2 In the example given in feature #2, the MN parameter will have the default value 0 (zero).	

2.5.1.2 Execution control

As shown in table 20, an additional Boolean "EN" (Enable) input and "ENO" (Enable Out) output shall be used with functions in the LD language defined in 4.2, and their use shall also be possible in the FBD language defined in this part. These variables are considered to be available in every function according to the implicit declarations

```
VAR_INPUT EN: BOOL := 1; END_VAR  
VAR_OUTPUT ENO: BOOL; END_VAR
```

When these variables are used, the execution of the operations defined by the function shall be controlled according to the following rules:

- 1) If the value of EN is FALSE (0) when the function is invoked, the operations defined by the function body shall not be executed and the value of "ENO" shall be reset to FALSE (0) by the programmable controller system.
- 2) Otherwise, the value of ENO shall be set to TRUE (1) by the programmable controller system, and the operations defined by the function body shall be executed. These operations can include the assignment of a Boolean value to ENO.
- 3) If one of the errors defined in annex E occurs during the execution of one of the standard functions defined in 2.5.1.5, the ENO output of that function shall be reset to FALSE (0) by the programmable controller system.

NOTE - The use of the ENO output is an allowable exception to the rule that the execution of a function yields exactly one output.

LIST OF TABLES (continued)

Table

Page

Table 20 - Use of EN input and ENO output

No.	Feature	Example
1	Use of "EN" and "ENO" Required for LD (Ladder Diagram) language (see 4.2)	<pre> +-----+ ADD_EN + ADD_OK +--- --- EN ENO ---()---+ A--- ---C B--- +-----+ </pre>
2	Use of "EN" and "ENO" Optional for FBD (Function Block Diagram) language (see 4.3)	<pre> +-----+ + ADD_EN-- EN ENO ---ADD_OK A--- ---C B--- +-----+ </pre>
3	FBD without "EN" and "ENO"	<pre> +-----+ A--- + ---C B--- +-----+ </pre>

2.5.1.3 Declaration

A function shall be declared textually or graphically.

As illustrated in figure 6, the textual declaration of a function shall consist of the following elements:

- 1) The keyword FUNCTION, followed by an identifier specifying the name of the function being declared, a colon (:), and the data type of the value to be returned by the function;
- 2) A VAR_INPUT...END_VAR construct as defined in 2.4.2, specifying the names and types of the function's input parameters;
- 3) A VAR...END_VAR construct, if required, specifying the names and types of the function's internal variables;
- 4) A *function body*, written in one of the languages defined in this part, or another programming language as defined in 1.4.3, which specifies the operations to be performed upon the input parameter(s) in order to assign one or more values to a variable with the same name as the function, which represents the value to be returned by the function;
- 5) The terminating keyword END_FUNCTION.

As illustrated in figure 6, the graphic declaration of a function shall consist of the following elements:

- 1) The bracketing keywords FUNCTION...END_FUNCTION or a graphical equivalent;
- 2) A graphic specification of the function name and the names and types of the function's inputs and output;

LIST OF TABLES (continued)

Table Page

- 3) A specification of the names and types of the internal variables used in the function, e.g., using the VAR...END_VAR construct;
- 4) A function body as defined above.

a)	<pre> FUNCTION SIMPLE_FUN : REAL VAR_INPUT A,B : REAL ; (* External interface specification *) C : REAL := 1.0; END_VAR SIMPLE_FUN := A*B/C; (* Function body specification *) END_FUNCTION </pre>
b)	<pre> FUNCTION +-----+ SIMPLE_FUN REAL---- A ----REAL REAL---- B (* External interface specification *) REAL---- C +-----+ +----+ (* Function body specification *) A--- * +----+ B--- --- / ---SIMPLE_FUN +----+ C----- +----+ END_FUNCTION </pre>

NOTE - In example a), the input variable C is given a default value of 1.0, as specified in 2.4.3.2, to avoid a "division by zero" error if the input is not specified when the function is invoked, for example, if a graphical input to the function is left unconnected.

Figure 6 - Examples of function declarations

- a) Textual declaration in ST language (see 3.3)**
- b) Graphical declaration in FBD language (see 4.3)**

2.5.1.4 Typing, overloading, and type conversion

A standard function, function block type, operator, or instruction is said to be *overloaded* when it can operate on input data elements of various types within a generic type designator as defined in 2.3.2. For instance, an overloaded addition function on generic type ANY_NUM can operate on data of types LREAL, REAL, DINT, INT, and SINT.

When a programmable controller system supports an overloaded standard function, function block type, operator, or instruction, this standard function, function block type, operator, or instruction shall apply to all data types of the given generic type which are supported by that system. For example, if a programmable controller system supports the overloaded function ADD and the data types SINT, INT, and REAL, then the system shall support the ADD function on inputs of type SINT, INT, and REAL.

When a function which normally represents an overloaded operator is to be typed, i.e., the types of its inputs and outputs restricted to a particular subtype, this shall be done by appending an "underline" character followed by the required type, as shown in table 21.

LIST OF TABLES (continued)

Table

Page

Table 21 - Typed and overloaded functions

No.	Feature	Example
1	Overloaded functions	<pre> +-----+ ADD ANY_NUM----- -----ANY_NUM ANY_NUM----- . . ANY_NUM----- +-----+ </pre>
2	Typed functions	<pre> +-----+ ADD_INT INT----- -----INT INT----- . . INT----- +-----+ </pre>
<p>NOTES</p> <p>1 If feature 2 is supported, the manufacturer shall provide a table of which functions are overloaded and which are typed in the implementation.</p> <p>2 The overloading of non-standard functions or function block types is beyond the scope of this Standard.</p>		

When all the formal input parameters to a standard function defined in 2.5.1.5 are of the same generic type then all the actual parameters shall be of the same type. If necessary, the type conversion functions defined in 2.5.1.5.1 can be used to meet this requirement. The output value of the function, if it is of the same generic type as the inputs, shall then have the same type as the actual inputs, except as noted in Tables 22 and 30. Examples of the application of this rule are given in figures 7 and 8.

Type declaration (ST language - see 3.3)	Usage (FBD language - see 4.3) (ST language - see 3.3)
<pre> VAR . A : INT ; . B : INT ; . C : INT ; END_VAR </pre>	<pre> +----+ A--- + ---C B--- +----+ C := A+B; </pre>
<pre> VAR A : INT ; B : REAL ; C : REAL ; END_VAR </pre>	<pre> +-----+ +----+ A--- INT_TO_REAL --- + ---C +-----+ B----- +-----+ C := INT_TO_REAL(A)+B; </pre>

LIST OF TABLES (continued)

Table

Page

<pre> VAR A : INT ; B : INT ; C : REAL; END_VAR </pre>	<pre> +---+ +-----+ A---- + --- INT_TO_REAL ---C B---- +-----+ +---+ C := INT_TO_REAL(A+B); </pre>
--	---

NOTE - Type conversion is not required in the first example shown above.

Figure 7 - Examples of explicit type conversion with overloaded functions

LIST OF TABLES (continued)

Table

Page

Type declaration (ST language - see 3.3)	Usage (FBD language - see 4.3) (ST language - see 3.3)
<pre>VAR A : INT ; B : INT ; C : INT ; END_VAR</pre>	<pre> +-----+ A--- ADD_INT ---C B--- +-----+ C := ADD_INT (A,B) ;</pre>
<pre>VAR A : INT ; B : REAL ; C : REAL; END_VAR</pre>	<pre> +-----+ +-----+ A--- INT_TO_REAL --- ADD_REAL ---C +-----+ B----- +-----+ C := ADD_REAL (INT_TO_REAL(A), B) ;</pre>
<pre>VAR A : INT ; B : INT ; C : REAL; END_VAR</pre>	<pre> +-----+ +-----+ A--- ADD_INT --- INT_TO_REAL ---C +-----+ B--- +-----+ C := INT_TO_REAL (ADD_INT (A, B)) ;</pre>

NOTE - Type conversion is not required in the first example shown above.

Figure 8 - Examples of explicit type conversion with typed functions

2.5.1.5 Standard functions

Definitions of functions common to all programmable controller programming languages are given in this subclause. Where graphical representations of standard functions are shown in this subclause, equivalent textual declarations may be written as specified in 2.5.1.3.

A standard function specified in this subclause to be *extensible* is allowed to have a variable number of inputs, and shall be considered as applying the indicated operation to each input in turn, e.g., extensible addition shall give as its output the sum of all its inputs. The maximum number of inputs of an extensible function is an implementation-dependent parameter.

2.5.1.5.1 Type conversion functions

As shown in table 22, type conversion functions shall have the form *_TO_**, where "*" is the type of the input variable IN, and "**" the type of the output variable OUT, e.g., INT_TO_REAL.

LIST OF TABLES (continued)

Table

Page

Table 22 - Type conversion function features

No.	Graphical form	Usage example	Notes
1	<pre> +-----+ * --- *_TO_** --- ** +-----+ (*) - Input data type, e.g., INT (**) - Output data type, e.g.,REAL (*_TO_**) - Function name, e.g., INT_TO_REAL </pre>	<p>A := INT_TO_REAL(B) ;</p>	<p>1 2 5</p>
2	<pre> +-----+ ANY_REAL--- TRUNC ---ANY_INT +-----+ </pre>	<p>A := TRUNC(B) ;</p>	<p>3</p>
3	<pre> +-----+ ANY_BIT-- BCD_TO_** ---ANY_INT +-----+ </pre>	<p>A := BCD_TO_INT(B) ;</p>	<p>4</p>
4	<pre> +-----+ ANY_INT-- *_TO_BCD ---ANY_BIT +-----+ </pre>	<p>A := INT_TO_BCD(B) ;</p>	<p>4</p>

LIST OF TABLES (continued)

Table

Page

NOTES

1 A statement of conformance to feature 1 of this table shall include a list of the specific type conversions supported, and a statement of the effects of performing each conversion.

2 Conversion from type REAL or LREAL to SINT, INT, DINT or LINT shall round according to the convention of IEC 559, according to which, if the two nearest integers are equally near, the result shall be the nearest even integer, e.g.:

REAL_TO_INT(1.6) is equivalent to 2
REAL_TO_INT(-1.6) is equivalent to -2
REAL_TO_INT(1.5) is equivalent to 2
REAL_TO_INT(-1.5) is equivalent to -2
REAL_TO_INT(1.4) is equivalent to 1
REAL_TO_INT(-1.4) is equivalent to -1
REAL_TO_INT(2.5) is equivalent to 2
REAL_TO_INT(-2.5) is equivalent to -2

3 The function TRUNC shall be used for truncation toward zero of a REAL or LREAL, yielding one of the integer types, for instance,

TRUNC(1.6) is equivalent to 1
TRUNC(-1.6) is equivalent to -1
TRUNC(1.4) is equivalent to 1
TRUNC(-1.4) is equivalent to -1

4 The conversion functions *_TO_BCD and BCD_TO_** are defined to perform conversions between variables of type BYTE, WORD, DWORD, and LWORD and variables of type SINT, INT, and DINT (represented by "*" or "**"), when the corresponding bit-string variables contain data encoded in BCD format. For example, the value of INT_TO_BCD(25) would be 2#0010_0101, and the value of BCD_TO_INT (2#0011_0110_1001) would be 369.

5 When an input or output of a type conversion function is of type STRING, the character string data shall conform to the external representation of the corresponding data, as specified in 2.2, in the ISO/IEC 646 character set.

6 Usage examples are given in the ST language defined in 3.3.

LIST OF TABLES (continued)

Table

Page

2.5.1.5.2 Numerical functions

The standard graphical representation, function names, input and output variable types, and function descriptions of functions of a single numeric variable shall be as defined in table 23. These functions shall be overloaded on the defined generic types, and can be typed as defined in 2.5.1.4. For these functions, the types of the input and output shall be the same.

The standard graphical representation, function names and symbols, and descriptions of arithmetic functions of two or more variables shall be as shown in table 24. These functions shall be overloaded on all numeric types, and can be typed as defined in 2.5.1.4.

Table 23 - Standard functions of one numeric variable

Graphical form			Usage example
<pre> +-----+ * --- ** --- * +-----+ (*) - Input/Output (I/O) type (**) - Function name </pre>			<p>A := SIN(B) ; (ST language - see 3.3)</p>
No.	Function name	I/O type	Description
General functions			
1	ABS	ANY_NUM	Absolute value
2	SQRT	ANY_REAL	Square root
Logarithmic functions			
3	LN	ANY_REAL	Natural logarithm
4	LOG	ANY_REAL	Logarithm base 10
5	EXP	ANY_REAL	Natural exponential
Trigonometric functions			
6	SIN	ANY_REAL	Sine of input in radians
7	COS	ANY_REAL	Cosine in radians
8	TAN	ANY_REAL	Tangent in radians
9	ASIN	ANY_REAL	Principal arc sine
10	ACOS	ANY_REAL	Principal arc cosine
11	ATAN	ANY_REAL	Principal arc tangent

LIST OF TABLES (continued)

Table

Page

Table 24 - Standard arithmetic functions

Graphical form		Usage example	
<pre> +-----+ ANY_NUM --- *** --- ANY_NUM ANY_NUM --- . --- . --- ANY_NUM --- +-----+ (***) - Name or Symbol </pre>		<pre> A := ADD(B,C,D) ; or A := B+C+D ; </pre>	
No.	Name	Symbol (note 1)	Description (notes 2 and 8)
Extensible arithmetic functions			
12	ADD	+	OUT := IN1 + IN2 + ... + INn
13	MUL	*	OUT := IN1 * IN2 * ... * INn
Non-extensible arithmetic functions			
14	SUB	-	OUT := IN1 - IN2
15	DIV	/	OUT := IN1 / IN2 (note 5)
16	MOD		OUT := IN1 modulo IN2 (note 3)
17	EXPT	**	Exponentiation: OUT := IN1 ^{IN2} (note 4)
18	MOVE	:=	OUT := IN (note 9)

LIST OF TABLES (continued)

Table

Page

Table	Page
NOTES	
1 These symbols are suitable for use as operators in textual languages, as shown in tables 52 and 55.	
2 The notations IN1, IN2, ..., INn refer to the inputs in top-to-bottom order; OUT refers to the output.	
3 IN1 and IN2 shall be of generic type ANY_INT for this function. The result of evaluating this function shall be the equivalent of executing the following statements in the ST language as defined in 3.3: IF (IN2 = 0) THEN OUT := 0 ; ELSE OUT := IN1 - (IN1/IN2)*IN2 ; END_IF	
4 IN1 shall be of type ANY_REAL, and IN2 of type ANY_NUM for this function. The output shall be of the same type as IN1.	
5 The result of division of integers shall be an integer of the same type with truncation toward zero, for instance, $7/3 = 2$ and $(-7)/3 = -2$.	
6 When the named representation of a function is supported, this shall be indicated by the suffix "n" in the compliance statement. For example, "12n" represents the notation "ADD".	
7 When the symbolic representation of a function is supported, this shall be indicated by the suffix "s" in the compliance statement. For example, "12s" represents the notation "+".	
8 Usage examples and descriptions are given in the ST language defined in Clause 3.3.	
9 The MOVE function has exactly one input (IN) of type any and one output (OUT) of type ANY.	

LIST OF TABLES (continued)

Table

Page

2.5.1.5.3 Bit string functions

The standard graphical representation, function names and descriptions of shift functions for a single bit-string variable shall be as defined in table 25. These functions shall be overloaded on all bit-string types, and can be typed as defined in 2.5.1.4.

The standard graphical representation, function names and symbols, and descriptions of bitwise Boolean functions shall be as defined in table 26. These functions shall be extensible, except for NOT, and overloaded on all bit-string types, and can be typed as defined in 2.5.1.4.

Table 25 - Standard bit shift functions

Graphical form		Usage example
<pre> +-----+ *** ANY_BIT --- IN --- ANY_BIT UINT ----- N +-----+ (***) - Function Name </pre>		<pre> A := SHL(IN:=B, N:=5) ; (ST language - see 3.3) </pre>
No.	Name	Description
1	SHL	OUT := IN left-shifted by N bits, zero-filled on right
2	SHR	OUT := IN right-shifted by N bits, zero-filled on left
3	ROR	OUT := IN right-rotated by N bits, circular
4	ROL	OUT := IN left-rotated by N bits, circular
NOTE - The notation "OUT" refers to the function output.		

2.5.1.5.4 Selection and comparison functions

Selection and comparison functions shall be overloaded on all data types. The standard graphical representations, function names and descriptions of selection functions shall be as shown in table 27.

The standard graphical representation, function names and symbols, and descriptions of comparison functions shall be as defined in table 28. All comparison functions (except NE) shall be extensible.

Comparisons of bit string data shall be made bitwise from the most significant to the least significant bit, and shorter bit strings shall be considered to be filled on the left with zeros when compared to longer bit strings; that is, comparison of bit string variables shall have the same result as comparison of unsigned integer variables.

LIST OF TABLES (continued)

Table

Page

Table 26 - Standard bitwise Boolean functions

Graphical form			Usage examples
<pre> +-----+ ANY_BIT --- *** --- ANY_BIT ANY_BIT --- . --- . --- ANY_BIT --- +-----+ </pre> <p>(***) - Name or symbol</p>			<p>A := AND(B,C,D) ;</p> <p>or</p> <p>A := B & C & D ;</p>
No.	Name	Symbol	Description
5	AND	& (note 1)	OUT := IN1 & IN2 & ... & INn
6	OR	>=1 (note 2)	OUT := IN1 OR IN2 OR ... OR INn
7	XOR	=2k+1 (note 2)	OUT := IN1 XOR IN2 XOR ... XOR INn
8	NOT		OUT := NOT IN1 (Note 4)
<p>NOTES</p> <p>1 This symbol is suitable for use as an operator in textual languages, as shown in tables 52 and 55.</p> <p>2 This symbol is not suitable for use as an operator in textual languages.</p> <p>3 The notations IN1, IN2, ..., INn refer to the inputs in top-to-bottom order; OUT refers to the output.</p> <p>4 Graphic negation of signals of type BOOL can also be accomplished as shown in table 19.</p> <p>5 When the named representation of a function is supported, this shall be indicated by the suffix "n" in the compliance statement. For example, "5n" represents the notation "AND".</p> <p>6 When the symbolic representation of a function is supported, this shall be indicated by the suffix "s" in the compliance statement. For example, "5s" represents the notation "&".</p> <p>7 Usage examples and descriptions are given in the ST language defined in 3.3.</p>			

LIST OF TABLES (continued)

Table

Page

Table 27 - Standard selection functions

No.	Graphical form	Explanation/example
1	<pre> +-----+ SEL G ----ANY IN0 IN1 +-----+ </pre>	<p>Binary selection: OUT := IN0 if G = 0 OUT := IN1 if G = 1</p> <p>Example: A := SEL(G:=0,IN0:=X,IN1:=5) ;</p>
2a	<pre> +-----+ MAX ----ANY +-----+ </pre> <p>(Note 1) --- : --- (Note 1) ---</p>	<p>Extensible maximum function: OUT := MAX (IN1,IN2, ...,INn)</p> <p>Example: A := MAX(B,C,D) ;</p>
2b	<pre> +-----+ MIN ----ANY +-----+ </pre> <p>(Note 1) --- : --- (Note 1) ---</p>	<p>Extensible minimum function: OUT := MIN (IN1,IN2, ...,INn)</p> <p>Example: A := MIN(B,C,D) ;</p>
3	<pre> +-----+ LIMIT ----ANY MN IN MX +-----+ </pre> <p>(Note 1) -- (Note 1) -- (Note 1) --</p>	<p>Limiter: OUT := MIN(MAX(IN,MN),MX)</p> <p>Example: A := LIMIT(IN:=B,MN:=0,MX:=5);</p>
4	<pre> +-----+ MUX ----ANY K +-----+ </pre> <p>ANY_INT --- ANY --- : --- ANY ---</p>	<p>Extensible multiplexer: Select one of "N" inputs depending on input K</p> <p>Example: A := MUX(0, B, C, D); would have the same effect as A := B ;</p>
<p>NOTES</p> <p>1 These inputs can be of type ANY_BIT, ANY_NUM, STRING, ANY_DATE, or TIME. The type conversion rules given in 2.5.1.4 shall be followed for these inputs.</p> <p>2 The notations IN1, IN2, ..., INn refer to the inputs in top-to-bottom order; OUT refers to the output.</p> <p>3 Usage examples and descriptions are given in the ST language defined in 3.3.</p>		

LIST OF TABLES (continued)

Table

Page

Table 28 - Standard comparison functions

Graphical form			Usage examples
<pre> +-----+ (Note 1)-- *** --- BOOL : -- (Note 1)-- +-----+ (***) - Name or Symbol </pre>			<p>A := GT(B,C,D) ;</p> <p>or</p> <p>A := (B>C) & (C>D) ;</p>
No.	Name	Symbol	Description
5	GT	>	Decreasing sequence: OUT := (IN1>IN2) & (IN2>IN3) & ... & (INn-1 > INn)
6	GE	>=	Monotonic sequence: OUT := (IN1>=IN2) & (IN2>=IN3) & ... & (INn-1 >= INn)
7	EQ	=	Equality: OUT := (IN1=IN2) & (IN2=IN3) & ... & (INn-1 = INn)
8	LE	<=	Monotonic sequence: OUT := (IN1<=IN2) & (IN2<=IN3) & ... & (INn-1 <= INn)
9	LT	<	Increasing sequence: OUT := (IN1<IN2) & (IN2<IN3) & ... & (INn-1 < INn)
10	NE	<>	Inequality (non-extensible) OUT := (IN1 <> IN2)
<p>NOTES</p> <p>1 These inputs can be of type ANY_BIT, ANY_NUM, STRING, ANY_DATE, or TIME. The type conversion rules given in 2.5.1.4 shall be followed for these inputs.</p> <p>2 The notations IN1, IN2, ..., INn refer to the inputs in top-to-bottom order; OUT refers to the output.</p> <p>3 All the symbols shown in this table are suitable for use as operators in textual languages, as shown in tables 52 and 55.</p> <p>4 When the named representation of a function is supported, this shall be indicated by the suffix "n" in the compliance statement. For example, "5n" represents the notation "GT".</p> <p>5 When the symbolic representation of a function is supported, this shall be indicated by the suffix "s" in the compliance statement. For example, "5s" represents the notation ">".</p> <p>6 Usage examples and descriptions are given in the ST language defined in 3.3.</p>			

LIST OF TABLES (continued)

Table

Page

2.5.1.5.5 Character string functions

All the functions defined in 2.5.1.5.4 shall be applicable to character strings. For the purposes of comparison of two strings of unequal length, the shorter string shall be considered to be extended on the right to the length of the longer string by characters with the value zero. Comparison shall proceed from left to right, based on the numeric value of the character codes in the ISO/IEC 646 code table. For example, the character string 'Z' shall be greater than the character string 'AZ', and 'AZ' shall be greater than 'ABC'.

The standard graphical representations, function names and descriptions of additional functions of character strings shall be as shown in table 29. For the purpose of these operations, character positions within the string shall be considered to be numbered 1,2,...,L, beginning with the leftmost character position, where L is the length of the string.

Table 29 - Standard character string functions

No.	Graphical form	Explanation/example
1	<pre> +-----+ STRING--- LEN ---INT +-----+</pre>	<p>String length function Example: A := LEN('ASTRING') is equivalent to A := 7;</p>
2	<pre> +-----+ LEFT STRING---- IN ---STRING UINT----- L +-----+</pre>	<p>Leftmost L characters of IN Example: A := LEFT(IN:='ASTR',L:=3); is equivalent to A := 'AST' ;</p>
3	<pre> +-----+ RIGHT STRING---- IN ---STRING UINT----- L +-----+</pre>	<p>Rightmost L characters of IN Example: A := RIGHT(IN:='ASTR',L:=3); is equivalent to A := 'STR' ;</p>
4	<pre> +-----+ MID STRING---- IN ---STRING UINT----- L UINT----- P +-----+</pre>	<p>L characters of IN, beginning at the P-th Example: A := MID(IN:='ASTR',L:=2,P:=2); is equivalent to A := 'ST' ;</p>
5	<pre> +-----+ CONCAT STRING--- ---STRING : --- STRING--- +-----+</pre>	<p>Extensible concatenation Example: A := CONCAT('AB','CD','E') ; is equivalent to A := 'ABCDE' ;</p>

LIST OF TABLES (continued)

Table		Page
6	<pre> +-----+ INSERT STRING--- IN1 --STRING STRING--- IN2 UINT----- P +-----+</pre>	<p>Insert IN2 into IN1 after the P-th character position</p> <p>Example: A:=INSERT(IN1:='ABC',IN2:='XY',P=2); is equivalent to A := 'ABXYC' ;</p>

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 29 - Standard character string functions - continued

No.	Graphical form	Explanation/example
7	<pre> +-----+ DELETE STRING--- IN --STRING UINT----- L UINT----- P +-----+ </pre>	Delete L characters of IN, beginning at the P-th character position Example: A := DELETE(IN:='ABXYC',L:=2, P:=3) ; is equivalent to A := 'ABC' ;
8	<pre> +-----+ REPLACE STRING--- IN1 --STRING STRING--- IN2 UINT----- L UINT----- P +-----+ </pre>	Replace L characters of IN1 by IN2, starting at the P-th character position Example: A := REPLACE(IN1:='ABCDE',IN2:='X',L:=2, P:=3) ; is equivalent to A := 'ABXE' ;
9	<pre> +-----+ FIND STRING--- IN1 ---INT STRING--- IN2 +-----+ </pre>	Find the character position of the beginning of the first occurrence of IN2 in IN1. If no occurrence of IN2 is found, then OUT := 0. Example: A := FIND(IN1:='ABCBC',IN2:='BC') ; is equivalent to A := 2 ;
NOTE - The examples in this table are given in the Structured Text (ST) language defined in 3.3.		

2.5.1.5.6 Functions of time data types

In addition to the comparison and selection functions defined in 2.5.1.5.4, the combinations of input and output time data types shown in table 30 shall be allowed with the associated functions.

2.5.1.5.7 Functions of enumerated data types

The selection and comparison functions listed in table 31 can be applied to inputs which are of an enumerated data type as defined in 2.3.3.1.

LIST OF TABLES (continued)

Table

Page

Table 30 - Functions of time data types

Numeric and concatenation functions					
No.	Name	Symbol	IN1	IN2	OUT
1	ADD	+	TIME	TIME	TIME
2			TIME_OF_DAY	TIME	TIME_OF_DAY
3			DATE_AND_TIME	TIME	DATE_AND_TIME
4	SUB	-	TIME	TIME	TIME
5			DATE	DATE	TIME
6			TIME_OF_DAY	TIME	TIME_OF_DAY
7			TIME_OF_DAY	TIME_OF_DAY	TIME
8			DATE_AND_TIME	TIME	DATE_AND_TIME
9			DATE_AND_TIME	DATE_AND_TIME	TIME
10	MUL	*	TIME	ANY_NUM	TIME
11	DIV	/	TIME	ANY_NUM	TIME
12	CONCAT		DATE	TIME_OF_DAY	DATE_AND_TIME
Type conversion functions					
13	DATE_AND_TIME_TO_TIME_OF_DAY				
14	DATE_AND_TIME_TO_DATE				
NOTES					
<p>1 The type conversion functions shall have the effect of "extracting" the appropriate data, e.g., the ST language statements</p> <p style="padding-left: 40px;">X := DT#1986-04-28-08:40:00 ; Y := DATE_AND_TIME_TO_TIME_OF_DAY(X) ; W := DATE_AND_TIME_TO_DATE(X)</p> <p>shall have the same result as the statements</p> <p style="padding-left: 40px;">X := DT#1986-04-28-08:40:00 ; W := DATE#1986-04-28 ; Y := TIME_OF_DAY#08:40:00</p>					
<p>2 The provisions of NOTES 2-5 of table 28 apply to this table.</p>					

Table 31 - Functions of enumerated data types

No.	Name	Symbol	Feature No. in Tables 27 and 28
1	SEL		1
2	MUX		4
3	EQ	=	7
4	NE	<>	10

LIST OF TABLES (continued)

Table	Page
NOTE - The provisions of NOTES 2-5 of table 28 apply to this table.	

2.5.2 Function blocks

For the purposes of programmable controller programming languages, a *function block* is a program organization unit which, when executed, yields one or more values. Multiple, named *instances* (copies) of a function block can be created. Each instance shall have an associated identifier (the *instance name*), and a data structure containing its output and internal variables, and, depending on the implementation, values of or references to its input parameters. All the values of the output variables and the necessary internal variables of this data structure shall persist from one execution of the function block to the next; therefore, invocation of a function block with the same arguments (input parameters) need not always yield the same output values.

Only the input and output parameters shall be accessible outside of an instance of a function block, i.e., the function block's internal variables shall be hidden from the user of the function block.

Execution of the operations of a function block shall be invoked as defined in clause 3 for textual languages, according to the rules of network evaluation given in clause 4 for graphic languages, or under the control of sequential function chart (SFC) elements as defined in 2.6.

Any function block type which has already been declared can be used in the declaration of another function block type or program type as shown in figure 3.

The scope of an instance of a function block shall be local to the program organization unit in which it is instantiated, unless it is declared to be global in a VAR_GLOBAL block as defined in 2.7.1.

As illustrated in 2.5.2.2, the instance name of a function block instance can be used as the input to a function or function block if declared as an input variable in a VAR_INPUT declaration, or as an input/output variable of a function block in a VAR_IN_OUT declaration, as defined in 2.4.3.

2.5.2.1 Representation

As illustrated in figure 9, an instance of a function block can be created *textually*, by declaring a data element using the declared function block type in a VAR...END_VAR construct, identically to the use of a structured data type, as defined in 2.4.3.

As further illustrated in figure 9, an instance of a function block can be created *graphically*, by using a graphic representation of the function block, with the function block type name inside the block, and the instance name above the block, following the rules for representation of functions given in 2.5.1.1 with the following additional conditions:

- 1) The size and orientation of the block may vary depending on the number of inputs, outputs, and other information to be displayed.
- 2) Formal input and output parameter names shall be shown at the inside left and right sides of the block, respectively.

As shown in figure 9, input and output variables of an instance of a function block can be represented as elements of structured data types as defined in 2.3.6.1.

If either of the two graphical negation features defined in table 19 is supported for function blocks, it shall also be supported for functions as defined in 2.5.1, and vice versa.

LIST OF TABLES (continued)

Table	Page
Function block instances can be declared to be retentive, as shown in feature 3 of table 33.	

LIST OF TABLES (continued)

Table

Page

Graphical (FBD language)	Textual (ST language)
<pre> FF75 +-----+ SR %IX1--- S1 Q1 ---%QX3 %IX2--- R +-----+ </pre>	<pre> VAR FF75: SR; END_VAR (* Declaration *) FF75(S1:=%IX1, R:=%IX2); (* Invocation *) %QX3 := FF75.Q1 ; (* Assign Output *) </pre>

Figure 9 - Function block instantiation example

Assignment of a value to an output variable of a function block is not allowed except from within the function block. The assignment of a value to the input of a function block is permitted only as part of the invocation of the function block. Allowable usages of function block inputs and outputs are summarized in table 32, using the function block FF75 of type SR shown in figure 9. The examples are shown in the ST language.

Table 32 - Examples of function block I/O parameter usage

Usage	Inside function block	Outside function block
Input read	IF S1 THEN ...	Not allowed (note 1 and 2)
Input write	Not allowed (notes 1 and 3)	FF75(S1:=%IX1,R:=%IX2);
Output read	Q1 := Q1 AND NOT R;	%QX3 := FF75.Q1;
Output write	Q1 := 1;	Not Allowed (note 1)
NOTES		
<p>1 Those usages listed as "not allowed" in this table could lead to implementation-dependent, unpredictable side effects.</p> <p>2 Reading of an input of a function block may be performed by the "communication function", "operator interface function", or the "programming, testing, and monitoring functions" defined in Part 1 of this standard.</p> <p>3 As illustrated in 2.5.2.2, modification within the function block of a variable declared in a VAR_IN_OUT block is permitted.</p>		

LIST OF TABLES (continued)

Table	Page
-------	------

2.5.2.2 Declaration

As illustrated in figure 10, a function block shall be declared textually or graphically in the same manner as defined for functions in 2.5.1.3, with the differences described below and summarized in table 33:

- 1) The delimiting keywords for declaration of function blocks shall be FUNCTION_BLOCK... END_FUNCTION_BLOCK.
- 2) A function block can have more than one output parameter, declared textually with the VAR_OUTPUT...END_VAR construct defined in 2.4.3, or graphically as illustrated in figure 10.
- 3) The RETAIN qualifier defined in 2.4.3 can be used for internal and output variables of a function block, as shown in features 1, 2, and 3 in table 33.
- 4) The values of variables which are passed to the function block via a VAR_IN_OUT or VAR_EXTERNAL construct can be modified from within the function block, as shown in feature 4 of table 33.
- 5) The output values of a function block instance whose name is passed into the function block via a VAR_INPUT, VAR_IN_OUT, or VAR_EXTERNAL construct can be accessed, but not modified, from within the function block, as shown in features 5, 6, and 7 of table 33.
- 6) A function block whose instance name is passed into the function block via a VAR_IN_OUT or VAR_EXTERNAL construction can be invoked from inside the function block, as shown in features 6 and 7 of table 33.
- 7) In textual declarations, the R_EDGE and F_EDGE qualifiers can be used to indicate an edge-detection function on Boolean inputs. This shall cause the implicit declaration of a function block of type R_TRIG or F_TRIG, respectively, as defined in 2.5.2.3.2, to perform the required edge detection. For an example of this construction, see features 8a and 8b of table 33 and the accompanying NOTE.
- 8) The construction illustrated in table 33, features 9a and 9b shall be used in graphical declarations for rising and falling edge detection. When the ISO/IEC 646 character set is used, the "greater than" (>) or "less than" (<) character shall be in line with the edge of the function block. When graphic or semigraphic representations are employed, the notation of IEC 617, Part 12 for dynamic inputs shall be used.
- 9) The variable initialization constructs defined in 2.4.3.2 can be used for the declaration of default values of function block inputs and initial values of their internal and output variables.
- 10) If the generic data types given in table 11 are used in the declaration of standard function block inputs and outputs, then the rules for inferring the actual types of the outputs of such function block types shall be part of the function block type definition.

As illustrated in figure 12, only variables or function block instance names can be passed into a function block via the VAR_IN_OUT construct, i.e., function or function block outputs cannot be passed via this construction. This is to prevent the inadvertent modifications of such outputs. However, "cascading" of VAR_IN_OUT constructions is permitted, as illustrated in figure 12c.

LIST OF TABLES (continued)

Table

Page

a)	<pre> FUNCTION_BLOCK DEBOUNCE (** External Interface **) VAR_INPUT IN : BOOL ; (* Default = 0 *) DB_TIME : TIME := t#10ms ; (* Default = t#10ms *) END_VAR VAR_OUTPUT OUT : BOOL ; (* Default = 0 *) ET_OFF : TIME ; (* Default = t#0s *) END_VAR VAR DB_ON : TON ; (** Internal Variables **) DB_OFF : TON ; (** and FB Instances **) DB_FF : SR ; END_VAR (** Function Block Body **) DB_ON(IN := IN, PT := DB_TIME) ; DB_OFF(IN := NOT IN, PT:=DB_TIME) ; DB_FF(S1 :=DB_ON.Q, R := DB_OFF.Q) ; OUT := DB_FF.Q ; ET_OFF := DB_OFF.ET ; END_FUNCTION_BLOCK </pre>
b)	<pre> FUNCTION_BLOCK (** External Interface **) +-----+ DEBOUNCE BOOL--- IN OUT ---BOOL TIME--- DB_TIME ET_OFF ---TIME +-----+ (** Function Block Body **) +-----+ DB_ON DB_FF +-----+ TON SR IN Q ----- S1 Q -----OUT PT ET R +-----+ DB_OFF +-----+ TON IN Q -----+ PT ET -----ET_OFF +-----+ END_FUNCTION_BLOCK </pre>

Figure 10 - Examples of function block declarations

a) Textual declaration in ST language (see 3.3)

b) Graphical declaration in FBD language (see 4.3)

LIST OF TABLES (continued)

Table

Page

Table 33 - Function block declaration features

No.	Description	Example
1	RETAIN qualifier on internal variables	VAR RETAIN X : REAL ; END_VAR
2	RETAIN qualifier on output variables	VAR_OUTPUT RETAIN X : REAL ; END_VAR
3	RETAIN qualifier on internal function blocks	VAR RETAIN TMR1: TON ; END_VAR
4a	Input/output declaration (textual)	VAR_IN X: INT; END_VAR VAR_IN_OUT A: INT ; END_VAR A := A+X ;
4b	Input/output declaration (graphical)	See figure 12
5a	Function block instance name as input (textual)	VAR_INPUT I_TMR: TON ; END_VAR EXPIRED := I_TMR.Q; (* Note 1 *)
5b	Function block instance name as input (graphical)	See figure 11a
6a	Function block instance name as input/output (textual)	VAR_IN_OUT IO_TMR: TOF ; END_VAR IO_TMR(IN:=A_VAR, PT:=T#10S); EXPIRED := IO_TMR.Q; (* Note 1 *)
6b	Function block instance name as input/output (graphical)	See figure 11b
7a	Function block instance name as external variable (textual)	VAR_EXTERNAL EX_TMR : TOF ;END_VAR EX_TMR(IN:=A_VAR, PT:=T#10S); EXPIRED := EX_TMR.Q; (* Note 1 *)
7b	Function block instance name as external variable (graphical)	See figure 11c
8a 8b	Textual declaration of: rising edge inputs falling edge inputs	FUNCTION_BLOCK AND_EDGE (* Note 2 *) VAR_INPUT X : BOOL R_EDGE; Y : BOOL F_EDGE; END_VAR VAR_OUTPUT Z : BOOL ; END_VAR Z := X AND Y ; (* ST language example *) END_FUNCTION_BLOCK (*- see 3.3 *)
9a 9b	Graphical declaration of: rising edge inputs falling edge inputs	FUNCTION_BLOCK (* Note 2 *) +-----+ (* External interface *) AND_EDGE BOOL--->X Z ---BOOL +-----+ +----+ (* Function block body *) X--- & ---Z (* FBD language example *) Y--- (* - see 4.3 *) +----+ END_FUNCTION_BLOCK

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 33 - Function block declaration features - continued

NOTES

1 It is assumed in these examples that the variables EXPIRED and A_VAR have been declared of type BOOL.

2 The declaration of function block AND_EDGE in the above examples is equivalent to:

```
FUNCTION_BLOCK AND_EDGE
  VAR INPUT X : BOOL; Y : BOOL; END_VAR
  VAR X_TRIG : R_TRIG ; Y_TRIG : F_TRIG ; END_VAR
  X_TRIG(CLK := X);
  Y_TRIG(CLK := Y);
  Z := X_TRIG.Q AND Y_TRIG.Q;
END_FUNCTION_BLOCK
```

See 2.5.2.3.2 for the definition of the edge detection function blocks R_TRIG and F_TRIG.

```
FUNCTION_BLOCK
+-----+ (* External interface *)
|   INSIDE_A   |
TON---| I_TMR  EXPIRED |---BOOL
+-----+

          I_TMR          (* Function Block body *)
+-----+
|   TON   |
| IN  Q |---EXPIRED
| PT ET |
+-----+
END_FUNCTION_BLOCK

FUNCTION_BLOCK
+-----+ (* External interface *)
|   EXAMPLE_A   |
BOOL---| GO      DONE |---BOOL
+-----+

          E_TMR          (* Function Block body *)
+-----+
|   TON   |
GO---| IN  Q |
t#100ms---| PT ET |
+-----+

          I_BLK
+-----+
|   INSIDE_A   |
E_TMR---| I_TMR  EXPIRED |---DONE
+-----+
```

**Figure 11a - Graphical use of a function block name as an input variable
(table 33, feature 5b)**

LIST OF TABLES (continued)

Table

Page

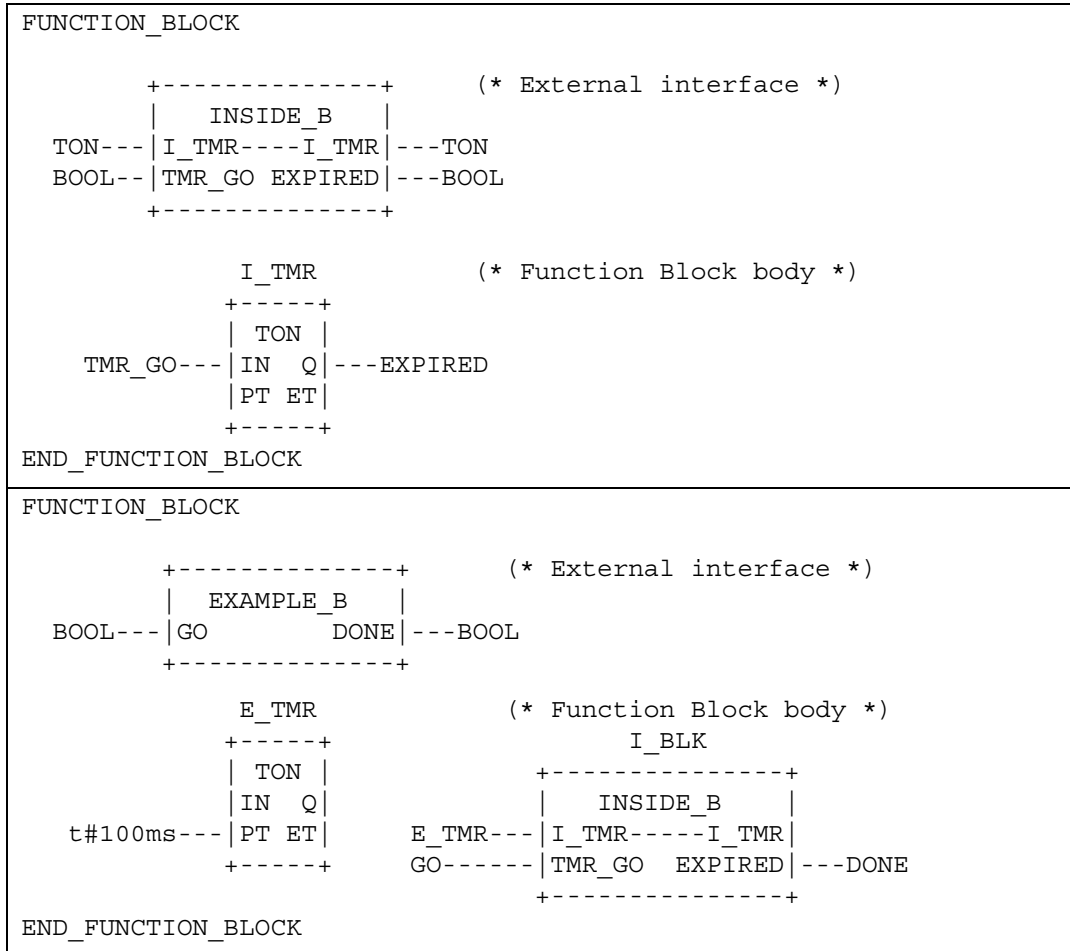


Figure 11b - Graphical use of a function block name as an input/output variable (table 33, feature 6b)

LIST OF TABLES (continued)

Table

Page

<pre> FUNCTION_BLOCK +-----+ (* External interface *) INSIDE_C TMR_GO EXPIRED ---BOOL +-----+ VAR_EXTERNAL X_TMR : TON ; END_VAR X_TMR (* Function Block body *) +-----+ TON TMR_GO--- IN Q ---EXPIRED PT ET +-----+ END_FUNCTION_BLOCK </pre>
<pre> PROGRAM +-----+ (* External interface *) EXAMPLE_C GO DONE ---BOOL +-----+ VAR_GLOBAL X_TMR : TON ; END_VAR I_BLK (* Program body *) +-----+ INSIDE_C TMR_GO EXPIRED ---DONE +-----+ END_PROGRAM </pre>

NOTE - PROGRAM declaration is defined in 2.5.3.

**Figure 11c - Graphical use of a function block name as an external variable
(table 33, feature 7b)**

LIST OF TABLES (continued)

Table

Page

<p>a)</p>	<pre> +-----+ ACCUM INT--- A-----A ---INT INT--- X +-----+ +----+ A--- + ---A X--- +----+ </pre>	<pre> FUNCTION_BLOCK ACCUM VAR_IN_OUT A : INT ; END_VAR VAR_INPUT X : INT ; END_VAR A := A+X ; END_FUNCTION_BLOCK </pre>
<p>b)</p>	<pre> ACC1 +-----+ ACCUM ACC----- A-----A ---ACC +----+ X1--- * ---X X2--- +-----+ +----+ </pre>	<p>Note 1</p>
<p>c)</p>	<pre> ACC1 ACC2 +-----+ +-----+ ACCUM ACCUM ACC----- A-----A ----- A-----A ---ACC +----+ +----+ X1--- * ---X X3--- * ---X X2--- +-----+ X4--- +-----+ +----+ +----+ </pre>	<p>Note 2</p>
<p>d)</p>	<pre> ACC1 +----+ +-----+ X1--- * ACCUM X2--- --- A-----A ---ACC +----+ X3----- X +-----+ </pre>	<p>Note 3</p>
<p>NOTES</p> <p>1 A declaration such as VAR ACC : INT ; X1 : INT ; X2 : INT ; END_VAR is assumed.</p> <p>2 Declarations as in b) are assumed for ACC, X1, X2, X3, and X4.</p> <p>3 ILLEGAL USAGE: Input/output A is not a variable or function block name (see preceding text).</p>		

LIST OF TABLES (continued)

Table

Page

- Figure 12 - Examples of use of input/output variables**
- a) Graphical and textual declarations
 - b), c) Legal usage
 - d) Illegal usage

LIST OF TABLES (continued)

Table

Page

2.5.2.3 Standard function blocks

Definitions of function blocks common to all programmable controller programming languages are given in this subclause.

Where graphical declarations of standard function blocks are shown in this subclause, equivalent textual declarations, as specified in 2.5.2.2, can also be written, as for example in table 35.

2.5.2.3.1 Bistable elements

The representation and function block bodies for standard bistable elements are shown in table 34. The notation for these elements is chosen to be as consistent as possible with symbols 12-09-01 and 12-09-02 of IEC 617-12.

Table 34 - Standard bistable function blocks

No.	Graphical form	Function block body
1	<p style="text-align: center;">+-----+</p> <pre> SR BOOL--- S1 Q1 ---BOOL R +-----+</pre>	<pre> +-----+ S1----- >=1 ---Q1 +-----+ & R-----O & --- Q1----- +-----+ +-----+</pre>
2	<p style="text-align: center;">+-----+</p> <pre> RS BOOL--- S Q1 ---BOOL R1 +-----+</pre>	<pre> +-----+ R1-----O & ---Q1 +-----+ >=1 S----- Q1----- +-----+ +-----+</pre>
<p>NOTES</p> <p>1 The function block body is specified in the Function Block Diagram (FBD) language defined in 4.3.</p> <p>2 The initial state of the output variable Q1 shall be the normal default value of zero for Boolean variables.</p>		

LIST OF TABLES (continued)

Table

Page

2.5.2.3.2 Edge detection

The graphic representation of standard rising- and falling-edge detecting function blocks shall be as shown in table 35. The behaviors of these blocks shall be equivalent to the definitions given in this table. This behavior corresponds to the following rules:

- 1) The "Q" output of an R_TRIG function block shall stand at the Boolean "1" value from one execution of the function block to the next, following the "0" to "1" transition of the "CLK" input, and shall return to "0" at the next execution.
- 2) The "Q" output of an F_TRIG function block shall stand at the Boolean "1" value from one execution of the function block to the next, following the "1" to "0" transition of the "CLK" input, and shall return to "0" at the next execution.

Table 35 - Standard edge detection function blocks

No.	Graphical form	Definition (ST language - see 3.3)
1	Rising edge detector <pre> +-----+ R_TRIG CLK Q ---BOOL +-----+</pre>	<pre> FUNCTION_BLOCK R_TRIG VAR_INPUT CLK: BOOL; END_VAR VAR_OUTPUT Q: BOOL; END_VAR VAR RETAIN M: BOOL; END_VAR Q := CLK AND NOT M; M := CLK; END_FUNCTION_BLOCK</pre>
	Falling edge detector <pre> +-----+ F_TRIG CLK Q ---BOOL +-----+</pre>	<pre> FUNCTION_BLOCK F_TRIG VAR_INPUT CLK: BOOL; END_VAR VAR_OUTPUT Q: BOOL; END_VAR VAR RETAIN M: BOOL; END_VAR Q := NOT CLK AND NOT M; M := NOT CLK; END_FUNCTION_BLOCK</pre>

LIST OF TABLES (continued)

Table

Page

2.5.2.3.3 Counters

The graphic representations of standard counter function blocks, with the types of the associated inputs and outputs, shall be as shown in table 36. The operation of these function blocks shall be as specified in the corresponding function block bodies.

Table 36 - Standard counter function blocks

No.	Graphical form	Function block body (ST language - see 3.3)
1	<pre> +-----+ CTU ----- CU Q ---BOOL ----- R ----- PV CV ---INT ----- +-----+ </pre>	<pre> IF R THEN CV := 0 ; ELSIF CU AND (CV < PVmax) THEN CV := CV+1; END_IF ; Q := (CV >= PV) ; </pre>
2	<pre> +-----+ CTD ----- CD Q ---BOOL ----- LD ----- PV CV ---INT ----- +-----+ </pre>	<pre> IF LD THEN CV := PV ; ELSIF CD AND (CV > PVmin) THEN CV := CV-1; END_IF ; Q := (CV <= 0) ; </pre>
3	<pre> +-----+ CTUD ----- CU QU ---BOOL ----- CD QD ---BOOL ----- R ----- LD ----- PV CV ---INT ----- +-----+ </pre>	<pre> IF R THEN CV := 0 ; ELSIF LD THEN CV := PV ; ELSE IF NOT (CU AND CD) THEN IF CU AND (CV < PVmax) THEN CV := CV+1; ELSIF CD AND (CV > PVmin) THEN CV := CV-1; END_IF ; END_IF ; END_IF ; QU := (CV >= PV) ; QD := (CV <= 0) ; </pre>
<p>NOTE - The numerical values of the limit variables PVmin and PVmax are implementation-dependent.</p>		

LIST OF TABLES (continued)

Table

Page

2.5.2.3.4 Timers

The graphic form for standard timer function blocks shall be as shown in table 37. The operation of these function blocks shall be as defined in the timing diagrams given in table 38.

The RTC function block shown as feature No. 4 in table 37 shall set the output CDT to the input value PDT at the next evaluation of the function block following a transition from 0 to 1 of the IN input. The CDT output of the RTC function block shall be undefined when the value of IN is 0.

Table 37 - Standard timer function blocks


No.	Description	Graphical form
1 2a 2b 3a 3b	<p>*** is: TP (Pulse)</p> <p>TON (On-delay)</p> <p>T---0 (On-delay)</p> <p>TOF (Off-delay)</p> <p>0---T (Off-delay)</p>	<pre> +-----+ *** IN Q TIME PT ET +-----+ </pre>
4	<p>Real-time clock</p> <p>PDT = Preset date and time, loaded on rising edge of EN</p> <p>CDT = Current date and time, valid when EN=1</p> <p>Q = copy of EN</p>	<pre> +-----+ RTC IN Q DT PDT CDT +-----+ </pre>
<p>NOTES</p> <p>1 In textual languages, features 2b and 3b shall not be used.</p> <p>2 The effect of a change in the value of the PT input during the timing operation is an <i>implementation-dependent parameter</i>."</p>		

Table 38 - Standard timer function blocks - timing diagrams

LIST OF TABLES (continued)

Table

Page

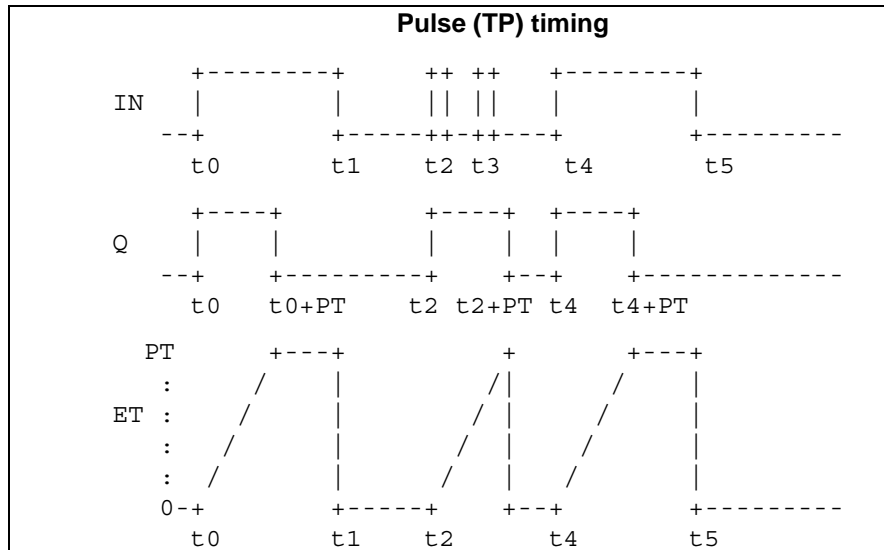


(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 38 - Standard timer Function Blocks - timing diagrams - continued

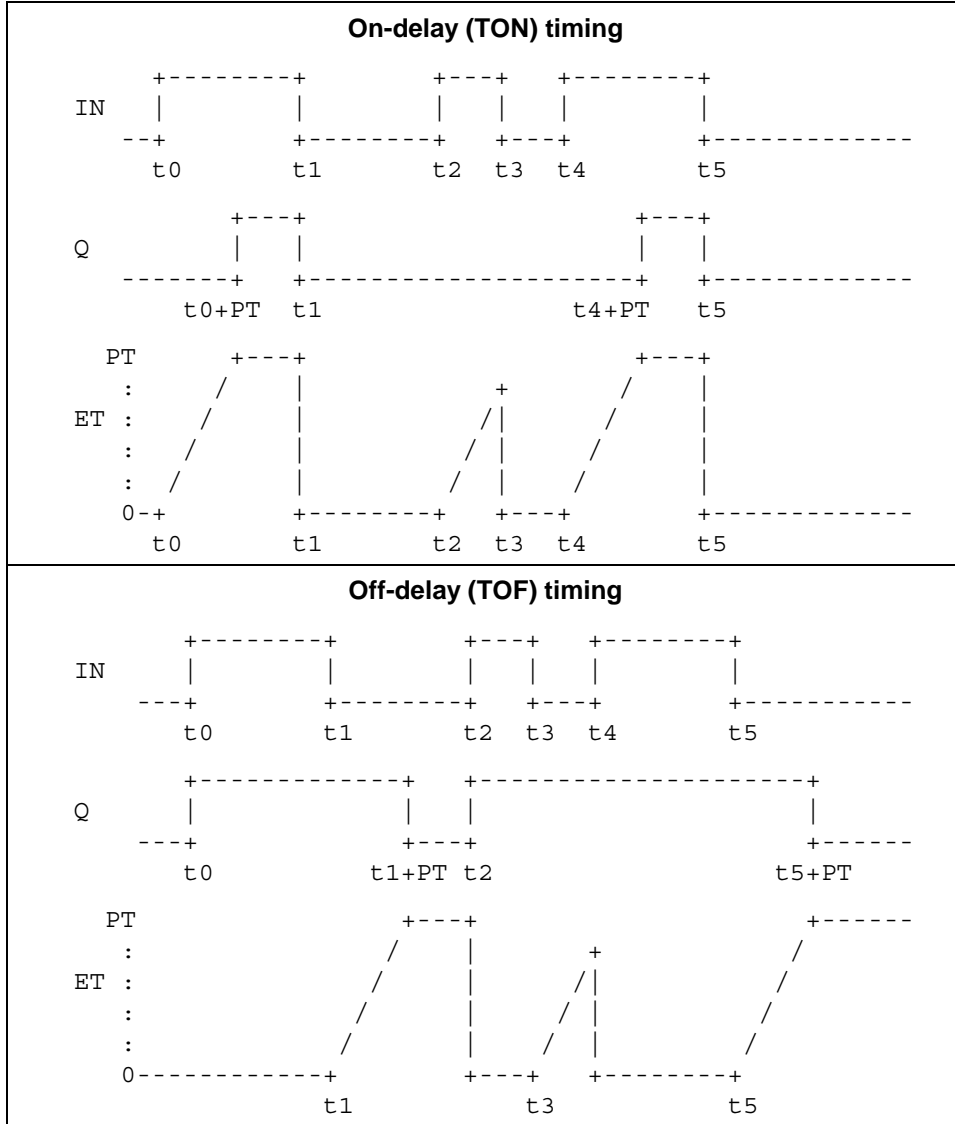

LIST OF TABLES (continued)

Table Page

2.5.2.3.5 Communication function blocks

Standard communication function blocks for programmable controllers are defined in IEC 1131-5. These function blocks provide programmable communications functionality such as device verification, polled data acquisition, programmed data acquisition, parametric control, interlocked control, programmed alarm reporting, and connection management and protection.

2.5.3 Programs

A *program* is defined in IEC 1131-1 as a "logical assembly of all the programming language elements and constructs necessary for the intended signal processing required for the control of a machine or process by a programmable controller system."

Subclause 1.4.1 of this part describes the place of programs in the overall software model of a programmable controller; subclause 1.4.2 describes the means available for inter- and intra-program communication; and subclause 1.4.3 describes the overall process of program development.

The declaration and usage of *programs* is identical to that of *function blocks* as defined in 2.5.2.1 and 2.5.2.2, with the additional features shown in table 39 and the following differences:

- 1) The delimiting keywords for program declarations shall be PROGRAM...END_PROGRAM.
- 2) A program can contain a VAR_ACCESS...END_VAR construction, which provides a means of specifying named variables which can be accessed by some of the communication services specified in IEC 1131-5. An *access path* associates each such variable with an input, output or internal variable of the program. The format and usage of this declaration shall be as described in 2.7.1 and in IEC 1131-5.
- 3) *Programs* can only be instantiated within *resources*, as defined in 2.7.1, while *function blocks* can only be instantiated within *programs* or other *function blocks*.

The declaration and use of programs are illustrated in figure 19, and in examples F.7 and F.8 of annex F.

Table 39 - Program declaration features

No.	DESCRIPTION
1 to 9b	Same as features 1 to 9b, respectively, of table 33
10	Formal input and output parameters
11 to 14	Same as features 1 to 4, respectively, of table 17
15 to 18	Same as features 1 to 4, respectively, of table 18
19	Use of directly represented variables (subclause 2.4.1.1)
20	VAR_GLOBAL...END_VAR declaration within a PROGRAM (see 2.4.3 and 2.7.1)
21	VAR_ACCESS...END_VAR declaration within a PROGRAM

LIST OF TABLES (continued)

Table	Page
-------	------

2.6 Sequential Function Chart (SFC) elements**2.6.1 General**

This subclause defines *sequential function chart* (SFC) elements for use in structuring the internal organization of a programmable controller program organization unit, written in one of the languages defined in this standard, for the purpose of performing *sequential control* functions. The definitions in this subclause are derived from IEC 848, with the changes necessary to convert the representations from a *documentation standard* to a set of *execution control elements* for a programmable controller program organization unit.

The SFC elements provide a means of partitioning a programmable controller program organization unit into a set of *steps* and *transitions* interconnected by *directed links*. Associated with each step is a set of *actions*, and with each transition is associated a *transition condition*.

Since SFC elements require storage of state information, the only program organization units which can be structured using these elements are *function blocks* and *programs*.

If any part of a program organization unit is partitioned into SFC elements, the entire program organization unit shall be so partitioned. If no SFC partitioning is given for a program organization unit, the entire program organization unit shall be considered to be a single *action* which executes under the control of the invoking entity.

2.6.2 Steps

A *step* represents a situation in which the behavior of a program organization unit with respect to its inputs and outputs follows a set of rules defined by the associated *actions* of the step. A step is either *active* or *inactive*. At any given moment, the state of the program organization unit is defined by the set of active steps and the values of its internal and output variables.

As shown in table 40, a step shall be represented graphically by a block containing a *step name* in the form of an identifier as defined in 2.1.2, or textually by a STEP...END_STEP construction. The directed link(s) into the step can be represented graphically by a vertical line attached to the top of the step. The directed link(s) out of the step can be represented by a vertical line attached to the bottom of the step. Alternatively, the directed links can be represented textually by the TRANSITION...END_TRANSITION construction defined in 2.6.3.

The *step flag* (active or inactive state of a step) can be represented by the logic value of a Boolean structure element ****.X*, where ***** is the step name, as shown in table 40. This Boolean variable has the value "1" when the corresponding step is active, and "0" when it is inactive. The state of this variable is available for graphical connection at the right side of the step as shown in table 40.

Similarly, the elapsed time, ****.T*, since initiation of a step can be represented by a structure element of type TIME, as shown in table 40. When a step is deactivated, the value of the step elapsed time shall remain at the value it had when the step was deactivated. When a step is activated, the value of the step elapsed time shall be reset to t#0s.

The *scope* of step names, step flags, and step times shall be *local* to the program organization unit in which the steps appear.

The initial state of the program organization unit is represented by the initial values of its internal and output variables, and by its set of *initial steps*, i.e., the steps which are initially active. Each SFC *network*, or its textual equivalent, shall have exactly one initial step.

LIST OF TABLES (continued)

Table	Page
-------	------

An initial step can be drawn graphically with double lines for the borders, and with the ISO 646 character set shall be drawn as shown in table 40.

For system initialization as defined in 2.4.2, the default initial elapsed time for steps is $t\#0s$, and the default initial state is Boolean 0 for ordinary steps and Boolean 1 for initial steps. However, when an instance of a function block or a program is declared to be *retentive* (for instance, as in feature 3 of table 33), the states and (if supported) elapsed times of all steps contained in the program or function block shall be treated as retentive for system initialization as defined in 2.4.2.

LIST OF TABLES (continued)

Table

Page

Table 40 - Step features

No.	REPRESENTATION	DESCRIPTION
1	<pre> +-----+ *** +-----+ </pre>	Step - Graphical form with directed links "****" = step name
	<pre> +=====+ *** +=====+ </pre>	Initial step - Graphical form with directed links "****" = Name of initial step (note 2)
2	<pre> STEP *** : (* Step body *) END_STEP </pre>	Step - Textual form without directed links (see 2.6.3) "****" = Step name
	<pre> INITIAL_STEP *** : (* Step body *) END_STEP </pre>	Initial step - Textual form without directed links (see 2.6.3) "****" = Name of initial step
3a	<pre> ***.X </pre>	Step flag - General form "****" = Step name ***.X = Boolean 1 when *** is active, Boolean 0 otherwise
3b	<pre> +-----+ *** ----- +-----+ </pre>	Step flag - Direct connection of Boolean variable ***.X to right side of step "****"
4	<pre> ***.T </pre>	Step elapsed time - General form "****" = Step name ***.T = A variable of type TIME (See 2.6.2)
NOTES 1. When feature 3a, 3b, or 4 is supported, it shall be an <i>error</i> if the user program attempts to modify the associated variable. For example, if S4 is a step name, then the following statements would be <i>errors</i> in the ST language defined in 3.3: <pre> S4.X := 1 ; (* ERROR *) S4.T := t#100ms ; (* ERROR *) </pre> 2. The upper directed link is not required if the initial step has no predecessors.		

LIST OF TABLES (continued)

Table

Page

2.6.3 Transitions

A *transition* represents the condition whereby control passes from one or more steps preceding the transition to one or more successor steps along the corresponding directed link. The transition shall be represented by a horizontal line across the vertical directed link.

The direction of evolution following the directed links shall be from the bottom of the predecessor step(s) to the top of the successor step(s).

Each transition shall have an associated *transition condition* which is the result of the evaluation of a single Boolean expression. A transition condition which is always true shall be represented by the symbol "1" or the keyword TRUE.

A transition condition can be associated with a transition by one of the following means, as shown in table 41:

- 1) By placing the appropriate Boolean expression in the ST language defined in 3.3 to the right of the vertical directed link.
- 2) By a ladder diagram network in the LD language defined in 4.2, whose output intersects the vertical directed link instead of a right rail.
- 3) By a network in the FBD language defined in 4.3, whose output intersects the vertical directed link.
- 4) By a LD or FBD network whose output intersects the vertical directed link via a *connector* as defined in 4.1.1.
- 5) By a TRANSITION...END_TRANSITION construct using the ST language. This shall consist of:
 - The keywords TRANSITION FROM followed by the step name of the predecessor step (or, if there is more than one predecessor, by a parenthesized list of predecessor steps);
 - The keyword TO followed by the step name of the successor step (or, if there is more than one successor, by a parenthesized list of successor steps);
 - The assignment operator (:=), followed by a Boolean expression in the ST language, specifying the transition condition;
 - The terminating keyword END_TRANSITION.
- 6) By a TRANSITION...END_TRANSITION construct using the IL language defined in 3.2. This shall consist of:
 - The keywords TRANSITION FROM followed by the step name of the predecessor step (or, if there is more than one predecessor, by a parenthesized list of predecessor steps), followed by a colon (':');
 - The keyword TO followed by the step name of the successor step (or, if there is more than one successor, by a parenthesized list of successor steps);
 - Beginning on a separate line, a list of instructions in the IL language, the result of whose evaluation determines the transition condition;
 - The terminating keyword END_TRANSITION on a separate line.

LIST OF TABLES (continued)

Table

Page

- 7) By the use of a *transition name* in the form of an identifier to the right of the directed link. This identifier shall refer to a TRANSITION...END_TRANSITION construction defining one of the following entities, whose evaluation shall result in the assignment of a Boolean value to the variable denoted by the transition name:
- A network in the LD or FBD language;
 - A list of instructions in the IL language;
 - An assignment of a Boolean expression in the ST language.

The *scope* of a transition name shall be *local* to the program organization unit in which the transition is located.

It shall be an *error* in the sense of 1.5.1 if any "side effect" (for instance, the assignment of a value to a variable other than the transition name) occurs during the evaluation of a transition condition.

Table 41 - Transitions and transition conditions

No.	EXAMPLE	DESCRIPTION
1	<pre> +-----+ STEP7 +-----+ + %IX2.4 & %IX2.3 +-----+ STEP8 +-----+ </pre>	<p>Predecessor step</p> <p>Transition condition using ST language (see 3.3)</p> <p>Successor step</p>
2	<pre> +-----+ STEP7 +-----+ %IX2.4 %IX2.3 +---+ +---+ +---+ +-----+ STEP8 +-----+ </pre>	<p>Predecessor step</p> <p>Transition condition using LD language (see 4.2)</p> <p>Successor step</p>

LIST OF TABLES (continued)

Table

Page

3	<pre> graph TD S7[STEP7] -- "%IX2.4 & %IX2.3" --> S8[STEP8] </pre>	<p>Predecessor step</p> <p>Transition condition using FBD language (see 4.3)</p> <p>Successor step</p>
---	---	--

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 41 - Transitions and transition conditions (continued)

No.	Example	Description
4	<pre> +-----+ STEP7 +-----+ >TRANX>-----+ +-----+ STEP8 +-----+ </pre>	Use of connector: Predecessor step Transition connector Successor step
4a	<pre> %IX2.4 %IX2.3 +--- ----- ----->TRANX> </pre>	Transition condition: Using LD language (see 4.2)
4b	<pre> +-----+ & %IX2.4--- --->TRANX> %IX2.3--- +-----+ </pre>	Using FBD language (see 4.3)
5	<pre> STEP STEP7: END_STEP TRANSITION FROM STEP7 TO STEP8 := %IX2.4 & %IX2.3 ; END_TRANSITION STEP STEP8: END_STEP </pre>	Textual equivalent of feature 1 using ST language (see 3.3)
6	<pre> STEP STEP7: END_STEP TRANSITION FROM STEP7 TO STEP 8: LD %IX2.4 AND %IX2.3 END_TRANSITION STEP STEP8: END_STEP </pre>	Textual equivalent of feature 1 using IL language (see 3.2)

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 41 - Transitions and transition conditions (continued)

No.	Example	Description
7	<pre> +-----+ STEP7 +-----+ + TRAN78 +-----+ STEP8 +-----+ </pre>	<p>Use of transition name:</p> <p>Predecessor step</p> <p>Transition name</p> <p>Successor step</p>
7a	<pre> TRANSITION TRAN78 : %IX2.4 %IX2.3 TRAN78 +--- ----- ----- () ---+ END_TRANSITION </pre>	<p>Transition condition using LD language (see 4.2)</p>
7b	<pre> TRANSITION TRAN78 : +-----+ & %IX2.4--- ---TRAN78 %IX2.3--- +-----+ END_TRANSITION </pre>	<p>Transition condition using FBD language (see 4.3)</p>
7c	<pre> TRANSITION TRAN78 : LD %IX2.4 AND %IX2.3 END_TRANSITION </pre>	<p>Transition condition using IL language (see 3.2)</p>
7d	<pre> TRANSITION TRAN78 := %IX2.4 & %IX2.3 ; END_TRANSITION </pre>	<p>Transition condition using ST language (see 3.3)</p>
<p>NOTES</p> <p>1. If feature 1 of table 40 is supported, then one or more of features 1, 2, 3, 4, or 7 of this table shall be supported.</p> <p>2. If feature 2 of table 40 is supported, then feature 5 or 6 of this table, or both, shall be supported.</p>		

LIST OF TABLES (continued)

Table	Page
-------	------

2.6.4 Actions

Zero or more *actions* shall be associated with each step. A step which has zero associated actions shall be considered as having a WAIT function, that is, waiting for a successor transition condition to become true.

An action can be a Boolean variable, a collection of *instructions* in the IL language defined in 3.2, a collection of *statements* in the ST language defined in 3.3, a collection of *rungs* in the LD language defined in 4.2, a collection of *networks* in the FBD language defined in 4.3, or a *sequential function chart* (SFC) organized as defined in this subclause (2.6).

Actions shall be declared via one or more of the mechanisms defined in 2.6.4.1, and shall be associated with steps via textual *step bodies* or graphical *action blocks*, as defined in 2.6.4.2. The details of action block representation are defined in 2.6.4.3. Control of actions shall be expressed by *action qualifiers* as defined in 2.6.4.4.

2.6.4.1 Declaration

A programmable controller implementation which supports SFC elements shall provide one or more of the mechanisms defined in table 42 for the declaration of actions. The *scope* of the declaration of an action shall be *local* to the program organization unit containing the declaration.

LIST OF TABLES (continued)

Table

Page

Table 42 - Declaration of actions

No.	Feature	
1	Any Boolean variable declared in a VAR or VAR_OUTPUT block, or their graphical equivalents, can be an action.	
	Example	Feature
2l	<pre> +-----+ ACTION_4 +-----+ %IX1 %MX3 S8.X %QX17 +---+ ---+ ---+ ---+ () ---+ +-----+ +---+ EN ENO %MX10 C-- LT ------(S)----+ D-- +-----+ +-----+ </pre>	Graphical declaration in LD language (see 4.2)
2s	<pre> +-----+ OPEN_VALVE_1 +-----+ ... +=====+ VALVE_1_READY +=====+ + STEP8.X +-----+ +-----+ +-----+ VALVE_1_OPENING -- N VALVE_1_FWD +-----+ +-----+ +-----+ ... +-----+ </pre>	Inclusion of SFC elements in action
2f	<pre> +-----+ ACTION_4 +-----+ +-----+ %IX1-- & %MX3-- S8.X---+---+ +-----+ FF28 +-----+ SR Q1 -%MX10 C-- LT --- S1 D-- +-----+ +-----+ </pre>	Graphical declaration in FBD language (see 4.3)

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 42 - Declaration of actions (continued)

No.	Example	Feature
3s	<pre> ACTION ACTION_4: %QX17 := %IX1 & %MX3 & S8.X ; FF28 (S1 := (C<D)); %MX10 := FF28.Q; END_ACTION </pre>	<p>Textual declaration in ST language (see 3.3)</p>
3i	<pre> ACTION ACTION_4: LD S8.X AND %IX1 AND %MX3 ST %QX17 LD C LT D S1 FF28 LD FF28.Q ST %MX10 END_ACTION </pre>	<p>Textual declaration in IL language (see 3.2)</p>
<p>NOTES</p> <p>1 - The step flag S8.X is used in these examples to obtain the desired result that, when S8 is deactivated, %QX17 := 0.</p> <p>2 - If feature 1 of table 40 is supported, then one or more of the features in this table, or feature 4 of table 43, shall be supported.</p> <p>3 - If feature 2 of table 40 is supported, then one or more of features 1,3s, or 3i of this table shall be supported.</p>		

LIST OF TABLES (continued)

Table

Page

2.6.4.2 Association with steps

A programmable controller implementation which supports SFC elements shall provide one or more of the mechanisms defined in table 43 for the association of actions with steps.

Table 43 - Step/action association

No.	Example	Feature
1	<pre> +-----+ +-----+-----+-----+ S8 -- L ACTION_1 DN1 +-----+ t#10s + DN1 </pre>	Action block (see 2.6.4.3)
2	<pre> +-----+ +-----+-----+-----+-----+ S8 -- L ACTION_1 DN1 +-----+ t#10s +DN1 P ACTION_2 N ACTION_3 +-----+-----+-----+-----+ </pre>	Concatenated action blocks
3	<pre> STEP S8 : ACTION_1 (L,t#10s, DN1) ; ACTION_2 (P) ; ACTION_3 (N) ; END_STEP </pre>	Textual step body
4	<pre> +-----+-----+-----+-----+ ---- N ACTION_4 ---- +-----+-----+-----+-----+ %QX17 := %IX1 & %MX3 & S8.X ; FF28 (S1 := (C<D)); %MX10 := FF28.Q; +-----+-----+-----+-----+ </pre>	Action block "d" Field (see 2.6.4.3)
<p>NOTE - When feature 4 is used, the corresponding action name cannot be used in any other action block.</p>		

LIST OF TABLES (continued)

Table

Page

2.6.4.3 Action blocks

As shown in table 44, an *action block* is a graphical element for the combination of a Boolean variable with one of the *action qualifiers* specified in subclause 2.6.4.4 to produce an enabling condition, according to the rules given in subclause 2.6.4.5, and an associated action.

The action block provides a means of optionally specifying Boolean "indicator" variables, indicated by the "c" field in table 44, which can be set by the specified action to indicate its completion, timeout, error conditions, etc. If the "c" field is not present, and the "b" field specifies that the action shall be a Boolean variable, then this variable shall be interpreted as the "c" variable when required.

When action blocks are concatenated graphically as illustrated in table 43, such concatenations can have multiple indicator variables, but shall have only a single common Boolean input variable, which shall act simultaneously upon all the concatenated blocks.

As well as being associated with a step, an action block can be used as a graphical element in the LD or FBD languages specified in clause 4. In this case, signal or power flow through an action block shall follow the rules specified in 4.1.1.

Table 44 - Action block features

No.	Feature	Graphical form
1	"a" : Qualifier as per 2.6.4.4	
2	"b" : Action name	
3	"c" : Boolean "indicator" variables	<pre> +-----+-----+-----+-----+ --- "a" "b" "c" --- +-----+-----+-----+-----+ </pre>
	"d" : Action using:	
4	IL language (3.2)	<pre> "d" ----- +-----+ </pre>
5	ST language (3.3)	
6	LD language (4.2)	
7	FBD language (4.3)	
No.	Feature/Example	
8	Use of action blocks in ladder diagrams (see 4.2):	
	<pre> S8.X %IX7.5 +-----+-----+ OK1 +-- ---- ---- N ACT1 DN1 --()--+ +-----+-----+ </pre>	
9	Use of action blocks in function block diagrams (see 4.3):	
	<pre> +----+ +-----+-----+ S8.X--- & ----- N ACT1 DN1 ---OK1 %IX7.5--- +-----+-----+ +----+ </pre>	
NOTES		
1. Field "a" can be omitted when the qualifier is "N".		
2. Field "c" can be omitted when no feedback variable is used.		

LIST OF TABLES (continued)

Table

Page

2.6.4.4 Action qualifiers

Associated with each step/action association defined in 2.6.4.2, or each occurrence of an action block as defined in 2.6.4.3, shall be an *action qualifier*. The value of this qualifier shall be one of the values listed in table 45. In addition, the qualifiers L, D, SD, DS, and SL shall have an associated duration of type TIME.

NOTE - IEC 848 gives informal definitions and examples of the use of these qualifiers. This standard formalizes these definitions, redefining the "S" qualifier and introducing the "R" qualifier. The control of actions using these qualifiers is defined in the following subclause, and additional examples of their use are given in annex F.

Table 45 - Action qualifiers

No.	Qualifier	Explanation
1	None	Non-stored (null qualifier)
2	N	Non-stored
3	R	overriding Reset
4	S	Set (Stored)
5	L	time Limited
6	D	time Delayed
7	P	Pulse
8	SD	Stored and time Delayed
9	DS	Delayed and Stored
10	SL	Stored and time Limited


2.6.4.5 Action control

The control of actions shall be functionally equivalent to the application of the following rules:

- 1) Associated with each action shall be the functional equivalent of an instance of the ACTION_CONTROL function block defined in figures 14 and 15. If the action is declared as a Boolean variable, as defined in 2.6.4.1, the "Q" output of this block shall be the state of this Boolean variable. If the action is declared as a collection of statements or networks, as defined in 2.6.4.1, then this collection shall be executed upon each invocation of the program organisation unit (POU) in which the action is contained while the "Q" output of the ACTION_CONTROL function block stands at Boolean 1. The statements or networks shall be executed one final time after the falling edge of "Q".
- 2) A Boolean input to the ACTION_CONTROL block for an action shall be said to have an *association* with a step as defined in 2.6.4.2, or with an action block as defined in 2.6.4.3, if the corresponding qualifier is equivalent to the input name (N, R, S, L, D, P, SD, DS, or SL). The association shall be said to be *active* if the associated step is active, or if the associated action block's input has the value Boolean 1. The *active associations* of an *action* are equivalent to the set of *active associations* of all inputs to its ACTION_CONTROL function block.

LIST OF TABLES (continued)

Table	Page
<p>A Boolean input to an ACTION_CONTROL block shall have the value Boolean 1 if it has at least one active association, and the value Boolean 0 otherwise.</p>	
<p>3) The value of the T input to an ACTION_CONTROL block shall be the value of the duration portion of a time-related qualifier (L, D, SD, DS, or SL) of an active association. If no such association exists, the value of the T input shall be t#0s.</p>	
<p>4) It shall be an <i>error</i> in the sense of subclause 1.5.1 if one or more of the following conditions exist:</p> <p>a) More than one <i>active association</i> of an action has a time-related qualifier (L, D, SD, DS, or SL).</p> <p>b) The SD input to an ACTION_CONTROL block has the Boolean value 1 when the Q1 output of its SL_FF block has the Boolean value 1.</p> <p>c) The SL input to an ACTION_CONTROL block has the Boolean value 1 when the Q1 output of its SD_FF block has the Boolean value 1.</p>	
<p>5) It is not required that the ACTION_CONTROL block itself be implemented, but only that the control of actions be equivalent to the preceding rules. Only those portions of the action control appropriate to a particular action need be instantiated, as illustrated in figure 16. In particular, note that simple MOVE (:=) and Boolean OR functions suffice for control of Boolean variable actions if the latter's associations have only "N" qualifiers.</p>	

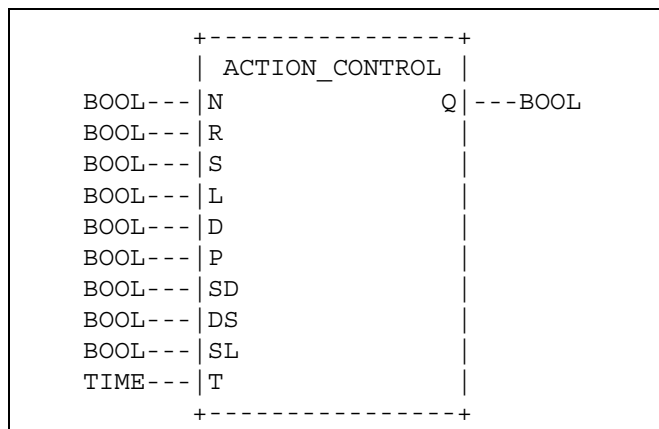

**Figure 14 - ACTION_CONTROL function block - External interface
(Not visible to the user)**

LIST OF TABLES (continued)

Table

Page

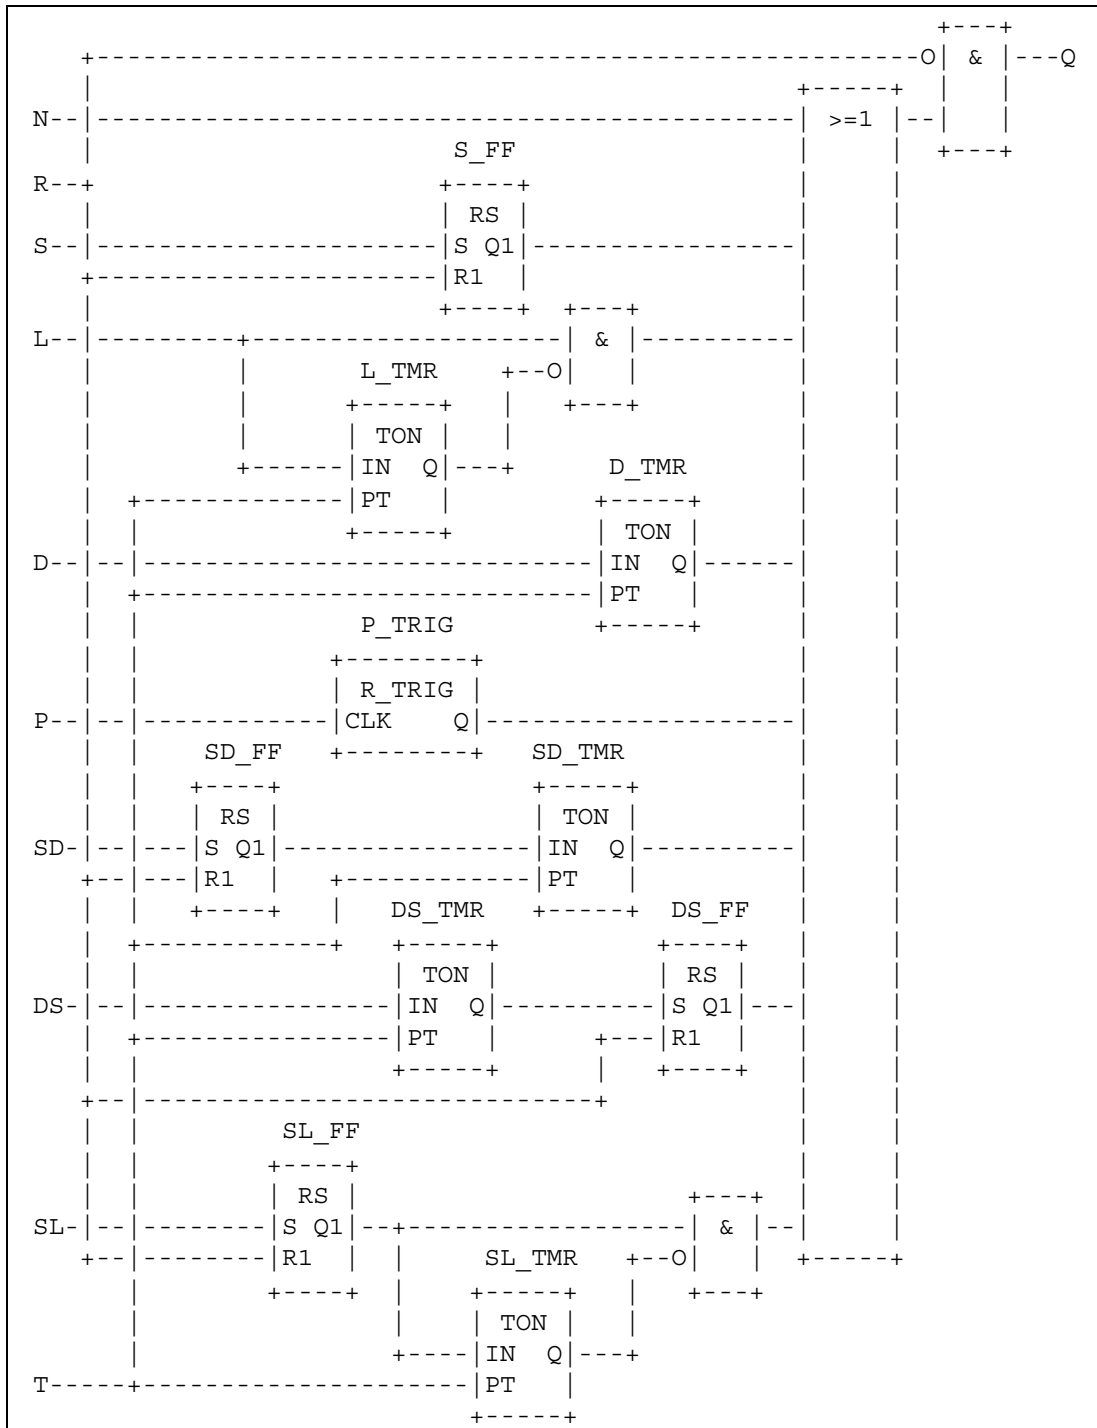


Figure 15 - ACTION_CONTROL function block body
(not visible to the user)

LIST OF TABLES (continued)

Table

Page

+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
S22	---	N	HV_BREAKER	HV_BRKR_CLOSED	
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
		S	START_INDICATOR		
		+-----+	+-----+	+-----+	+-----+
+ HV_BRKR_CLOSED					
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
S23	---	SL	RUNUP_MONITOR		
+-----+	t#1m				
		+-----+	+-----+	+-----+	+-----+
		D	START_WAIT		
		t#1s			
		+-----+	+-----+	+-----+	+-----+
+ START_WAIT					
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
S24	---	N	ADVANCE_STARTER	STARTER_ADVANCED	
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
		L	START_MONITOR		
		t#30s			
		+-----+	+-----+	+-----+	+-----+
+ STARTER_ADVANCED					
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
S26	---	N	RETRACT_STARTER	STARTER_RETRACTED	
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
+ STARTER_RETRACTED					
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
S27	---	R	START_INDICATOR		
+-----+	+-----+	+-----+	+-----+	+-----+	+-----+
		R	RUNUP_MONITOR		
		+-----+	+-----+	+-----+	+-----+
NOTE - The complete SFC network and its associated declarations are not shown in this example.					

Figure 16a - Action control example - SFC representation

LIST OF TABLES (continued)

Table

Page

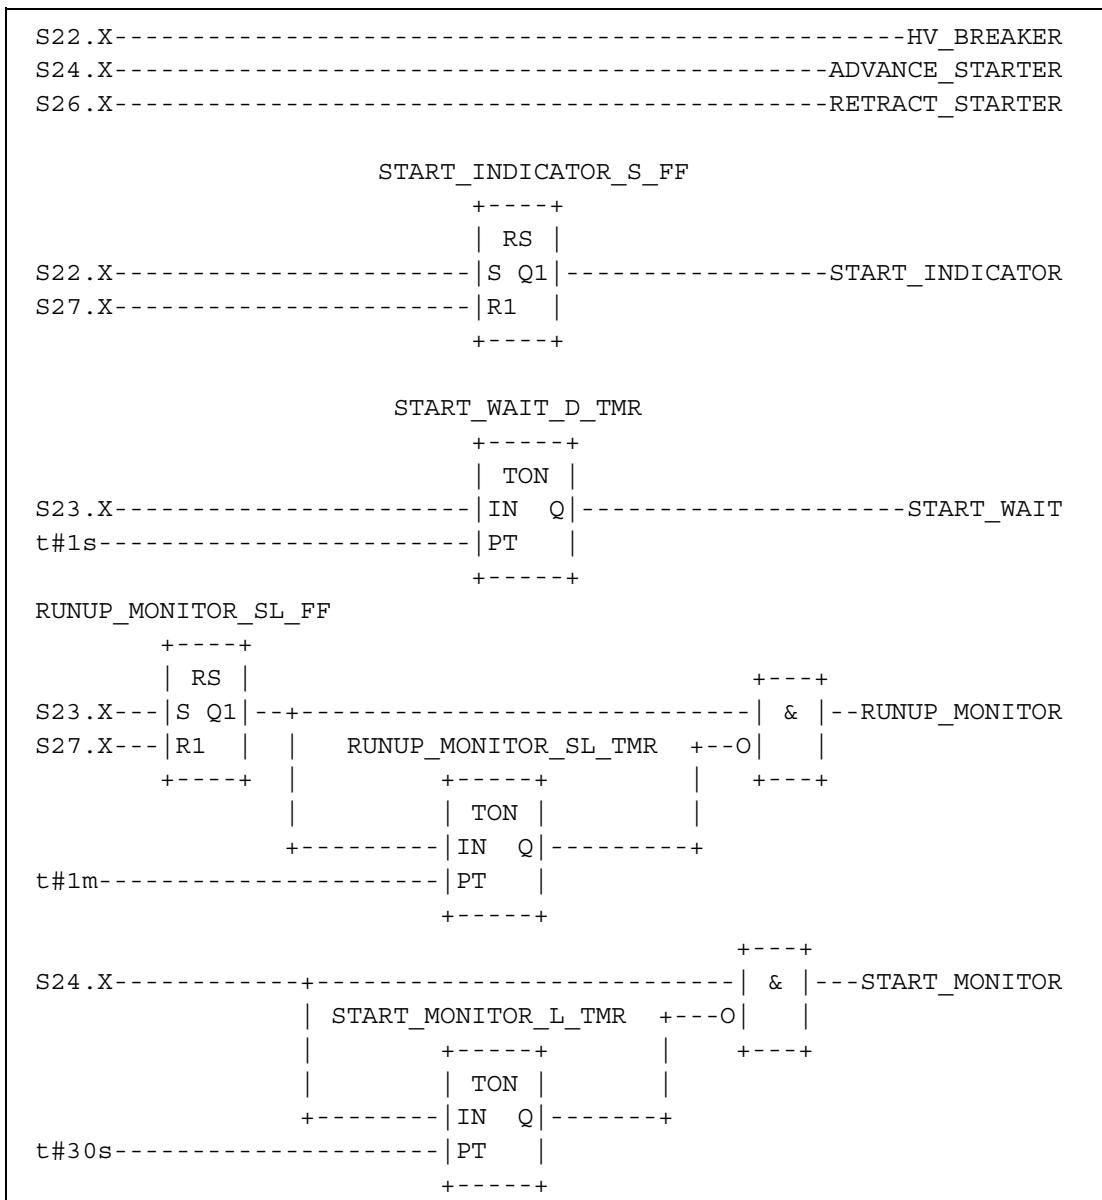


Figure 16b - Action control example - functional equivalent

2.6.5 Rules of evolution

The *initial situation* of a SFC network is characterized by the *initial step* which is in the active state upon initialization of the program or function block containing the network.

Evolutions of the active states of steps shall take place along the *directed links* when caused by the *clearing* of one or more *transitions*.

A transition is *enabled* when all the preceding steps, connected to the corresponding transition symbol by directed links, are active. The clearing of a transition occurs when the transition is enabled and when the associated transition condition is true.

The clearing of a transition causes the *deactivation* (or "resetting") of all the immediately preceding steps connected to the corresponding transition symbol by directed links, followed by the *activation* of all the immediately following steps.

LIST OF TABLES (continued)

Table	Page
-------	------

The alternation Step/Transition and Transition/Step shall always be maintained in SFC element connections, that is:

- Two steps shall never be directly linked; they shall always be separated by a transition.
- Two transitions shall never be directly linked; they shall always be separated by a step.

When the clearing of a transition leads to the activation of several steps at the same time, the sequences to which these steps belong are called *simultaneous sequences*. After their simultaneous activation, the evolution of each of these sequences becomes independent. In order to emphasize the special nature of such constructs, the divergence and convergence of simultaneous sequences shall be indicated by a double horizontal line.

Table 46 defines the syntax and semantics of the allowed combinations of steps and transitions.

The clearing time of a transition may theoretically be considered as short as one may wish, but it can never be zero. In practice, the clearing time will be imposed by the programmable controller implementation. For the same reason, the duration of a step activity can never be considered to be zero.

Several transitions which can be cleared simultaneously shall be cleared simultaneously, within the timing constraints of the particular programmable controller implementation and the priority constraints defined in table 46.

Testing of the successor transition condition(s) of an active step shall not be performed until the effects of the step activation have propagated throughout the program organization unit in which the step is declared.

Figure 17 illustrates the application of these rules. In this figure, the active state of a step is indicated by the presence of an asterisk (*) in the corresponding block. This notation is used for illustration only, and is not a required language feature.

The application of the rules given in this subclause cannot prevent the formulation of "unsafe" SFCs, such as the one shown in figure 18a, which may exhibit uncontrolled proliferation of tokens. Likewise, the application of these rules cannot prevent the formulation of "unreachable" SFCs, such as the one shown in figure 18b, which may exhibit "locked up" behavior. The programmable controller system shall treat the existence of such conditions as *errors* as defined in 1.5.1.

LIST OF TABLES (continued)

Table

Page

Table 46 - Sequence evolution

No.	Example	Rule
1	<pre> +-----+ S3 +-----+ + c +-----+ S4 +-----+ </pre>	<p>Single sequence: The alternation step-transition is repeated in series.</p> <p>Example: An evolution from step S3 to step S4 shall take place if and only if step S3 is in the active state and the transition condition c is true.</p>
2a	<pre> +-----+ S5 +-----+ +-----*-----+-----... + e + f +-----+ +-----+ S6 S8 +-----+ +-----+ </pre>	<p>Divergence of sequence selection: A selection between several sequences is represented by as many transition symbols, <i>under</i> the horizontal line, as there are different possible evolutions. The asterisk denotes left-to-right priority of transition evaluations.</p> <p>Example: An evolution shall take place from S5 to S6 only if S5 is active and the transition condition "e" is true, or from S5 to S8 only if S5 is active and "f" is true and "e" is false.</p>
2b	<pre> +-----+ S5 +-----+ +-----*-----+-----... 2 1 + e + f +-----+ +-----+ S6 S8 +-----+ +-----+ </pre>	<p>Divergence of sequence selection: The asterisk, followed by numbered branches, indicates a user-defined priority of transition evaluation, with the lowest-numbered branch having the highest priority.</p> <p>Example: An evolution shall take place from S5 to S8 only if S5 is active and the transition condition "f" is true, or from S5 to S6 only if S5 is active, and "e" is true, and "f" is false.</p>

LIST OF TABLES (continued)

Table

Page

<p>2c</p>	<pre> +-----+ S5 +-----+ +-----+-----+... +e +NOT e & f +-----+ +-----+ S6 S8 +-----+ +-----+ </pre>	<p>Divergence of sequence selection: The connection of the branch indicates that the user must assure that transition conditions are mutually exclusive, as specified by IEC 848.</p> <p>Example: S6 only if S5 is active and the transition condition "e" is true, or from S5 to S8 only if S5 is active and "e" is false and "f" is true.</p>
-----------	--	---

LIST OF TABLES (continued)

Table

Page

Table 46 - Sequence evolution (*continued*)

<p>3</p>	<pre> +-----+ +-----+ S7 S9 +-----+ +-----+ + h + j +-----+-----+---... +-----+ S10 +-----+ </pre>	<p>Convergence of sequence selection: The end of a sequence selection is represented by as many transition symbols, <i>above</i> the horizontal line, as there are selection paths to be ended.</p> <p>Example: An evolution shall take place from S7 to S10 only if S7 is active and the transition condition "h" is true, or from S9 to S10 only if S9 is active and "j" is true.</p>
<p>4</p>	<pre> +-----+ S11 +-----+ + b ==+=====+=====+==... +-----+ +-----+ S12 S14 +-----+ +-----+ </pre>	<p>Simultaneous sequences - divergence: Only one common transition symbol shall be possible, immediately <i>above</i> the double horizontal line of synchronization.</p> <p>Example: An evolution shall take place from S11 to S12, S14,... only if S11 is active and the transition condition "b" associated to the common transition is true. After the simultaneous activation of S12, S14, etc., the evolution of each sequence proceeds independently.</p>
	<pre> +-----+ +-----+ S13 S15 +-----+ +-----+ ==+=====+=====+==... + d +-----+ S16 +-----+ </pre>	<p>Simultaneous sequences - convergence: Only one common transition symbol shall be possible, immediately <i>under</i> the double horizontal line of synchronization.</p> <p>Example: An evolution shall take place from S13, S15,... to S16 only if all steps above and connected to the double horizontal line are active and the transition condition "d" associated to the common transition is true.</p>

LIST OF TABLES (continued)

Table

Page

Table 46 - Sequence evolution (continued)

No.	Example	Rule
5a 5b 5c	<pre> +-----+ S30 +-----+ +---*---+ + a +d +-----+ S31 +-----+ + b +-----+ S32 +-----+ + c +---+---+ +-----+ S33 +-----+ </pre>	<p>Sequence skip: A "sequence skip" is a special case of sequence selection (Feature 2) in which one or more of the branches contain no steps. Features 5a, 5b, and 5c correspond to the representation options given in features 2a, 2b, and 2c, respectively.</p> <p>Example: (Feature 5a shown) An evolution shall take place from S30 to S33 if "a" is false and "d" is true, that is, the sequence (S31, S32) will be skipped.</p>

LIST OF TABLES (continued)

Table		Page
<p>6a 6b 6c</p>	<pre> +-----+ S30 +-----+ + a +-----+ +-----+ S31 +-----+ + b +-----+ S32 +-----+ *-----+ + c + d +-----+ +-----+ S33 +-----+ </pre>	<p>Sequence loop: A "sequence loop" is a special case of sequence selection (Feature 2) in which one or more of the branches returns to a preceding step. Features 6a, 6b, and 6c correspond to the representation options given in features 2a, 2b, and 2c, respectively.</p> <p>Example: (Feature 6a shown) An evolution shall take place from S32 to S31 if "c" is false and "d" is true, that is, the sequence (S31, S32) will be repeated.</p>

Table 46 - Sequence evolution (concluded)

No.	Example	Rule
-----	---------	------

LIST OF TABLES (continued)

Table

Page


<p>7</p>	<pre> +-----+ S30 +-----+ + a +-----<-----+ +-----+ S31 +-----+ + b +-----+ S32 +-----+ *-----+ + c + d +-----+ +-->+ S33 +-----+ </pre>	<p>Directional arrows: When necessary for clarity, the "less than" (<) character of the ISO 646 character set can be used to indicate right-to-left control flow, and the "greater than" (>) character to represent left-to-right control flow. When this feature is used, the corresponding character shall be located between two "-" characters, that is, in the character sequence "-<-" or "->-" as shown in the accompanying example.</p>
----------	--	---

LIST OF TABLES (continued)


Table

Page


a) Transition not enabled (X = Don't care)

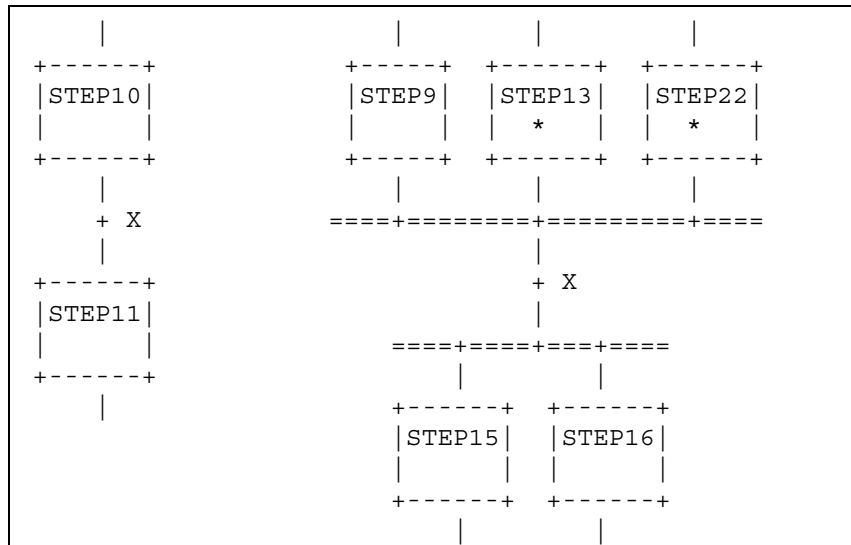

b) Transition enabled but not cleared (X = 0)

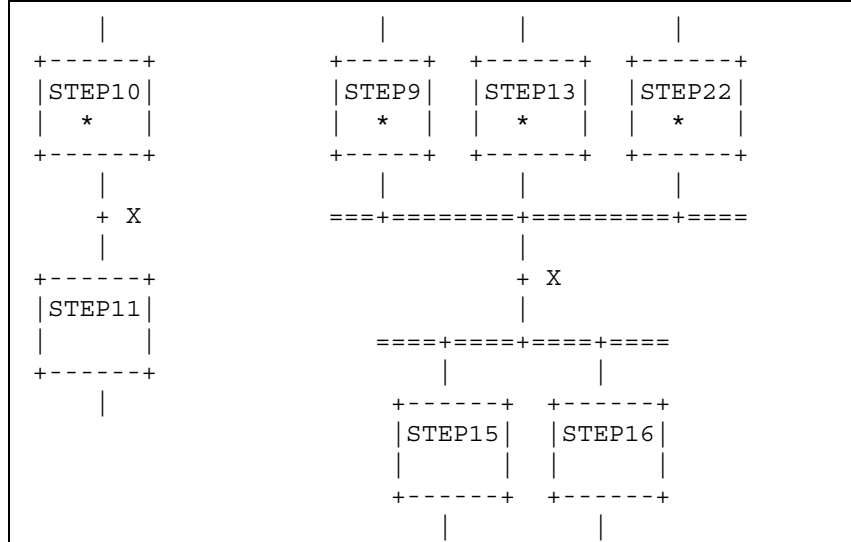

c) Transition cleared (X = 1)

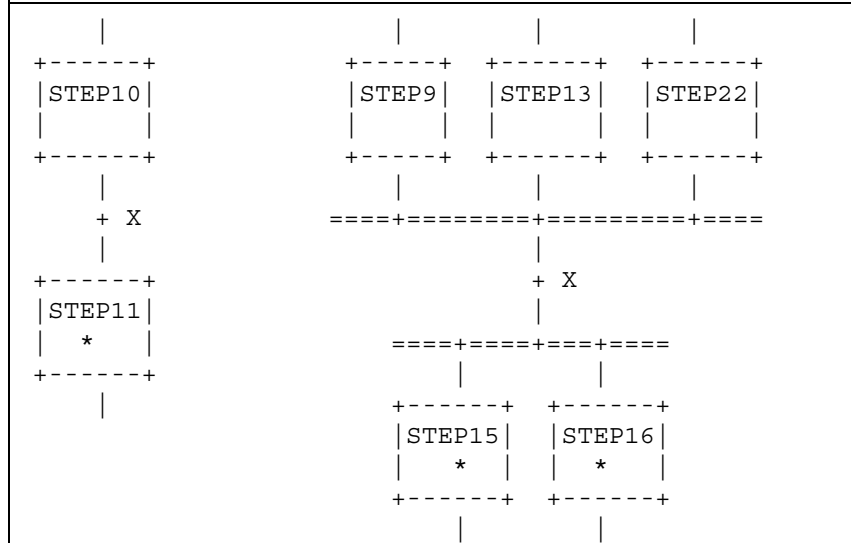

LIST OF TABLES (continued)

Table

Page

NOTE - In this figure, the active state of a step is indicated by the presence of an asterisk (*) in the corresponding block. This notation is used for illustration only, and is not a required language feature.

Figure 17 - SFC evolution rules

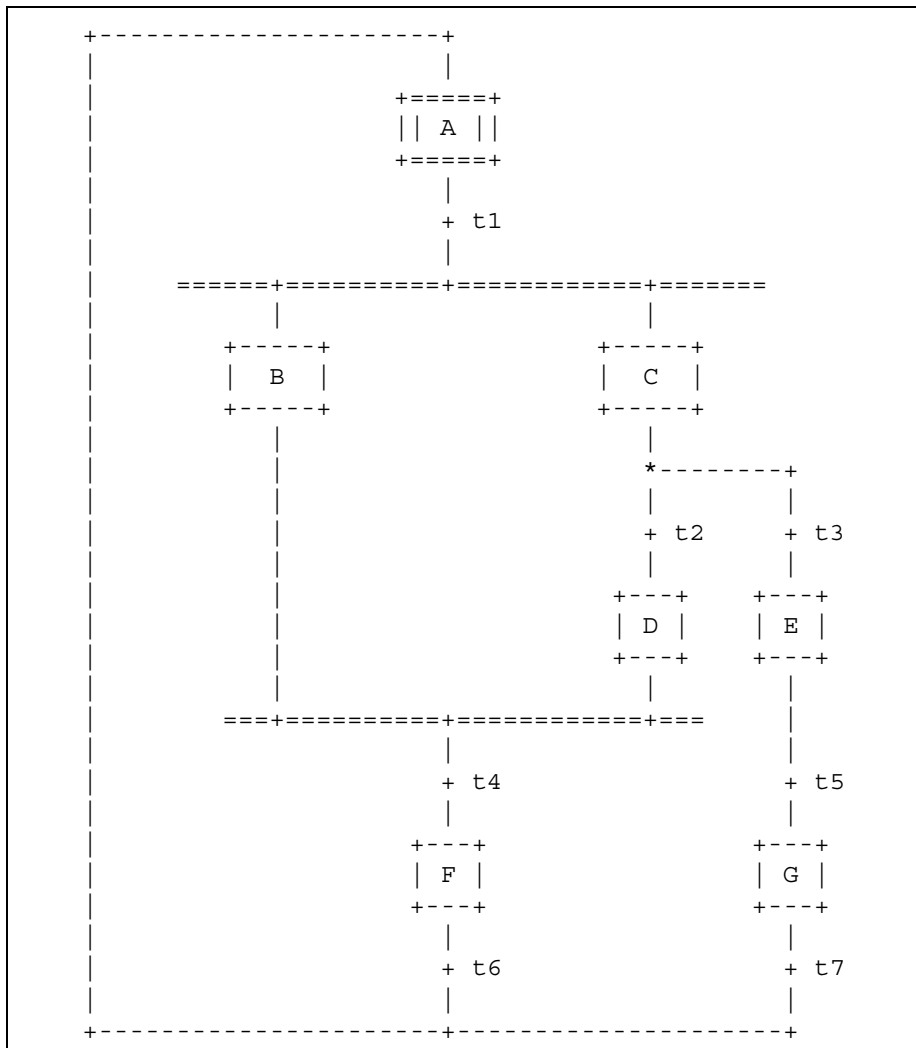


Figure 18a - SFC errors: an "unsafe" SFC (see 2.6.5)

LIST OF TABLES (continued)

Table

Page

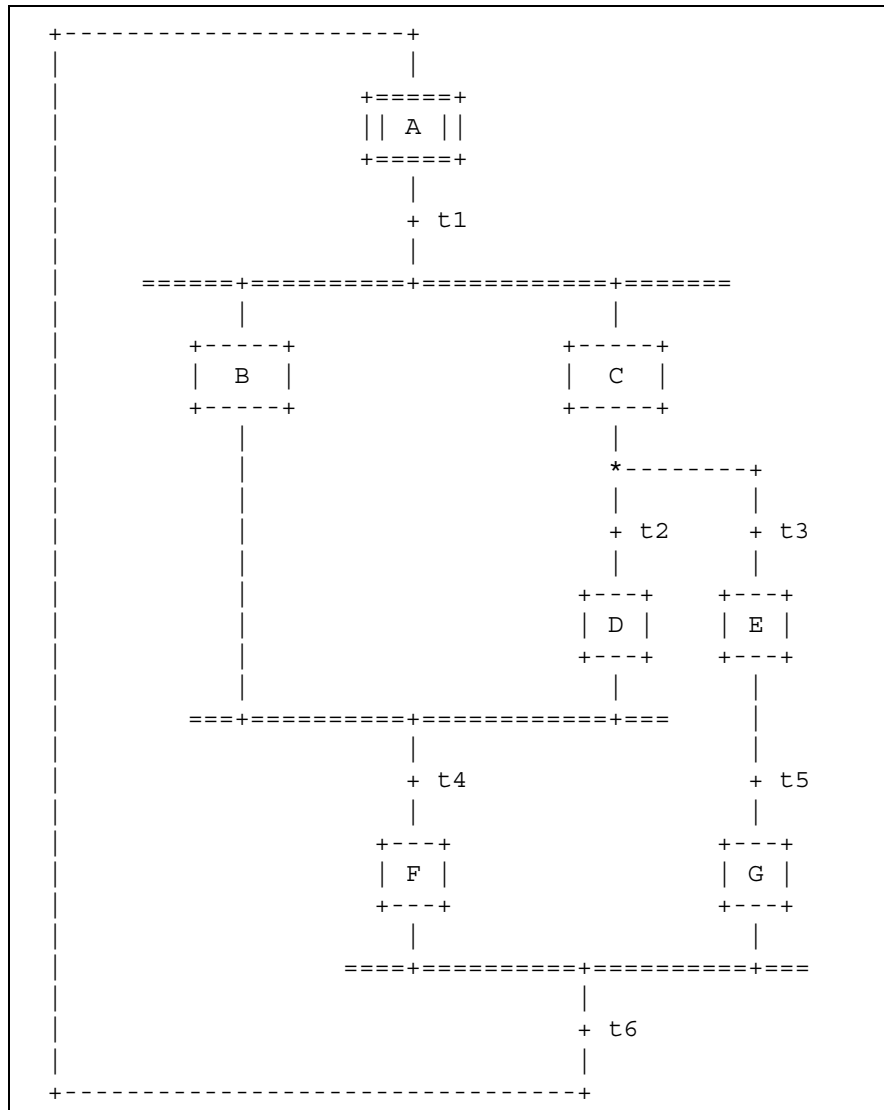


Figure 18b - SFC errors: an "unreachable" SFC (see 2.6.5)

LIST OF TABLES (continued)

Table

Page

2.6.6 Compatibility of SFC elements

SFCs can be represented graphically or textually, utilizing the elements defined above. Table 47 summarizes for convenience those elements which are mutually compatible for graphical and textual representation, respectively.

Table 47 - Compatible SFC features

Table	Graphical representation	Textual representation
40	1, 3a, 3b, 4	2, 3a, 4
41	1,2,3,4,4a,4b,7,7a,7b	5, 6, 7c, 7d
42	1, 2l, 2s, 2f	3s,3i
43	1, 2, 4	3
44	1 to 9	--
45	1 to 10	1 to 10 (textual equivalent)
46	1 to 7	1 to 6
57	All	--

2.6.7 Compliance requirements

In order to claim compliance with the requirements of 2.6, the elements shown in table 48 shall be supported and the compatibility requirements defined in 2.6.6 shall be observed.

Table 48 - SFC minimal compliance requirements

Table	Graphical representation	Textual representation
40	1	2
41	1 or 2 or 3 or (4 and (4a or 4b)) or (7 and (7a or 7b or 7c or 7d))	5 or 6
42	1 or 2l or 2f	3s or 3i
43	1 or 2 or 4	3
45	1 or 2	1 or 2
46	1 and (2a or 2b or 2c) and 3 and 4	Same (textual equivalent)
57	(1 or 2) and (3 or 4) and (5 or 6) and (7 or 8) and (9 or 10) and (11 or 12)	Not required

LIST OF TABLES (continued)


Table

Page

2.7 Configuration elements

As described in 1.4.1, a *configuration* consists of *resources*, *tasks* (which are defined within *resources*), *global variables*, and *access paths*. Each of these elements is defined in detail in this subclause.

A graphic example of a simple configuration is shown in figure 19a. Skeleton declarations for the corresponding function blocks and programs are given in figure 19b. This figure serves as a reference point for the examples of configuration elements given in the remainder of this subclause such as in figure 20.

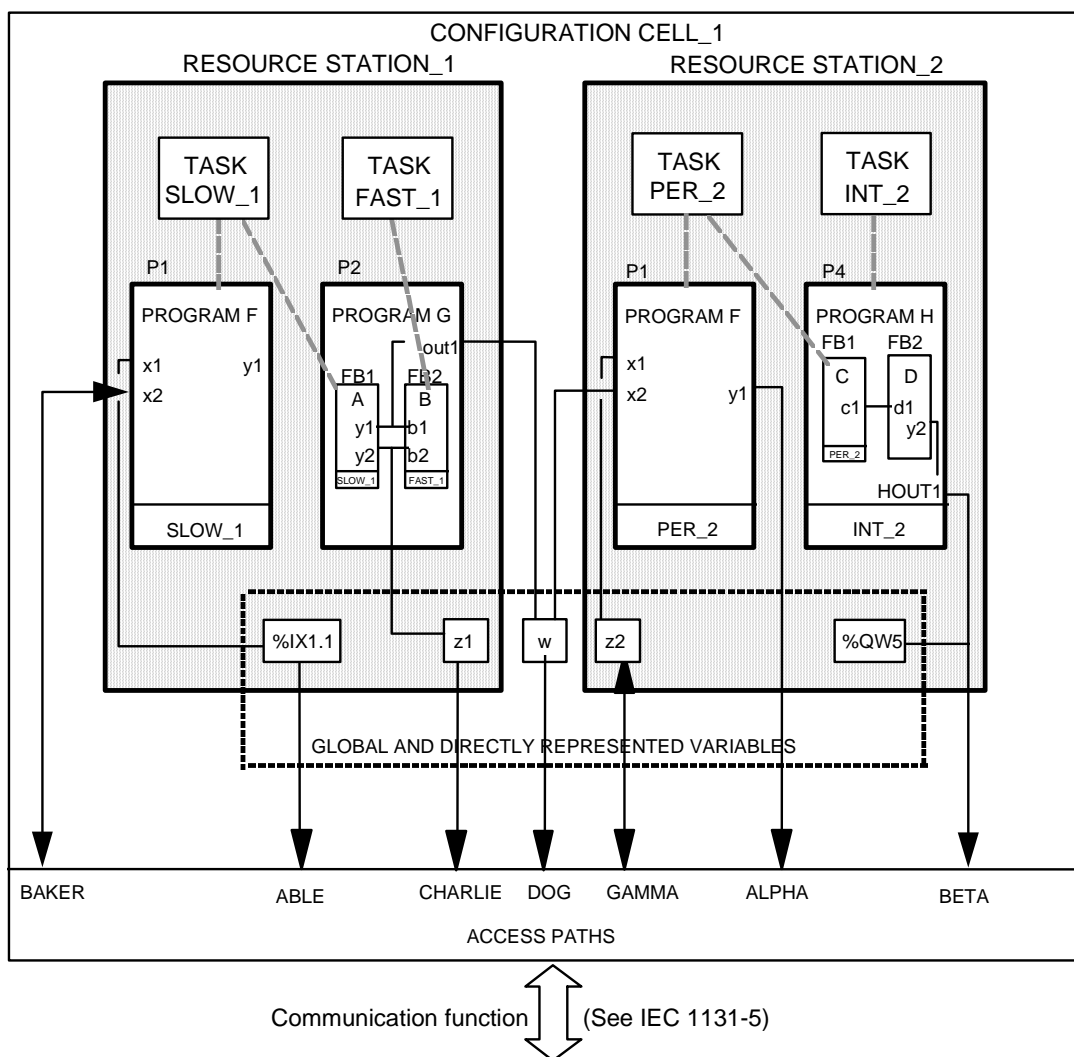

19a - Graphical example of a configuration

Figure

LIST OF TABLES (continued)

Table

Page

<pre> FUNCTION_BLOCK A VAR_OUTPUT y1 : UINT ; y2 : BYTE ; END_VAR END_FUNCTION_BLOCK </pre>	<pre> FUNCTION_BLOCK B VAR_INPUT b1 : UINT ; b2 : BYTE ; END_VAR END_FUNCTION_BLOCK </pre>
<pre> FUNCTION_BLOCK C VAR_OUTPUT c1 : BOOL ; END_VAR END_FUNCTION_BLOCK </pre>	<pre> FUNCTION_BLOCK D VAR_INPUT d1 : BOOL ; END_VAR VAR_OUTPUT y2 : INT ; END_VAR END_FUNCTION_BLOCK </pre>
<pre> PROGRAM F VAR_INPUT x1 : BOOL ; x2 : UINT ; END_VAR VAR_OUTPUT y1 : BYTE ; END_VAR END_PROGRAM </pre>	
<pre> PROGRAM G VAR_OUTPUT out1 : UINT ; END_VAR VAR_EXTERNAL z1 : BYTE ; END_VAR VAR FB1 : A ; FB2 : B ; END_VAR FB1(...); out1 := FB1.y1; z1 := FB1.y2; FB2(b1 := FB1.y1, b2 := FB1.y2) ; END_PROGRAM </pre>	
<pre> PROGRAM H VAR_OUTPUT HOUT1: INT ; END_VAR VAR FB1 : C ; FB2 : D ; END_VAR FB1(...); FB2(d1 := FB1.c1); HOUT1 := FB2.y2; END_PROGRAM </pre>	

Figure 19b - Skeleton function block and program declarations for configuration example

2.7.1 Configurations, resources, and access paths

Table 49 enumerates the language features for declaration of *configurations*, *resources*, *global variables*, and *access paths*. Partial enumeration of TASK declaration features is also given; additional information on *tasks* is provided in 2.7.2. The formal syntax for these features is given in B.1.7. Figure 20 provides examples of these features, corresponding to the example configuration shown in figure 19a and the supporting declarations in figure 19b.

The ON qualifier in the RESOURCE...ON...END_RESOURCE construction is used to specify the type of "processing function" and its "man-machine interface" and "sensor and actuator interface" functions upon which the *resource* and its associated *programs* and *tasks* are to be implemented. The manufacturer shall supply a *resource library* of such functions, as illustrated in figure 3. Associated with each element in this library shall be an identifier (the *resource type name*) for use in resource declaration.

LIST OF TABLES (continued)

Table Page

The *scope* of a VAR_GLOBAL declaration shall be limited to the *configuration* or *resource* in which it is declared, with the exception that an *access path* can be declared to a *global* variable in a *resource* using feature 10d in table 49.

The VAR_ACCESS...END_VAR construction provides a means of specifying named variables which can be accessed by some of the communication services specified in IEC 1131-5. An *access path* associates each such variable with an input or output variable of a *program*, a *global* variable, or a *directly represented* variable as defined in 2.4.1.1. If such a variable is a *multi-element variable* (*structure* or *array*), an access path can be specified to an element of the variable. The direction of the access path can be specified as READ_WRITE or READ_ONLY, indicating that the communication services can both read and modify the value of the variable in the first case, or read but not modify the value in the second case. If no direction is specified, the default direction is READ_ONLY.

Table 49 - Configuration and resource declaration features

No.	DESCRIPTION
1	CONFIGURATION...END_CONFIGURATION construction
2	VAR_GLOBAL...END_VAR construction within CONFIGURATION
3	RESOURCE...ON...END_RESOURCE construction
4	VAR_GLOBAL...END_VAR construction within RESOURCE
5a	Periodic TASK construction within RESOURCE (Note 1)
5b	Non-periodic TASK construction within RESOURCE (Note 1)
6a	PROGRAM declaration with PROGRAM-to-TASK association using the WITH construction (Note 1)
6b	PROGRAM declaration with Function Block-to-TASK association using the WITH construction (Note 1)
6c	PROGRAM declaration with no TASK association (Note 1)
7	Declaration of directly represented variables in VAR_GLOBAL (Note 2)
8a	Connection of directly represented variables to PROGRAM inputs
8b	Connection of GLOBAL variables to PROGRAM inputs
9a	Connection of PROGRAM outputs to directly represented variables
9b	Connection of PROGRAM outputs to GLOBAL variables
10a	VAR_ACCESS...END_VAR construction
10b	Access paths to directly represented variables
10c	Access paths to PROGRAM inputs
10d	Access paths to GLOBAL variables in RESOURCES
10e	Access paths to GLOBAL variables in CONFIGURATIONS
10f	Access paths to PROGRAM outputs

LIST OF TABLES (continued)

Table

Page

NOTES

1. See 2.7.2 for further description of TASK features.
2. See 2.4.3.1 for further description of related features.

LIST OF TABLES (continued)

Table

Page

No.	EXAMPLE
1	CONFIGURATION CELL_1
2	VAR_GLOBAL w: UINT; END_VAR
3	RESOURCE STATION_1 ON PROCESSOR_TYPE_1
4	VAR_GLOBAL z1: BYTE; END_VAR
5a	TASK SLOW_1 (INTERVAL := t#20ms, PRIORITY := 2) ;
5a	TASK FAST_1 (INTERVAL := t#10ms, PRIORITY := 1) ;
6a	PROGRAM P1 WITH SLOW_1 :
8a	F(x1 := %IX1.1) ;
9b	PROGRAM P2 : G(OUT1 => w,
6b	FB1 WITH SLOW_1,
6b	FB2 WITH FAST_1) ;
3	END_RESOURCE
3	RESOURCE STATION_2 ON PROCESSOR_TYPE_2
4	VAR_GLOBAL z2 : BOOL ;
7	AT %QW5 : INT ;
4	END_VAR
5a	TASK PER_2 (INTERVAL := t#50ms, PRIORITY := 2) ;
5b	TASK INT_2 (SINGLE := z2, PRIORITY := 1) ;
6a	PROGRAM P1 WITH PER_2 :
8b	F(x1 := z2, x2 := w) ;
6a	PROGRAM P4 WITH INT_2 :
9a	H(HOUT1 => %QW5,
6b	FB1 WITH PER_2);
3	END_RESOURCE
10a	VAR_ACCESS
10b	ABLE : STATION_1.%IX1.1 : BOOL READ_ONLY ;
10c	BAKER : STATION_1.P1.x2 : UINT READ_WRITE ;
10d	CHARLIE : STATION_1.z1 : BYTE ;
10e	DOG : w : UINT READ_ONLY ;
10f	ALPHA : STATION_2.P1.y1 : BYTE READ_ONLY ;
10f	BETA : STATION_2.P4.HOUT1 : INT READ_ONLY ;
10d	GAMMA : STATION_2.z2 : BOOL READ_WRITE ;
10a	END_VAR
1	END_CONFIGURATION

NOTES

1. Graphical and semigraphic representation of these features is allowed but is beyond the scope of this Part of IEC 1131.
2. It is an *error* if the data type declared for a variable in a VAR_ACCESS statement is not the same as the data type declared for the variable elsewhere, e.g., if variable BAKER is declared of type WORD in the above examples.

LIST OF TABLES (continued)

Table

Page

Figure 20 - Examples of CONFIGURATION and RESOURCE declaration features

LIST OF TABLES (continued)

Table Page

2.7.2 Tasks

For the purposes of IEC 1131-3, a *task* is defined as an execution control element which is capable of invoking, either on a periodic basis or upon the occurrence of the rising edge of a specified Boolean variable, the execution of a set of program organization units, which can include *programs* and *function blocks* whose instances are specified in the declaration of *programs*.

Tasks and their association with program organization units can be represented graphically or textually using the WITH construction, as shown in table 50, as part of *resources* within *configurations*. A task is implicitly enabled or disabled by its associated resource according to the mechanisms defined in 1.4.1. The control of program organization units by enabled tasks shall conform to the following rules:

- 1) The associated program organization units shall be scheduled for execution upon each rising edge of the SINGLE input of the task.
- 2) If the INTERVAL input is non-zero, the associated program organization units shall be scheduled for execution periodically at the specified interval as long as the SINGLE input stands at zero (0). If the INTERVAL input is zero (the default value), no periodic scheduling of the associated program organization units shall occur.
- 3) The PRIORITY input of a task establishes the scheduling priority of the associated program organization units, with zero (0) being highest priority and successively lower priorities having successively higher numeric values. As shown in table 50, the priority of a program organization unit (that is, the priority of its associated task) can be used for *preemptive* or *non-preemptive* scheduling.
 - a) In *non-preemptive* scheduling, processing power becomes available on a *resource* when execution of a program organization unit or operating system function is complete. When processing power is available, the program organization unit with highest scheduled priority shall begin execution. If more than one program organization unit is waiting at the highest scheduled priority, then the program organization unit with the longest waiting time at the highest scheduled priority shall be executed.
 - b) In *preemptive* scheduling, when a program organization unit is scheduled, it can *interrupt* the execution of a program organization unit of lower priority on the same *resource*, that is, the execution of the lower-priority unit can be suspended until the execution of the higher-priority unit is completed. A program organization unit shall not interrupt the execution of another unit of the same or higher priority.

NOTE - Depending on schedule priorities, a program organization unit might not begin execution at the instant it is scheduled. However, in the examples shown in table 50, all program organization units meet their *deadlines*, that is, they all complete execution before being scheduled for re-execution. The manufacturer shall provide information to enable the user to determine whether all deadlines will be met in a proposed configuration.

- 4) A *program* with no task association shall have the lowest system priority. Any such program shall be scheduled for execution upon "starting" of its *resource*, as defined in 1.4.1, and shall be re-scheduled for execution as soon as its execution terminates.
- 5) When a *function block instance* is associated with a task, its execution shall be under the exclusive control of the task, independent of the rules of evaluation of the program organization unit in which the task-associated function block instance is declared.

LIST OF TABLES (continued)

Table	Page
6) Execution of a <i>function block instance</i> which is not directly associated with a task shall follow the normal rules for the order of evaluation of language elements for the program organization unit (which can itself be under the control of a task) in which the function block instance is declared.	
7) The execution of function blocks within a program shall be synchronized to ensure that data concurrency is achieved according to the following rules:	
a) If a function block receives more than one input from another function block, then when the former is executed, all inputs from the latter shall represent the results of the same evaluation. For instance, in the example represented by figure 21a, when Y2 is evaluated, the inputs Y2.A and Y2.B shall represent the outputs Y1.C and Y1.D from the same (not two different) evaluations of Y1.	
b) If two or more function blocks receive inputs from the same function block, and if the "destination" blocks are all explicitly or implicitly associated with the same task, then the inputs to all such "destination" blocks at the time of their evaluation shall represent the results of the same evaluation of the "source" block. For instance, in the example represented by figures 21b and 21c, when Y2 and Y3 are evaluated in the normal course of evaluating program P1, the inputs Y2.A and Y2.B shall be the results of the same evaluation of Y1 as the inputs Y3.A and Y3.B.	

Provision shall be made for storage of the outputs of functions or function blocks which have explicit task associations, or which are used as inputs to program organization units which have explicit task associations, as necessary to satisfy the rules given above.

LIST OF TABLES (continued)

Table

Page

Table 50 - Task features

No.	Description/Examples
1a	Textual declaration of periodic TASK (feature 5a of table 49)
1b	Textual declaration of non-periodic TASK (feature 5b of table 49)
	<p>Graphical representation of TASKs within a RESOURCE</p> <pre> TASKNAME +-----+ TASK ----- SINGLE ----- INTERVAL ----- PRIORITY ----- +-----+ </pre>
2a	<p>Graphical representation of periodic TASKs</p> <pre> SLOW_1 FAST_1 +-----+ +-----+ TASK TASK ----- ----- SINGLE SINGLE ----- ----- INTERVAL INTERVAL ----- ----- PRIORITY PRIORITY ----- ----- +-----+ +-----+ t#20ms--- t#10ms--- 2--- 1--- </pre>
2b	<p>Graphical representation of non-periodic TASK</p> <pre> INT_2 +-----+ TASK ----- SINGLE ----- INTERVAL ----- PRIORITY ----- +-----+ %IX2--- 1--- </pre>
3a	Textual association with PROGRAMs (feature 6a of table 49)
3b	Textual association with FUNCTION BLOCKs (feature 6b of table 49)
4a	<p>Graphical association with PROGRAMs (within RESOURCEs)</p> <pre> RESOURCE STATION_2 P1 P4 +-----+ +-----+ F H ----- ----- PER_2 INT_2 ----- ----- +-----+ +-----+ END_RESOURCE </pre>

LIST OF TABLES (continued)

Table

Page

Table 50 - Task features (*continued*)

No.	Description/Examples																																													
4b	<p style="text-align: center;">Graphical association with FUNCTION BLOCKs (within PROGRAMs inside RESOURCEs)</p> <p>RESOURCE STATION_1</p> <div style="border: 1px dashed black; padding: 10px; margin: 10px auto; width: fit-content;"> <p style="text-align: center;">P2</p> <p style="text-align: center;">G</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center; border-right: 1px dashed black; padding: 5px;"> <p>FB1</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">A</p> <p style="text-align: center;"> SLOW_1 </p> </div> </td> <td style="width: 50%; text-align: center; padding: 5px;"> <p>FB2</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">B</p> <p style="text-align: center;"> FAST_1 </p> </div> </td> </tr> </table> </div> <p>END_RESOURCE</p>	<p>FB1</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">A</p> <p style="text-align: center;"> SLOW_1 </p> </div>	<p>FB2</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">B</p> <p style="text-align: center;"> FAST_1 </p> </div>																																											
<p>FB1</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">A</p> <p style="text-align: center;"> SLOW_1 </p> </div>	<p>FB2</p> <div style="border: 1px dashed black; padding: 5px; margin: 5px auto; width: 60%;"> <p style="text-align: center;">B</p> <p style="text-align: center;"> FAST_1 </p> </div>																																													
5a	<p style="text-align: center;">Non-preemptive scheduling</p> <p>Example 1:</p> <ul style="list-style-type: none"> - RESOURCE STATION_1 as configured in figure 20 - Execution times: P1 = 2 ms; P2 = 8 ms; - P2.FB1 = P2.FB2 = 2 ms (NOTE 3) - STATION_1 starts at t = 0 <p style="text-align: center;">SCHEDULE (repeats every 40 ms)</p> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th style="width: 10%;">t(ms)</th> <th style="width: 35%;">Executing</th> <th style="width: 55%;">Waiting</th> </tr> </thead> <tbody> <tr><td>0</td><td>P2.FB2 @ 1</td><td>P1 @ 2, P2.FB1 @ 2, P2</td></tr> <tr><td>2</td><td>P1 @ 2</td><td>P2.FB1 @ 2, P2</td></tr> <tr><td>4</td><td>P2.FB1 @ 2</td><td>P2</td></tr> <tr><td>6</td><td>P2</td><td></td></tr> <tr><td>10</td><td>P2</td><td>P2.FB2 @ 1</td></tr> <tr><td>14</td><td>P2.FB2 @ 1</td><td>P2</td></tr> <tr><td>16</td><td>P2</td><td>(P2 restarts)</td></tr> <tr><td>20</td><td>P2</td><td>P2.FB2 @ 1, P1 @ 2, P2.FB1 @ 2</td></tr> <tr><td>24</td><td>P2.FB2 @ 1</td><td>P1 @ 2, P2.FB1 @ 2, P2</td></tr> <tr><td>26</td><td>P1 @ 2</td><td>P2.FB1 @ 2, P2</td></tr> <tr><td>28</td><td>P2.FB1 @ 2</td><td>P2</td></tr> <tr><td>30</td><td>P2.FB2 @ 1</td><td>P2</td></tr> <tr><td>32</td><td>P2</td><td></td></tr> <tr><td>40</td><td>P2.FB2 @ 1</td><td>P1 @ 2, P2.FB1 @ 2, P2</td></tr> </tbody> </table>	t(ms)	Executing	Waiting	0	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2	2	P1 @ 2	P2.FB1 @ 2, P2	4	P2.FB1 @ 2	P2	6	P2		10	P2	P2.FB2 @ 1	14	P2.FB2 @ 1	P2	16	P2	(P2 restarts)	20	P2	P2.FB2 @ 1, P1 @ 2, P2.FB1 @ 2	24	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2	26	P1 @ 2	P2.FB1 @ 2, P2	28	P2.FB1 @ 2	P2	30	P2.FB2 @ 1	P2	32	P2		40	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2
t(ms)	Executing	Waiting																																												
0	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2																																												
2	P1 @ 2	P2.FB1 @ 2, P2																																												
4	P2.FB1 @ 2	P2																																												
6	P2																																													
10	P2	P2.FB2 @ 1																																												
14	P2.FB2 @ 1	P2																																												
16	P2	(P2 restarts)																																												
20	P2	P2.FB2 @ 1, P1 @ 2, P2.FB1 @ 2																																												
24	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2																																												
26	P1 @ 2	P2.FB1 @ 2, P2																																												
28	P2.FB1 @ 2	P2																																												
30	P2.FB2 @ 1	P2																																												
32	P2																																													
40	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2																																												

LIST OF TABLES (continued)

Table

Page

Table 50 - Task features (continued)

No.	Description/Examples		
5a	Non-preemptive scheduling		
	Example 2: - RESOURCE STATION_2 as configured in figure 20 - Execution times: P1 = 30 ms, P4 = 5 ms, P4.FB1 = 10 ms (NOTE 4) - INT_2 is triggered at t = 25, 50, 90, ... ms - STATION_2 starts at t = 0		
	SCHEDULE		
	t(ms)	Executing	Waiting
	0	P1 @ 2	P4.FB1 @ 2
	25	P1 @ 2	P4.FB1 @ 2, P4 @ 1
	30	P4 @ 1	P4.FB1 @ 2
	35	P4.FB1 @ 2	
	50	P4 @ 1	P1 @ 2, P4.FB1 @ 2
	55	P1 @ 2	P4.FB1 @ 2
	85	P4.FB1 @ 2	
	90	P4.FB1 @ 2	P4 @ 1
95	P4 @ 1		
100	P1 @ 2	P4.FB1 @ 2	
5b	Preemptive scheduling		
	Example 3: - RESOURCE STATION_1 as configured in figure 20 - Execution times: P1 = 2 ms; P2 = 8 ms; P2.FB1 = P2.FB2 = 2 ms (NOTE 3) - STATION_1 starts at t = 0		
	SCHEDULE		
	t(ms)	Executing	Waiting
	0	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2
	2	P1 @ 2	P2.FB1 @ 2, P2
	4	P2.FB1 @ 2	P2
	6	P2	
	10	P2.FB2 @ 1	P2
	12	P2	
	16	P2	(P2 restarts)
	20	P2.FB2 @ 1	P1 @ 2, P2.FB1 @ 2, P2

LIST OF TABLES (continued)

Table

Page

Table 50 - Task features (concluded)

No.	Description/Examples		
5b	Preemptive scheduling		
	Example 4: - RESOURCE STATION_2 as configured in figure 20 - Execution times: P1 = 30 ms, P4 = 5 ms, P4.FB1 = 10 ms (NOTE 4) - INT_2 is triggered at t = 25, 50, 90, ... ms - STATION_2 starts at t = 0		
	SCHEDULE		
	t(ms)	Executing	Waiting
	0	P1 @ 2	P4.FB1 @ 2
	25	P4 @ 1	P1 @ 2, P4.FB1 @ 2
	30	P1 @ 2	P4.FB1 @ 2
	35	P4.FB1 @ 2	
	50	P4 @ 1	P1 @ 2, P4.FB1 @ 2
	55	P1 @ 2	P4.FB1 @ 2
	85	P4.FB1 @ 2	
	90	P4 @ 1	P4.FB1 @ 2
95	P4.FB1 @ 2		
100	P1 @ 2	P4.FB1 @ 2	
<p>NOTES</p> <ol style="list-style-type: none"> 1. Details of RESOURCE and PROGRAM declarations are not shown; see 2.7 and 2.7.1. 2. The notation "X @ Y" indicates that program organization unit X is scheduled or executing at priority Y. 3. The execution times of P2.FB1 and P2.FB2 are not included in the execution time of P2. 4. The execution time of P4.FB1 is not included in the execution time of P4. 			

LIST OF TABLES (continued)

Table

Page

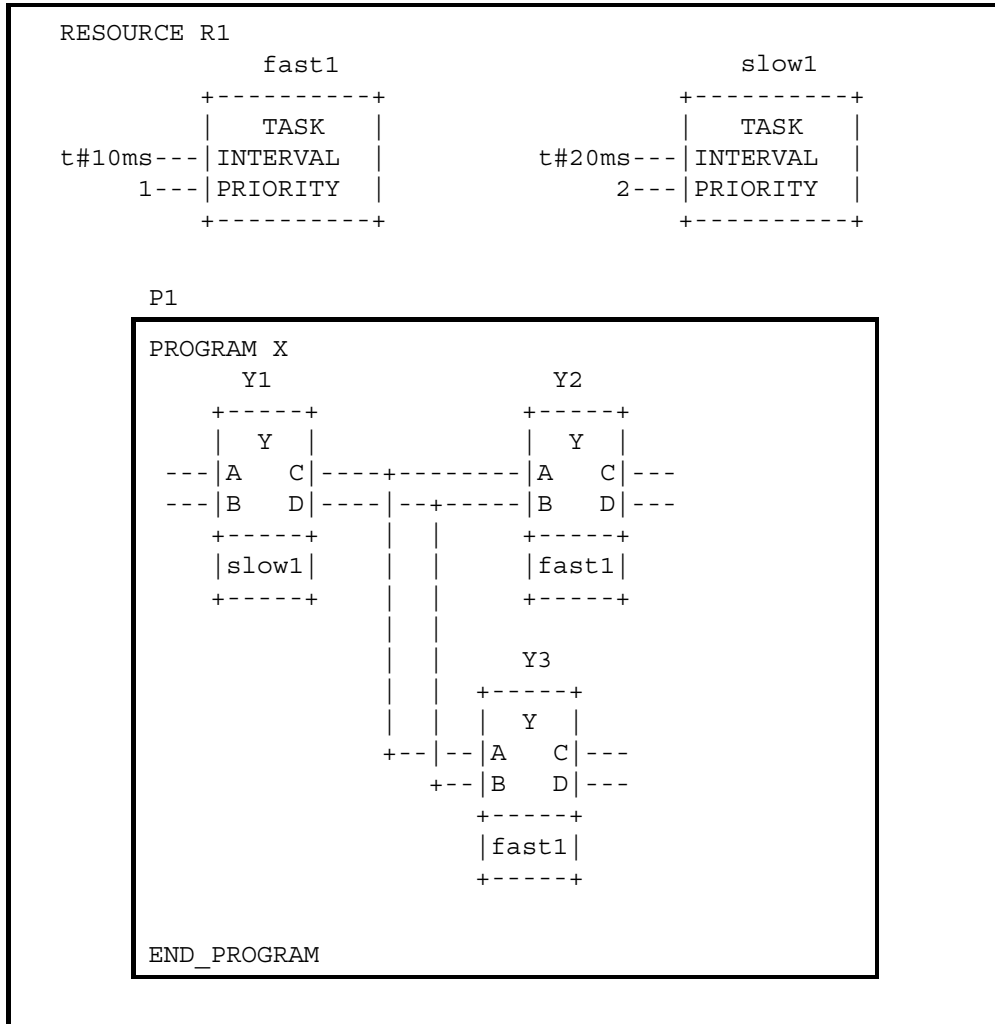


Figure 21a - Synchronization of function blocks with explicit task associations

LIST OF TABLES (continued)

Table

Page

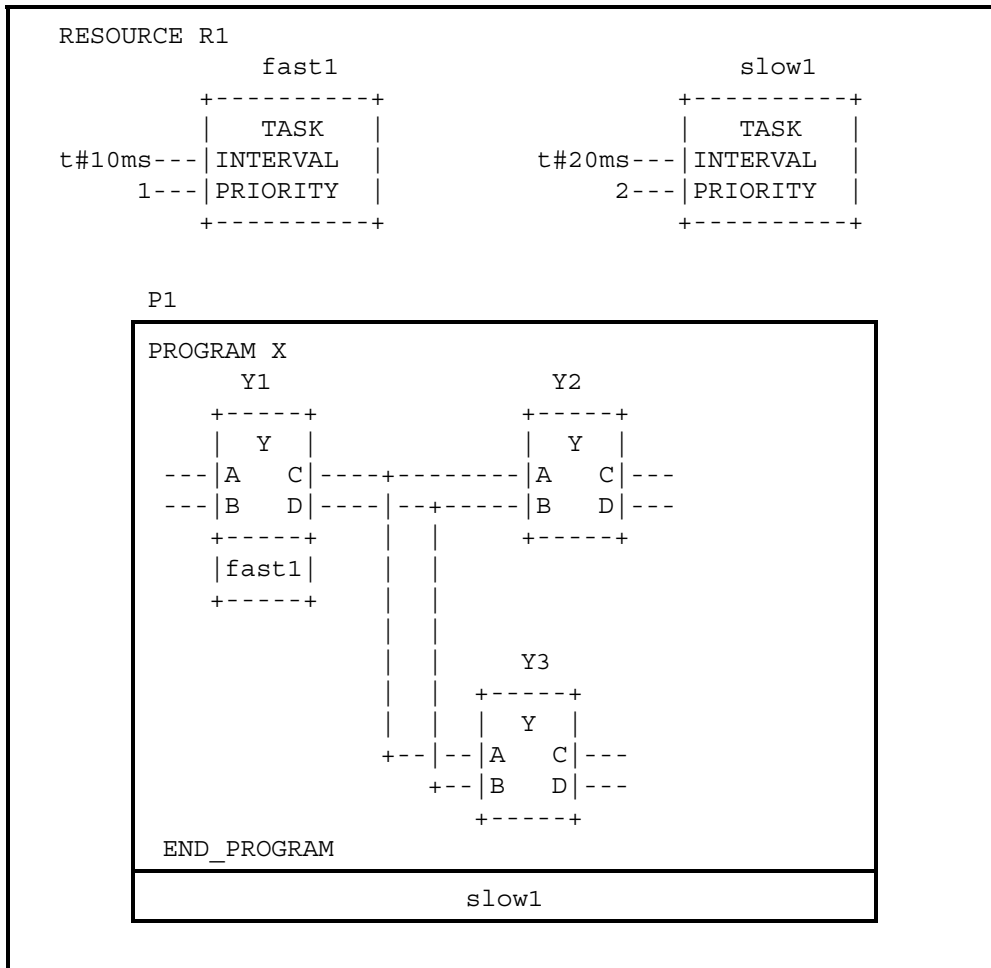


Figure 21b - Synchronization of function blocks with implicit task associations

LIST OF TABLES (continued)

Table

Page

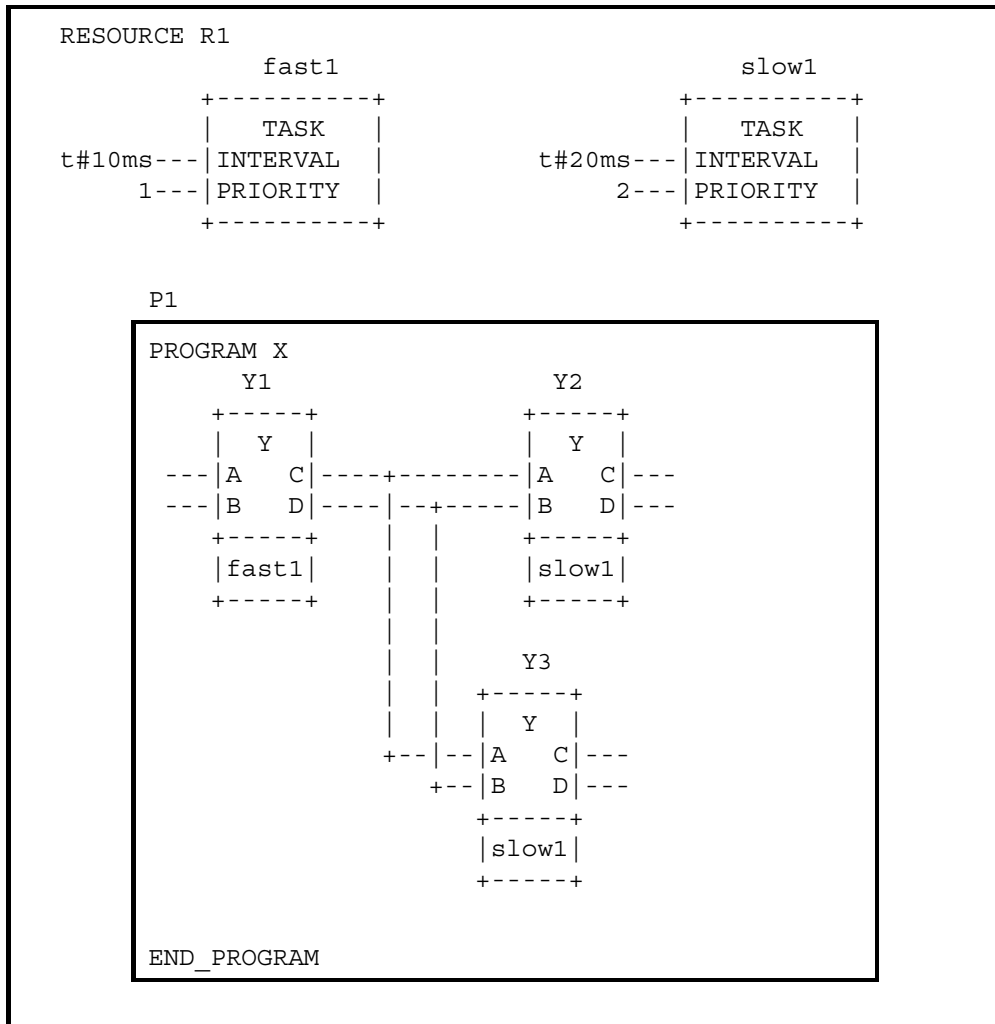


Figure 21c - Explicit task associations equivalent to figure 21b

LIST OF TABLES (continued)

Table	Page
-------	------

3. Textual languages

The textual languages defined in this standard are IL (Instruction List) and ST (Structured Text). The sequential function chart (SFC) elements defined in 2.6 can be used in conjunction with either of these languages.

3.1 Common elements

The textual elements specified in clause 2 shall be common to the textual languages (IL and ST) defined in this clause. In particular, the following program structuring elements shall be common to textual languages:

TYPE...END_TYPE	(2.3.3)
VAR...END_VAR	(2.4.3)
VAR_INPUT...END_VAR	(2.4.3)
VAR_OUTPUT...END_VAR	(2.4.3)
VAR_IN_OUT...END_VAR	(2.4.3)
VAR_EXTERNAL...END_VAR	(2.4.3)
FUNCTION ... END_FUNCTION	(2.5.1.3)
FUNCTION_BLOCK...END_FUNCTION_BLOCK	(2.5.2.2)
PROGRAM...END_PROGRAM	(2.5.3)
STEP...END_STEP	(2.6.2)
TRANSITION...END_TRANSITION	(2.6.3)
ACTION...END_ACTION	(2.6.4)

LIST OF TABLES (continued)

Table

Page

3.2 Language IL (Instruction List)

This subclause defines the semantics of the IL (Instruction List) language whose formal syntax is given in B.2.

3.2.1 Instructions

As illustrated in table 51, an *instruction list* is composed of a sequence of *instructions*. Each instruction shall begin on a new line and shall contain an operator with optional *modifiers*, and, if necessary for the particular operation, one or more *operands* separated by commas. Operands can be any of the data representations defined in 2.2 for literals and 2.4 for variables.

The instruction can be preceded by an identifying *label* followed by a colon (:). A *comment*, as defined in 2.1.5, if present, shall be the last element on a line. Empty lines can be inserted between instructions.

Table 51 - Examples of instruction fields

Label	Operator	Operand	Comment
START :	LD	%IX1	(* PUSH BUTTON *)
	ANDN	%MX5	(* NOT INHIBITED *)
	ST	%QX2	(* FAN ON *)

3.2.2 Operators, modifiers and operands

Standard operators with their allowed modifiers and operands shall be as listed in table 52. The typing of operators shall conform to the conventions of 2.5.1.4.

Unless otherwise defined in table 52, the semantics of the operators shall be

$$\text{result} := \text{result OP operand}$$

That is, the value of the expression being evaluated is replaced by its current value operated upon by the operator with respect to the operand. For instance, the instruction AND %IX1 is interpreted as

$$\text{result} := \text{result AND \%IX1}$$

The comparison operators shall be interpreted with the current result to the left of the comparison and the operand to the right, with a Boolean result. For instance, the instruction "GT %IW10" will have the Boolean result 1 if the current result is greater than the value of Input Word 10, and the Boolean result 0 otherwise.

The modifier "N" indicates Boolean negation of the operand. For instance, the instruction ANDN %IX2 is interpreted as

$$\text{result} := \text{result AND NOT \%IX2}$$

LIST OF TABLES (continued)

Table

Page

The left parenthesis modifier "(" indicates that evaluation of the operator shall be deferred until a right parenthesis operator ")" is encountered, e.g., the sequence of instructions

```

AND(    %IX1
OR      %IX2
)

```

shall be interpreted as

```
result := result AND (%IX1 OR %IX2)
```

The modifier "C" indicates that the associated instruction shall be performed only if the value of the currently evaluated result is Boolean 1 (or Boolean 0 if the operator is combined with the "N" modifier).

Table 52 - Instruction List (IL) operators

No.	Operator	Modifiers	Operand	Semantics
1	LD	N	Note 2	Set current result equal to operand
2	ST	N	Note 2	Store current result to operand location
3	S	Note 3	BOOL	Set Boolean operand to 1
	R	Note 3	BOOL	Reset Boolean operand to 0
4	AND	N, (BOOL	Boolean AND
5	&	N, (BOOL	Boolean AND
6	OR	N, (BOOL	Boolean OR
7	XOR	N, (BOOL	Boolean Exclusive OR
8	ADD	(Note 2	Addition
9	SUB	(Note 2	Subtraction
10	MUL	(Note 2	Multiplication
11	DIV	(Note 2	Division
12	GT	(Note 2	Comparison: >
13	GE	(Note 2	Comparison: >=
14	EQ	(Note 2	Comparison: =
15	NE	(Note 2	Comparison: <>
16	LE	(Note 2	Comparison: <=
17	LT	(Note 2	Comparison: <
18	JMP	C, N	LABEL	Jump to label
19	CAL	C, N	NAME	Call function block (note 4)
20	RET	C, N		Return from called function or function block
21)			Evaluate deferred operation

NOTES

- 1 - See 3.2.2 for explanation of modifiers and evaluation of expressions.
- 2 - These operators shall be either overloaded or typed as defined in 2.5.1.4. The current result and the operand shall be of the same type.
- 3 - These operations are performed if and only if the value of the current result is Boolean 1.
- 4 - The function block name is followed by a parenthesized argument list as defined in 3.2.3.
- 5 - When a JMP instruction is contained in an ACTION... END_ACTION construct, the operand shall be a label within the same construct.

LIST OF TABLES (continued)

Table

Page

3.2.3 Functions and function blocks

Functions as defined in 2.5.1 shall be invoked by placing the function name in the operator field. The current result shall be used as the first argument of the function. Additional arguments, if required, shall be given in the operand field. The value returned by a function upon the successful execution of a RET instruction or upon reaching the physical end of the function shall become the "current result" described in 3.2.2.

Function blocks as defined in 2.5.2 can be invoked conditionally and unconditionally via the CAL (Call) operator listed in table 52. As shown in table 53, this invocation can take one of three forms. The input operators shown in table 54 can be used in conjunction with feature 3 of table 53.

Table 53 - Function block invocation features for IL language

No.	Description/Example
1	CAL with input list: CAL C10 (CU:=%IX10, PV:=15)
2	CAL with load/store of inputs: LD 15 ST C10.PV LD %IX10 ST C10.CU CAL C10
3	Use of input operators: LD 15 PV C10 LD %IX10 CU C10
NOTE - A declaration such as VAR C10: CTU ; END_VAR is assumed in the above examples.	

Table 54 - Standard function block input operators for IL language

No.	Operators	FB Type	Reference
4	S1,R	SR	2.5.2.3.1
5	S,R1	RS	2.5.2.3.1
6	CLK	R_TRIG	2.5.2.3.2
7	CLK	F_TRIG	2.5.2.3.2
8	CU,R,PV	CTU	2.5.2.3.3
9	CD,LD,PV	CTD	2.5.2.3.3
10	CU,CD,R,LD,PV	CTUD	2.5.2.3.3
11	IN,PT	TP	2.5.2.3.4
12	IN,PT	TON	2.5.2.3.4
13	IN,PT	TOF	2.5.2.3.4

LIST OF TABLES (continued)

Table	Page
-------	------

3.3 Language ST (Structured Text)

This subclause defines the semantics of the ST (Structured Text) language whose syntax is defined in B.3. In this language, the end of a textual line shall be treated the same as a space (SP) character, as defined in 2.1.4.

3.3.1 Expressions

An *expression* is a construct which, when evaluated, yields a value corresponding to one of the data types defined in 2.3.1 and 2.3.3.

Expressions are composed of operators and operands. An *operand* shall be a literal as defined in 2.2, a variable as defined in 2.4, a function invocation as defined in 2.5.1, or another expression.

The *operators* of the ST language are summarized in table 55. The evaluation of an expression consists of applying the operators to the operands in a sequence defined by the operator precedence shown in table 55. The operator with highest precedence in an expression shall be applied first, followed by the operator of next lower precedence, etc., until evaluation is complete. Operators of equal precedence shall be applied as written in the expression from left to right. For example, if A, B, C, and D are of type INT with values 1, 2, 3, and 4, respectively, then

$$A+B-C*ABS(D)$$

shall evaluate to -9, and

$$(A+B-C)*ABS(D)$$

shall evaluate to 0 .

When an operator has two operands, the leftmost operand shall be evaluated first. For example, in the expression

$$SIN(A)*COS(B)$$

the expression SIN(A) shall be evaluated first, followed by COS(B), followed by evaluation of the product.

Boolean expressions may be evaluated only to the extent necessary to determine the resultant value. For instance, if $A \leq B$, then only the expression $(A > B)$ would be evaluated to determine that the value of the expression

$$(A > B) \& (C < D)$$

is Boolean zero.

Functions shall be invoked as elements of expressions consisting of the function name followed by a parenthesized list of arguments, as defined in 2.5.1.1.

When an operator in an expression can be represented as one of the overloaded functions defined in 2.5.1.5, conversion of operands and results shall follow the rule and examples given in 2.5.1.4.

LIST OF TABLES (continued)

Table

Page

TABLE 55 - Operators of the ST language

No.	Operation	Symbol	Precedence
1	Parenthesization	(expression)	HIGHEST
2	Function evaluation Examples:	identifier(argument list) LN(A), MAX(X,Y), etc.	
3	Exponentiation (Note 2)	**	
4	Negation	-	
5	Complement	NOT	
6	Multiply	*	
7	Divide	/	
8	Modulo	MOD	
9	Add	+	
10	Subtract	-	
11	Comparison	< , > , <= , >=	
12	Equality	=	
13	Inequality	<>	
14	Boolean AND	&	
15	Boolean AND	AND	
16	Boolean Exclusive OR	XOR	
17	Boolean OR	OR	LOWEST
<p>NOTES</p> <p>1 - The same restrictions apply to the operands of these operators as to the inputs of the corresponding functions defined in 2.5.1.5.</p> <p>2 - The result of evaluating the expression A**B shall be the same as the result of evaluating the function EXPT(A,B) as defined in table 24.</p>			

LIST OF TABLES (continued)

Table

Page

3.3.2 Statements

The statements of the ST language are summarized in table 56. Statements shall be terminated by semicolons as specified in the syntax of B.3.

Table 56 - ST language statements

No.	Statement type/Reference	Examples
1	Assignment (3.3.2.1)	A := B; CV := CV+1; C := SIN(X);
2	Function block Invocation and FB output usage (3.3.2.2)	CMD_TMR(IN:=%IX5, PT:=T#300ms) ; A := CMD_TMR.Q ;
3	RETURN (3.3.2.2)	RETURN ;
4	IF (3.3.2.3)	D := B*B - 4*A*C ; IF D < 0.0 THEN NROOTS := 0 ; ELSIF D = 0.0 THEN NROOTS := 1 ; X1 := - B/(2.0*A) ; ELSE NROOTS := 2 ; X1 := (- B + SQRT(D))/(2.0*A) ; X2 := (- B - SQRT(D))/(2.0*A) ; END_IF ;
5	CASE (3.3.2.3)	TW := BCD_TO_INT(THUMBWHEEL); TW_ERROR := 0; CASE TW OF 1,5: DISPLAY := OVEN_TEMP; 2: DISPLAY := MOTOR_SPEED; 3: DISPLAY := GROSS - TARE; 4,6..10: DISPLAY := STATUS(TW - 4); ELSE DISPLAY := 0 ; TW_ERROR := 1; END_CASE; QW100 := INT_TO_BCD(DISPLAY);
6	FOR (3.3.2.4)	J := 101 ; FOR I := 1 TO 100 BY 2 DO IF WORDS[I] = 'KEY' THEN J := I ; EXIT ; END_IF ; END_FOR ;
7	WHILE (3.3.2.4)	J := 1; WHILE J <= 100 & WORDS[J] <> 'KEY' DO J := J+2 ; END_WHILE ;

(continued on following page)

LIST OF TABLES (continued)

Table

Page

Table 56 - ST language statements (continued)

No.	Statement type/Reference	Examples
8	REPEAT (3.3.2.4)	<pre>J := -1 ; REPEAT J := J+2 ; UNTIL J = 101 OR WORDS[J] = 'KEY' END_REPEAT ;</pre>
9	EXIT (3.3.2.4)	EXIT ;
10	Empty Statement	;
NOTE - If the EXIT statement (9) is supported, then it shall be supported for all of the iteration statements (FOR, WHILE, REPEAT) which are supported in the implementation.		

3.3.2.1 Assignment statements

The assignment statement replaces the current value of a single or multi-element variable by the result of evaluating an expression. An assignment statement shall consist of a variable reference on the left-hand side, followed by the *assignment operator* ":", followed by the expression to be evaluated. For instance, the statement

A := B ;

would be used to replace the single data value of variable A by the current value of variable B if both were of type INT. However, if both A and B were of type ANALOG_CHANNEL_CONFIGURATION as described in table 12, then the values of all the elements of the structured variable A would be replaced by the current values of the corresponding elements of variable B.

As illustrated in figure 6, the assignment statement shall also be used to assign the value to be returned by a function, by placing the function name to the left of an assignment operator in the body of the function declaration. The value returned by the function shall be the result of the most recent evaluation of such an assignment. It is an error to return from the evaluation of a function with the " ENO" output non-zero unless at least one such assignment has been made.

3.3.2.2 Function and function block control statements

Function and function block control statements consist of the mechanisms for invoking function blocks and for returning control to the invoking entity before the physical end of a function or function block.

Function evaluation shall be invoked as part of expression evaluation, as specified in 3.3.1.

Function blocks shall be invoked by a statement consisting of the name of the function block followed by a parenthesized list of named input parameter value assignments, as illustrated in table56. The order in which input parameters are listed in a function block invocation shall not be significant. It is not required that all input parameters be assigned values in every invocation of a function block. If a particular parameter is not assigned a value in a function block invocation, the previously assigned value (or the initial value, if no previous assignment has been made) shall apply.

The RETURN statement shall provide early exit from a function , function block or program (e.g., as the result of the evaluation of an IF statement).

LIST OF TABLES (continued)

Table Page

3.3.2.3 Selection statements

Selection statements include the IF and CASE statements. A selection statement selects one (or a group) of its component statements for execution, based on a specified condition. Examples of selection statements are given in table 56.

The IF statement specifies that a group of statements is to be executed only if the associated Boolean expression evaluates to the value 1 (true). If the condition is false, then either no statement is to be executed, or the statement group following the ELSE keyword (or the ELSIF keyword if its associated Boolean condition is true) is to be executed.

The CASE statement consists of an expression which shall evaluate to a variable of type INT (the "selector"), and a list of statement groups, each group being labeled by one or more integers or ranges of integer values. It specifies that the first group of statements, one of whose ranges contains the computed value of the selector, shall be executed. If the value of the selector does not occur in a range of any case, the statement sequence following the keyword ELSE (if it occurs in the CASE statement) shall be executed. Otherwise, none of the statement sequences shall be executed.

3.3.2.4 Iteration statements

Iteration statements specify that the group of associated statements shall be executed repeatedly. The FOR statement is used if the number of iterations can be determined in advance; otherwise, the WHILE or REPEAT constructs are used.

The EXIT statement shall be used to terminate iterations before the termination condition is satisfied.

When the EXIT statement is located within nested iterative constructs, exit shall be from the innermost loop in which the EXIT is located, that is, control shall pass to the next statement after the first loop terminator (END_FOR, END_WHILE, or END_REPEAT) following the EXIT statement. For instance, after executing the statements shown in figure 22, the value of the variable SUM shall be 15 if the value of the Boolean variable FLAG is 0, and 6 if FLAG=1.

```
SUM := 0 ;
FOR I := 1 TO 3 DO
  FOR J := 1 TO 2 DO
    IF FLAG THEN EXIT ; END_IF
    SUM := SUM + J ;
  END_FOR ;
  SUM := SUM + I ;
END_FOR ;
```

Figure 22 - EXIT statement example

LIST OF TABLES (continued)

Table Page

The FOR statement indicates that a statement sequence shall be repeatedly executed, up to the END_FOR keyword, while a progression of values is assigned to the FOR loop control variable. The control variable, initial value, and final value shall be expressions of the same integer type (SINT, INT, or DINT) and shall not be altered by any of the repeated statements. The FOR statement increments the control variable up or down from an initial value to a final value in increments determined by the value of an expression; this value defaults to 1. The test for the termination condition is made at the beginning of each iteration, so that the statement sequence is not executed if the initial value exceeds the final value. The value of the control variable after completion of the FOR loop is implementation-dependent.

An example of the usage of the FOR statement is given in feature 6 of table 56. In this example, the FOR loop is used to determine the index J of the first occurrence (if any) of the string 'KEY' in the odd-numbered elements of an array of strings WORDS with a subscript range of (1..100). If no occurrence is found, J will have the value 101.

The WHILE statement causes the sequence of statements up to the END_WHILE keyword to be executed repeatedly until the associated Boolean expression is false. If the expression is initially false, then the group of statements is not executed at all. For instance, the FOR...END_FOR example given in table 56 can be rewritten using the WHILE...END_WHILE construction shown in table 56.

The REPEAT statement causes the sequence of statements up to the UNTIL keyword to be executed repeatedly (and at least once) until the associated Boolean condition is true. For instance, the WHILE...END_WHILE example given in table 56 can be rewritten using the REPEAT...END_REPEAT construction shown in table 56.

The WHILE and REPEAT statements shall not be used to achieve interprocess synchronization, for example as a "wait loop" with an externally determined termination condition. The SFC elements defined in 2.6 shall be used for this purpose.

It shall be an *error* in the sense of 1.5.1 if a WHILE or REPEAT statement is used in an algorithm for which satisfaction of the loop termination condition or execution of an EXIT statement cannot be guaranteed.

LIST OF TABLES (continued)

Table	Page
-------	------

4. Graphic languages

The graphic languages defined in this standard are LD (Ladder Diagram) and FBD (Function Block Diagram). The sequential function chart (SFC) elements defined in 2.6 can be used in conjunction with either of these languages.

4.1 Common elements

The elements defined in this clause apply to both the graphic languages in this Standard, that is, LD (Ladder Diagram) and FBD (Function Block Diagram), and to the graphic representation of sequential function chart (SFC) elements.

4.1.1 Representation of lines and blocks

The graphic language elements defined in this clause are drawn with line elements using characters from the ISO/IEC 646 character set, or using graphic or semigraphic elements, as shown in table 57.

Lines can be extended by the use of *connectors* as shown in table 57. No storage of data or association with data elements shall be associated with the use of connectors; hence, to avoid ambiguity, it shall be an *error* if the identifier used as a connector label is the same as the name of another named element within the same program organization unit.

4.1.2 Direction of flow in networks

A *network* is defined as a maximal set of interconnected graphic elements, excluding the left and right rails in the case of networks in the LD language defined in 4.2. Provision shall be made to associate with each network or group of networks in a graphic language a *network label* delimited on the right by a colon (:). This label shall have the form of an identifier or an unsigned decimal integer as defined in clause 2 of this Part. The *scope* of a network and its label shall be *local* to the program organization unit in which the network is located. Examples of networks and network labels are shown in annex F.

Graphic languages are used to represent the flow of a conceptual quantity through one or more networks representing a control plan, that is:

- "Power flow", analogous to the flow of electric power in an electromechanical relay system, typically used in relay ladder diagrams;
- "Signal flow", analogous to the flow of signals between elements of a signal processing system, typically used in function block diagrams;
- "Activity flow", analogous to the flow of control between elements of an organization, or between the steps of an electromechanical sequencer, typically used in sequential function charts.

The appropriate conceptual quantity shall flow along lines between elements of a network according to the following rules:

- 1) Power flow in the LD language shall be from left to right.
- 2) Signal flow in the FBD language shall be from the output (right-hand) side of a function or function block to the input (left-hand) side of the function or function block(s) so connected.
- 3) Activity flow between the SFC elements defined in 2.6 shall be from the bottom of a step through the appropriate transition to the top of the corresponding successor step(s).

LIST OF TABLES (continued)

Table	Page
-------	------

4.1.3 Evaluation of networks

The order in which networks and their elements are evaluated is not necessarily the same as the order in which they are labeled or displayed. Similarly, it is not necessary that all networks be evaluated before the evaluation of a given network can be repeated. However, when the body of a program organization unit consists of one or more networks, the results of network evaluation within said body shall be functionally equivalent to the observance of the following rules:

- 1) No element of a network shall be evaluated until the states of all of its inputs have been evaluated.
- 2) The evaluation of a network element shall not be complete until the states of all of its outputs have been evaluated.
- 3) The evaluation of a network is not complete until the outputs of all of its elements have been evaluated, even if the network contains one of the execution control elements defined in 4.1.4.
- (4) The order in which networks are evaluated shall conform to the provisions of 4.2.6 for the LD language and 4.3.3 for the FBD language.

A *feedback path* is said to exist in a network when the output of a function or function block is used as the input to a function or function block which precedes it in the network; the associated variable is called a *feedback variable*. For instance, the Boolean variable RUN is the feedback variable in the example shown in figure 23. A feedback variable can also be an output element of a function block data structure as defined in 2.5.2.

Feedback paths can be utilized in the graphic languages defined in 4.2 and 4.3, subject to the following rules:

- 1) Explicit loops such as the one shown in 23a shall only appear in the FBD language defined in 4.3.
- 2) It shall be possible for the user to define the order of execution of the elements in an explicit loop, for instance by selection of feedback variables to form an implicit loop as shown in figure 23b.
- 3) Feedback variables shall be initialized by one of the mechanisms defined in clause 2. The initial value shall be used during the first evaluation of the network.
- 4) Once the element with a feedback variable as output has been evaluated, the new value of the feedback variable shall be used until the next evaluation of the element.

LIST OF TABLES (continued)

Table

Page

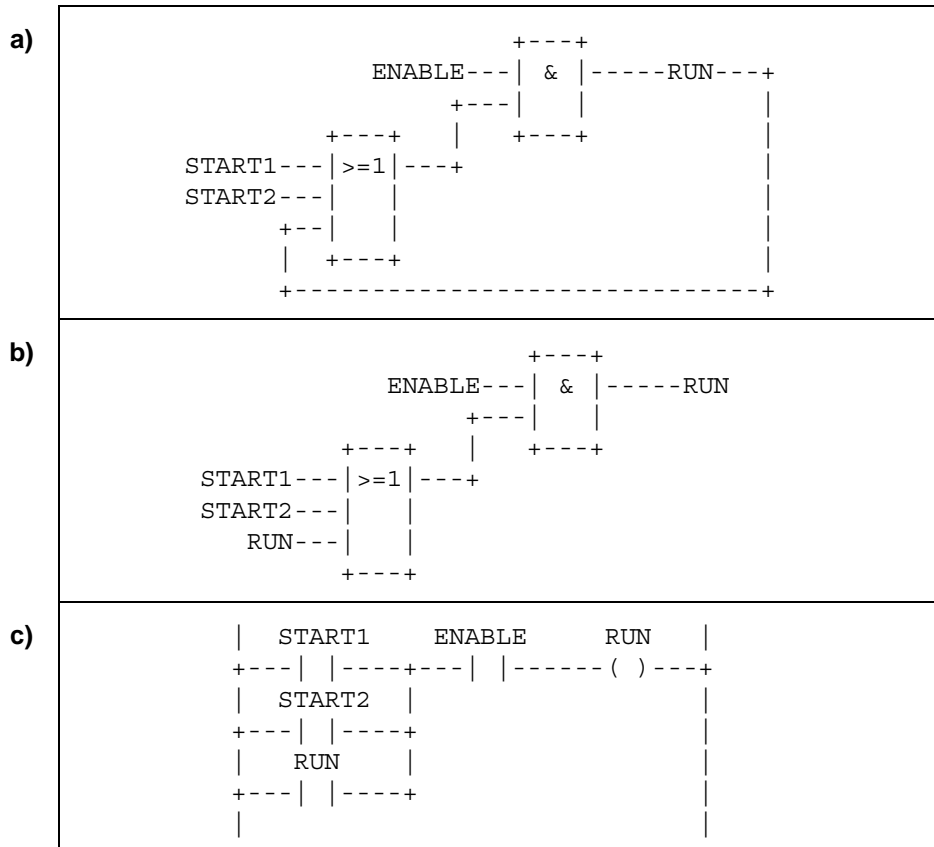


Figure 23 - Feedback path example

a) Explicit loop

b) Implicit loop

c) LD language equivalent

LIST OF TABLES (continued)

Table	Page
-------	------

4.1.4 Execution control elements

Transfer of program control in the LD and FBD languages shall be represented by the graphical elements shown in table 58.

Jumps shall be shown by a Boolean signal line terminated in a double arrowhead. The signal line for a jump condition shall originate at a Boolean variable, at a Boolean output of a function or function block, or on the power flow line of a ladder diagram. A transfer of program control to the designated network label shall occur when the Boolean value of the signal line is 1 (TRUE); thus, the unconditional jump is a special case of the conditional jump.

The target of a jump shall be a network label within the program organization unit within which the jump occurs. If the jump occurs within an ACTION...END_ACTION construct, the target of the jump shall be within the same construct.

Conditional returns from functions and function blocks shall be implemented using a RETURN construction as shown in table 58. Program execution shall be transferred back to the invoking entity when the Boolean input is 1 (TRUE), and shall continue in the normal fashion when the Boolean input is 0 (FALSE). Unconditional returns shall be provided by the physical end of the function or function block, or by a RETURN element connected to the left rail in the LD language, as shown in table 58.

LIST OF TABLES (continued)

Table

Page

Table 58 - Graphic execution control elements

No.	Symbol/Example	Explanation
1	<pre> 1----->>LABELA </pre>	<p>Unconditional Jump: FBD Language</p>
2	<pre> +----->>LABELA </pre>	<p>LD Language</p>
3	<pre> X----->>LABELB +----+ %IX20--- & ---->>NEXT %MX50--- +----+ NEXT: +----+ %IX25--- >=1 ---%QX100 %MX60--- +----+ </pre>	<p>Conditional Jump (FBD Language)</p> <p>Example: Jump Condition</p> <p>Jump Target</p>
4	<pre> X +- ----->>LABELB %IX20 %MX50 +--- ----- ---->>NEXT NEXT: %IX25 %QX100 +----- -----+----- () ----+ %MX60 +----- -----+ </pre>	<p>Conditional Jump (LD Language)</p> <p>Example: Jump Condition</p> <p>Jump Target</p>
5	<pre> X +--- ----<RETURN> </pre>	<p>Conditional Return: LD Language</p>
6	<pre> X---<RETURN> </pre>	<p>FBD Language</p>
7	<pre> END_FUNCTION END_FUNCTION_BLOCK </pre>	<p>Unconditional Return: from FUNCTION from FUNCTION_BLOCK</p>
8	<pre> +---<RETURN> </pre>	<p>Alternative representation in LD language</p>

LIST OF TABLES (continued)

Table

Page

4.2 Language LD (Ladder Diagram)

This subclause defines the LD language for ladder diagram programming of programmable controllers.

A LD program enables the programmable controller to test and modify data by means of standardized graphic symbols. These symbols are laid out in networks in a manner similar to a "rung" of a relay ladder logic diagram. LD networks are bounded on the left and right by *power rails*.

4.2.1 Power rails

As shown in table 59, LD network shall be delimited on the left by a vertical line known as the *left power rail*, and on the right by a vertical line known as the *right power rail*. The right power rail may be explicit or implied.

Table 59 - Power rails

No.	Symbol	Description
1	<pre> +--- </pre>	<p>Left power rail (with attached horizontal link)</p>
2	<pre> ---+ </pre>	<p>Right power rail (with attached horizontal link)</p>

4.2.2 Link elements and states

As shown in table 60, link elements may be horizontal or vertical. The state of the link element shall be denoted "ON" or "OFF", corresponding to the literal Boolean values 1 or 0, respectively. The term *link state* shall be synonymous with the term *power flow*.

The state of the left rail shall be considered ON at all times.. No state is defined for the right rail.

A horizontal link element shall be indicated by a horizontal line. A horizontal link element transmits the state of the element on its immediate left to the element on its immediate right.

The vertical link element shall consist of a vertical line intersecting with one or more horizontal link elements on each side. The state of the vertical link shall represent the inclusive OR of the ON states of the horizontal links on its left side, that is, the state of the vertical link shall be:

- OFF if the states of all the attached horizontal links to its left are OFF;
- ON if the state of one or more of the attached horizontal links to its left is ON.

The state of the vertical link shall be copied to all of the attached horizontal links on its right. The state of the vertical link shall not be copied to any of the attached horizontal links on its left.

LIST OF TABLES (continued)

Table

Page

Table 60 - Link elements

No.	Symbol	Description
1	-----	Horizontal link
2	<pre> -----+----- -----+ +----- </pre>	<p>Vertical link (with attached horizontal links)</p>

4.2.3 Contacts

A *contact* is an element which imparts a state to the horizontal link on its right side which is equal to the Boolean AND of the state of the horizontal link at its left side with an appropriate function of an associated Boolean input, output, or memory variable. A contact does not modify the value of the associated Boolean variable. Standard contact symbols are given in table 61.

4.2.4 Coils

A *coil* copies the state of the link on its left to the link on its right without modification, and stores an appropriate function of the state or transition of the left link into the associated Boolean variable. Standard coil symbols are given in table 62.

4.2.5 Functions and function blocks

The representation of functions and function blocks in the LD language shall be as defined in clause 2 of this Part, with the following exceptions:

- 1) Actual parameter connections may optionally be shown by writing the appropriate data or variable outside the block adjacent to the formal parameter name on the inside.
- 2) At least one Boolean input and one Boolean output shall be shown on each block to allow for power flow through the block.

4.2.6 Order of network evaluation

Within a program organization unit written in LD, networks shall be evaluated in top to bottom order as they appear in the ladder diagram, except as this order is modified by the execution control elements defined in 4.1.4.

LIST OF TABLES (continued)

Table

Page

Table 61 - Contacts

Static contacts		
No.	Symbol	Description
1	*** -- --	Normally open contact The state of the left link is copied to the right link if the state of the associated Boolean variable (indicated by "****") is ON. Otherwise, the state of the right link is OFF.
2	or *** -- ! ! --	
3	*** -- / --	Normally closed contact The state of the left link is copied to the right link if the state of the associated Boolean variable is OFF. Otherwise, the state of the right link is OFF.
4	or *** -- ! / ! --	
Transition-sensing contacts		
5	*** -- P --	Positive transition-sensing contact The state of the right link is ON from one evaluation of this element to the next when a transition of the associated variable from OFF to ON is sensed at the same time that the state of the left link is ON. The state of the right link shall be OFF at all other times.
6	or *** -- ! P ! --	
7	*** -- N --	Negative transition-sensing contact The state of the right link is ON from one evaluation of this element to the next when a transition of the associated variable from ON to OFF is sensed at the same time that the state of the left link is ON. The state of the right link shall be OFF at all other times.
8	or *** -- ! N ! --	
NOTE: As specified in 2.1.1, the exclamation mark "!" shall be used when a national character set does not support the vertical bar " ".		

LIST OF TABLES (continued)

Table

Page

Table 62 - Coils

Momentary coils		
No.	Symbol	Description
1	*** -- () --	Coil The state of the left link is copied to the associated Boolean variable and to the right link.
2	*** -- (/) --	Negated coil The state of the left link is copied to the right link. The inverse of the state of the left link is copied to the associated Boolean variable, that is, if the state of the left link is OFF, then the state of the associated variable is ON, and vice versa.
Latched Coils		
3	*** -- (S) --	SET (latch) coil The associated Boolean variable is set to the ON state when the left link is in the ON state, and remains set until reset by a RESET coil.
4	*** -- (R) --	RESET (unlatch) coil The associated Boolean variable is reset to the OFF state when the left link is in the ON state, and remains reset until set by a SET coil.
Retentive coils (see Note)		
5	*** ---- (M) ----	Retentive (Memory) coil
6	*** ---- (SM) ----	SET retentive (Memory) coil
7	*** ---- (RM) ----	RESET retentive (Memory) coil
Transition-sensing coils		
8	*** -- (P) --	Positive transition-sensing coil The state of the associated Boolean variable is ON from one evaluation of this element to the next when a transition of the left link from OFF to ON is sensed. The state of the left link is always copied to the right link.
9	*** -- (N) --	Negative transition-sensing coil The state of the associated Boolean variable is ON from one evaluation of this element to the next when a transition of the left link from ON to OFF is sensed. The state of the left link is always copied to the right link.
<p>NOTE - The action of coils 5, 6, and 7 is identical to that of coils 1, 3, and 4, respectively, except that the associated Boolean variable is automatically declared to be in retentive memory without the explicit use of the VAR RETAIN declaration defined in 2.4.2.</p>		

LIST OF TABLES (continued)

Table Page

4.3 Language FBD (Function Block Diagram)

4.3.1 General

This subclause defines FBD, a graphic language for the programming of programmable controllers which is consistent, as far as possible, with IEC 617-12. Where conflicts exist between this standard and IEC 617, the provisions of this standard shall apply for the programming of programmable controllers in the FBD language.

The provisions of clauses 2 and 4.1 shall apply to the construction and interpretation of programmable controller programs in the FBD language.

Examples of the use of the FBD language are given in annex F.

4.3.2 Combination of elements

Elements of the FBD language shall be interconnected by signal flow lines following the conventions of 4.1.2.

Outputs of function blocks shall not be connected together. In particular, the "wired-OR" construct of the LD language is not allowed in the FBD language; an explicit Boolean "OR" block is required instead, as shown in figure 24.




Figure 24 - Boolean OR Examples
a) "Wired-OR" in LD language
b) Function in FBD language

4.3.3 Order of network evaluation

Within a program organization unit written in the FBD language, the order of network evaluation shall follow the rule that the evaluation of a network shall be complete before starting the evaluation of another network which uses one or more of the outputs of the preceding evaluated network.

ANNEX A - Specification method for textual languages (normative)

Programming languages are specified in terms of a *syntax*, which specifies the allowable combinations of symbols which can be used to define a program; and a set of *semantics*, which specify the relationship between programmed operations and the symbol combinations defined by the syntax.

A.1 Syntax

A syntax is defined by a set of *terminal symbols* to be utilized for program specification; a set of *non-terminal symbols* defined in terms of the terminal symbols; and a set of *production rules* specifying those definitions.

A.1.1 Terminal symbols

The terminal symbols for textual programmable controller programs shall consist of combinations of the characters in the ISO/IEC 646 character set. For interchange of programs between systems, these characters shall be represented by the seven-bit character codes defined in ISO 646.

For the purposes of this part, terminal textual symbols consist of the appropriate character string enclosed in paired single or double quotes. For example, a terminal symbol represented by the character string ABC can be represented by either

"ABC"

or

'ABC'

This allows the representation of strings containing either single or double quotes; for instance, a terminal symbol consisting of the double quote itself would be represented by "".

A special terminal symbol utilized in this syntax is the end-of-line delimiter, which is represented by the unquoted character string EOL. This symbol shall normally consist of the FE5 (CR = carriage return) character defined by ISO/IEC 646. Language implementors shall specify any deviation from this usage; in any case, no characters other than those in ISO/IEC 646 are allowed.

A second special terminal symbol utilized in this syntax is the "null string", that is, a string containing no characters. This is represented by the terminal symbol NIL.

A.1.2 Non-terminal symbols

Non-terminal textual symbols shall be represented by strings of lower-case letters, numbers, and the underline character (), beginning with a lower-case letter. For instance, the strings

nonterm1

and

non_term_2

are valid non-terminal symbols, while the strings

3nonterm

and

 nonterm4

are not.

ANNEX G - Index (continued)

A.1.3 Production rules

The production rules for textual programmable controller programming languages shall form an *extended grammar* in which each rule has the form

$$\text{non_terminal_symbol} ::= \text{extended_structure}$$

This rule can be read as:

"A non_terminal_symbol can consist of an extended_structure."

Extended structures can be constructed according to the following rules:

- 1) The null string, NIL, is an extended structure.
- 2) A terminal symbol is an extended structure.
- 3) A non-terminal symbol is an extended structure.
- 4) If S is an extended structure, then the following expressions are also extended structures:
 - (S), meaning S itself.
 - {S}, *closure*, meaning zero or more concatenations of S.
 - [S], *option*, meaning zero or one occurrence of S.
- 5) If S1 and S2 are extended structures, then the following expressions are extended structures:
 - S1|S2, *alternation*, meaning a choice of S1 or S2.
 - S1 S2, *concatenation*, meaning S1 followed by S2.
- 6) Concatenation *precedes* alternation, that is, S1 | S2 S3 is equivalent to S1 | (S2 S3), and S1 S2 | S3 is equivalent to (S1 S2) | S3.

A.2 Semantics

Programmable controller textual programming language semantics are defined in this Part by appropriate natural language text, accompanying the production rules, which references the descriptions provided in the appropriate clauses. Standard options available to the user and manufacturer are specified in these semantics.

In some cases it is more convenient to embed semantic information in an extended structure. In such cases, this information is delimited by paired angle brackets, for example, <semantic information>.

ANNEX G - Index (continued)

ANNEX B - Formal specifications of language elements (normative)

B.0 Programming model

The contents of this annex are normative in the sense that a compiler which is capable of recognizing all the syntax in this annex shall be capable of recognizing the syntax of any textual language implementation complying with this standard.

PRODUCTION RULES:

```
library_element_name ::= data_type_name | function_name
                       | function_block_type_name | program_type_name
                       | resource_type_name | configuration_name
```

```
library_element_declaration ::= data_type_declaration
                              | function_declaration | function_block_declaration
                              | program_declaration | configuration_declaration
```

SEMANTICS: These productions reflect the basic programming model defined in 1.4.3, where *declarations* are the basic mechanism for the production of named *library elements*. The syntax and semantics of the non-terminal symbols given above are defined in the subclauses listed below.

Non-terminal symbol	Syntax	Semantics
data_type_name data_type_declaration	B.1.3	2.3
function_name function_declaration	B.1.5.1	2.5.1
function_block_type_name function_block_declaration	B.1.5.2	2.5.2
program_type_name program_declaration	B.1.5.3	2.5.3
resource_type_name configuration_name configuration_declaration	B.1.7	2.7

ANNEX G - Index (continued)

B.1 Common elements

B.1.1 Letters, digits and identifiers

PRODUCTION RULES:

letter ::= 'A' | 'B' | <...> | 'Z' | 'a' | 'b' | <...> | 'z'
digit ::= '0' | '1' | '2' | '3' | '4' | '5' | '6' | '7' | '8' | '9'
octal_digit ::= '0' | '1' | '2' | '3' | '4' | '5' | '6' | '7'
hex_digit ::= digit | 'A' | 'B' | 'C' | 'D' | 'E' | 'F' | 'a' | 'b' | 'c' | 'd' | 'e' | 'f'
identifier ::= (letter | ('_' (letter | digit))) {'_' (letter | digit)}

SEMANTICS:

The ellipsis <...> here indicates the ISO/IEC 646 sequence of 26 letters.

Characters from national character sets can be used; however, international portability of the printed representation of programs cannot be guaranteed in this case.

The case of letters shall be significant in terminal symbols, but not in other syntactic elements.

B.1.2 Constants

PRODUCTION RULE:

constant ::= numeric_literal | character_string | time_literal

SEMANTICS:

The external representations of data described in 2.2 are designated as "constants" in this annex.

B.1.2.1 Numeric literals

PRODUCTION RULES:

numeric_literal ::= integer_literal | real_literal | 'TRUE' | 'FALSE'
integer_literal ::= signed_integer | binary_integer | octal_integer | hex_integer
signed_integer ::= ['+' '-'] integer
integer ::= digit {'_' digit}
binary_integer ::= '2#' bit {'_' bit}
bit ::= '1' | '0'
octal_integer ::= '8#' octal_digit {'_' octal_digit}
hex_integer ::= '16#' hex_digit {'_' hex_digit}
real_literal ::= signed_integer '.' integer [exponent]
exponent ::= ('E' | 'e') ['+' '-'] integer

SEMANTICS: See 2.2.1.

ANNEX G - Index (continued)**B.1.2.2 Character strings**

PRODUCTION RULES:

character_string ::= " " {character_representation} " "

character_representation ::= <any printable character except '\$'> | '\$' hex_digit hex_digit | '\$\$'
| "\$" | '\$L' | '\$N' | '\$P' | '\$R' | '\$T' | '\$' | '\$n' | '\$p' | '\$r' | '\$t'

SEMANTICS: See 2.2.2.

B.1.2.3 Time literals

PRODUCTION RULE:

time_literal ::= duration | time_of_day | date | date_and_time

SEMANTICS: See 2.2.3.

B.1.2.3.1 Duration

PRODUCTION RULES:

duration ::= ('T' | 't' | 'TIME' | 'time') '#' ['-'] interval

interval ::= days | hours | minutes | seconds | milliseconds

days ::= fixed_point ('d' | 'D') | integer ('d' | 'D') ['_'] hours

fixed_point ::= integer ['.' integer]

hours ::= fixed_point ('h' | 'H') | integer ('h' | 'H') ['_'] minutes

minutes ::= fixed_point ('m' | 'M') | integer ('m' | 'M') ['_'] seconds

seconds ::= fixed_point ('s' | 'S') | integer ('s' | 'S') ['_'] milliseconds

milliseconds ::= fixed_point ('ms' | 'MS')

SEMANTICS: See 2.2.3.1.

NOTE - The semantics of 2.2.3.1 impose additional constraints on the allowable values of hours, minutes, seconds, and milliseconds.

B.1.2.3.2 Time of day and date

PRODUCTION RULES:

time_of_day ::= ('TIME_OF_DAY' | 'time_of_day' | 'TOD' | 'tod') '#' daytime

daytime ::= day_hour ':' day_minute ':' day_second

day_hour ::= integer

day_minute ::= integer

day_second ::= fixed_point

date ::= ('DATE' | 'date' | 'D' | 'd') '#' date_literal

ANNEX G - Index (continued)

date_literal ::= year '-' month '-' day

year ::= integer

month ::= integer

day ::= integer

date_and_time ::= ('DATE_AND_TIME' | 'date_and_time' | 'DT' | 'dt') '#' date_literal '-' daytime

SEMANTICS: See 2.2.3.2.

NOTE -The semantics of 2.2.3.2 impose additional constraints on the allowable values of day_hour, day_minute, day_second, year, month, and day.

B.1.3 Data types

PRODUCTION RULES:

data_type_name ::= non_generic_type_name | generic_type_name

non_generic_type_name ::= elementary_type_name | derived_type_name

SEMANTICS: See 2.3.

B.1.3.1 Elementary data types

PRODUCTION RULES:

elementary_type_name ::= numeric_type_name | date_type_name | bit_string_type_name
| 'STRING' | 'TIME'

numeric_type_name ::= integer_type_name | real_type_name

integer_type_name ::= signed_integer_type_name | unsigned_integer_type_name

signed_integer_type_name ::= 'SINT' | 'INT' | 'DINT' | 'LINT'

unsigned_integer_type_name ::= 'USINT' | 'UINT' | 'UDINT' | 'ULINT'

real_type_name ::= 'REAL' | 'LREAL'

date_type_name ::= 'DATE' | 'TIME_OF_DAY' | 'TOD' | 'DATE_AND_TIME' | 'DT'

bit_string_type_name ::= 'BOOL' | 'BYTE' | 'WORD' | 'DWORD' | 'LWORD'

SEMANTICS: See 2.3.1.

B.1.3.2 Generic data types

PRODUCTION RULE:

generic_type_name ::= 'ANY' | 'ANY_NUM' | 'ANY_REAL' | 'ANY_INT' | 'ANY_BIT' |
'ANY_DATE'

SEMANTICS: See 2.3.2.

B.1.3.3 Derived data types

PRODUCTION RULES:

ANNEX G - Index (continued)

derived_type_name ::= single_element_type_name | array_type_name | structure_type_name
 | string_type_name
 single_element_type_name ::= simple_type_name | subrange_type_name
 | enumerated_type_name
 simple_type_name ::= identifier
 subrange_type_name ::= identifier
 enumerated_type_name ::= identifier
 array_type_name ::= identifier
 structure_type_name ::= identifier
 data_type_declaration ::= 'TYPE' type_declaration ';' {type_declaration ';'} 'END_TYPE'
 type_declaration ::= single_element_type_declaration | array_type_declaration
 | structure_type_declaration | string_type_declaration
 single_element_type_declaration ::= simple_type_declaration | subrange_type_declaration
 | enumerated_type_declaration
 simple_type_declaration ::= simple_type_name ':' simple_spec_init
 simple_spec_init ::= simple_specification [':=' constant]
 simple_specification ::= elementary_type_name | simple_type_name
 subrange_type_declaration ::= subrange_type_name ':' subrange_spec_init
 subrange_spec_init ::= subrange_specification [':=' signed_integer]
 subrange_specification ::= integer_type_name '(' subrange ')' | subrange_type_name
 subrange ::= signed_integer '..' signed_integer
 enumerated_type_declaration ::= enumerated_type_name ':' enumerated_spec_init
 enumerated_spec_init ::= enumerated_specification [':=' enumerated_value]
 enumerated_specification ::= ('(' enumerated_value '{',' enumerated_value}')
 | enumerated_type_name
 enumerated_value ::= identifier
 array_type_declaration ::= array_type_name ':' array_spec_init
 array_spec_init ::= array_specification [':=' array_initialization]
 array_specification ::= array_type_name
 | 'ARRAY' '[' subrange '{',' subrange}'] 'OF' non_generic_type_name
 array_initialization ::= [array_initial_elements '{',' array_initial_elements}]
 array_initial_elements ::= array_initial_element | integer '(' array_initial_element)'
 array_initial_element ::= constant | enumerated_value | structure_initialization |
 array_initialization
 structure_type_declaration ::= structure_type_name ':' structure_specification
 structure_specification ::= structure_declaration | initialized_structure
 initialized_structure ::= structure_type_name [structure_initialization]
 structure_declaration ::= 'STRUCT' structure_element_declaration ';' {
 structure_element_declaration ';'} 'END_STRUCT'
 structure_element_declaration ::= structure_element_name ':'
 (simple_spec_init | subrange_spec_init | enumerated_spec_init | array_spec_init
 | initialized_structure)
 structure_element_name ::= identifier

ANNEX G - Index (continued)

structure_initialization ::= '(' structure_element_initialization '{',
structure_element_initialization}')'
structure_element_initialization ::= structure_element_name ':'=
(constant | enumerated_value | array_initialization | structure_initialization)
string_type_name ::= identifier
string_type_declaration ::= string_type_name ':' 'STRING' '[' integer ']' [':=' character_string]

SEMANTICS: See 2.3.3.

B.1.4 Variables

PRODUCTION RULES:

variable ::= direct_variable | symbolic_variable
symbolic_variable ::= variable_name | multi_element_variable
variable_name ::= identifier

SEMANTICS: See 2.4.1.

B.1.4.1 Directly represented variables

PRODUCTION RULES:

direct_variable ::= '%' location_prefix size_prefix integer {'.' integer}
location_prefix ::= 'I' | 'Q' | 'M'
size_prefix ::= NIL | 'X' | 'B' | 'W' | 'D' | 'L'

SEMANTICS: See 2.4.1.1.

B.1.4.2 Multi-element variables

PRODUCTION RULES:

multi_element_variable ::= array_variable | structured_variable
array_variable ::= subscripted_variable subscript_list
subscripted_variable ::= symbolic_variable
subscript_list ::= '[' subscript {'.' subscript} ']'
subscript ::= expression
structured_variable ::= record_variable '.' field_selector
record_variable ::= symbolic_variable
field_selector ::= identifier

SEMANTICS: See 2.4.1.2.

ANNEX G - Index (continued)**B.1.4.3 Declaration and initialization**

PRODUCTION RULES:

```

input_declarations ::= 'VAR_INPUT' input_declaration ';' {input_declaration ';' } 'END_VAR'
input_declaration ::= var_init_decl | edge_declaration
edge_declaration ::= var1_list ':' 'BOOL' ['R_EDGE' | 'F_EDGE']
var_init_decl ::= var1_init_decl | array_var_init_decl | structured_var_init_decl | fb_name_decl
                | string_var_declaration
var1_init_decl ::= var1_list ':' (simple_spec_init | subrange_spec_init | enumerated_spec_init)
var1_list ::= variable_name {',' variable_name}
array_var_init_decl ::= var1_list ':' array_spec_init
structured_var_init_decl ::= var1_list ':' initialized_structure
fb_name_decl ::= fb_name_list ':' function_block_type_name
fb_name_list ::= fb_name {',' fb_name}
fb_name ::= identifier
output_declarations ::= 'VAR_OUTPUT' ['RETAIN'] var_init_decl ';' {var_init_decl ';' }
                'END_VAR'
input_output_declarations ::= 'VAR_IN_OUT' var_declaration ';' {var_declaration ';' } 'END_VAR'
var_declaration ::= var1_declaration | array_var_declaration | structured_var_declaration
                | fb_name_decl
var1_declaration ::= var1_list ':'
                (simple_specification | subrange_specification | enumerated_specification)
array_var_declaration ::= var1_list ':' array_specification
structured_var_declaration ::= var1_list ':' structure_type_name
var_declarations ::= 'VAR' ['CONSTANT'] var_init_decl ';' {(var_init_decl ';')} 'END_VAR'
retentive_var_declarations ::= 'VAR' 'RETAIN' var_init_decl ';' {var_init_decl ';' } 'END_VAR'
located_var_declarations ::= 'VAR' ['CONSTANT' | 'RETAIN']
                located_var_decl ';' {located_var_decl ';' } 'END_VAR'
located_var_decl ::= [variable_name] location ':' located_var_spec_init
external_var_declarations ::= 'VAR_EXTERNAL' external_declaration ';' {external_declaration
                ';'}
                'END_VAR'
external_declaration ::= global_var_name ':' (simple_specification | subrange_specification
                | enumerated_specification | array_specification | structure_type_name
                | function_block_type_name)
global_var_name ::= identifier
global_var_declarations ::= 'VAR_GLOBAL' ['CONSTANT' | 'RETAIN']
                global_var_decl ';' {global_var_decl ';' } 'END_VAR'

```

ANNEX G - Index (continued)

global_var_decl ::= global_var_spec ':' [located_var_spec_init
| function_block_type_name]
global_var_spec ::= global_var_list | [global_var_name] location
located_var_spec_init ::= simple_spec_init | subrange_spec_init | enumerated_spec_init
| array_spec_init | initialized_structure
location ::= 'AT' direct_variable
global_var_list ::= global_var_name {' , ' global_var_name}
string_var_declaration ::= variable_name ':' 'STRING' '[' integer ']' [':=' character_string]

SEMANTICS: See 2.4.2. The non-terminal "function_block_type_name" is defined in B.1.5.2.

B.1.5 Program organization units

B.1.5.1 Functions

PRODUCTION RULES:

function_name ::= standard_function_name | derived_function_name
standard_function_name ::= <as defined in 2.5.1.5>
derived_function_name ::= identifier
function_declaration ::=
 'FUNCTION' derived_function_name ':' (elementary_type_name | derived_type_name)
 input_declarations
 ['VAR' ['CONSTANT']]function_var_decls 'END_VAR'
 function_body
 'END_FUNCTION'
function_var_decls ::= function_var_decl ';' {function_var_decl ';' }
function_var_decl ::= var1_declaration | array_var_declaration | structured_var_declaration
function_body ::= ladder_diagram | function_block_diagram | instruction_list | statement_list

SEMANTICS: See 2.5.1.

NOTES

- 1 This syntax does not reflect the fact that function block references and invocations are not allowed in function bodies.
- 2 Ladder diagrams and function block diagrams are graphically represented as defined in clause 4. The non-terminals *instruction_list* and *statement_list* are defined in B.2.1 and B.3.2, respectively.

B.1.5.2 Function blocks

PRODUCTION RULES:

function_block_type_name ::= standard_function_block_name | derived_function_block_name
standard_function_block_name ::= <as defined in 2.5.2.3>
derived_function_block_name ::= identifier

ANNEX G - Index (continued)

```

function_block_declaration ::=
    'FUNCTION_BLOCK' derived_function_block_name
    {fb_io_var_declarations}
    {other_var_declarations}
    function_block_body
    'END_FUNCTION_BLOCK'

fb_io_var_declarations ::= input_declarations | output_declarations | input_output_declarations

other_var_declarations ::= external_var_declarations | var_declarations
    | retentive_var_declarations

function_block_body ::= sequential_function_chart | ladder_diagram | function_block_diagram
    | instruction_list | statement_list

```

SEMANTICS: See 2.5.2.

NOTES

- 1 Ladder diagrams and function block diagrams are graphically represented as defined in clause 4.
- 2 The non-terminals *sequential_function_chart*, *instruction_list*, and *statement_list* are defined in B.1.6, B.2, and B.3.2, respectively.

B.1.5.3 Programs

PRODUCTION RULES:

```

program_type_name ::= identifier

program_declaration ::=
    'PROGRAM' program_type_name
    {fb_io_var_declarations}
    {other_var_declarations | located_var_declarations | global_var_declarations}
    [program_access_decls]
    function_block_body
    'END_PROGRAM'

program_access_decls ::=
    'VAR_ACCESS' program_access_decl ';'
    {program_access_decl ';' }
    'END_VAR'

program_access_decl ::= access_name ':' symbolic_variable ':' non_generic_type_name
    [direction]

```

SEMANTICS: See 2.5.3.

B.1.6 Sequential function chart elements

PRODUCTION RULES:

```

sequential_function_chart ::= sfc_network {sfc_network}

```


ANNEX G - Index (continued)

resource_declaration ::= 'RESOURCE' resource_name 'ON' resource_type_name
 [global_var_declarations]
 single_resource_declaration
 'END_RESOURCE'
 single_resource_declaration ::= {task_configuration ';' }
 program_configuration ';' }
 {program_configuration ';' }
 resource_name ::= identifier
 access_declarations ::= 'VAR_ACCESS' access_declaration ';' {access_declaration ';' }
 'END_VAR'
 access_declaration ::= access_name ':' access_path ':' non_generic_type_name [direction]
 access_path ::= [resource_name '.'] direct_variable | resource_name ':' program_io_reference
 | global_var_reference
 global_var_reference ::= [resource_name '.'] global_var_name ['.' structure_element_name]
 access_name ::= identifier
 program_io_reference ::= program_input_reference | program_output_reference
 program_output_reference ::= program_name '.' symbolic_variable
 program_input_reference ::= program_name '.' symbolic_variable
 program_name ::= identifier
 direction ::= 'READ_WRITE' | 'READ_ONLY'
 task_configuration ::= 'TASK' task_name task_initialization
 task_name ::= identifier
 task_initialization ::= '(' ['SINGLE' ':' data_source ','] ['INTERVAL' ':' data_source ',']
 'PRIORITY' ':' integer ')'
 data_source ::= constant | global_var_reference | program_output_reference | direct_variable
 program_configuration ::= 'PROGRAM' program_name ['WITH' task_name] ':'
 program_type_name
 ['(' prog_conf_elements ')']
 prog_conf_elements ::= prog_conf_element {',' prog_conf_element}
 prog_conf_element ::= fb_task | prog_cnxn
 fb_task ::= fb_name 'WITH' task_name
 prog_cnxn ::= symbolic_variable ':' prog_data_source | symbolic_variable '=>' data_sink
 prog_data_source ::= constant | global_var_reference | direct_variable
 data_sink ::= global_var_reference | direct_variable

SEMANTICS: See 2.7.

B.2 Language IL (Instruction List)**B.2.1 Instructions and operands**

PRODUCTION RULES:

ANNEX G - Index (continued)

instruction_list ::= instruction {instruction}
instruction ::= [[label ':'] (il_operation | il_fb_call)] EOL {EOL}
label ::= identifier
il_operation ::= il_operator [' ' il_operand_list]
il_operand_list ::= il_operand {',' il_operand}
il_operand ::= [identifier ':='] (constant | variable)
il_fb_call ::= 'CAL' ['C'['N']] fb_name ['(' il_operand_list ')']
SEMANTICS: See 3.2.

NOTE - The form of subscripts in the IL language is restricted to *single-element variables* or *integer literals*.

B.2.2 Operators

PRODUCTION RULES:

il_operator ::= ('LD' | 'ST') ['N'] | 'S' | 'R'
| ('AND' | 'OR' | 'XOR') ['N'] ['(']
| ('ADD' | 'SUB' | 'MUL' | 'DIV') ['(']
| ('GT' | 'GE' | 'EQ' | 'NE' | 'LT' | 'LE') ['(']
| ('JMP' | 'RET') ['C' ['N']]
| 'S1' | 'R1' | 'CLK' | 'CU' | 'CD' | 'PV' | 'IN' | 'PT' | '
| function_name

SEMANTICS: See 3.2.

B.3 Language ST (Structured Text)

B.3.1 Expressions

PRODUCTION RULES:

expression ::= xor_expression {'OR' xor_expression}
xor_expression ::= and_expression {'XOR' and_expression}
and_expression ::= comparison {'&' | 'AND'} comparison
comparison ::= equ_expression {'=' | '<>'} equ_expression
equ_expression ::= add_expression {comparison_operator add_expression}
comparison_operator ::= '<' | '>' | '<=' | '>='
add_expression ::= term {add_operator term}
add_operator ::= '+' | '-'
term ::= power_expression {multiply_operator power_expression}
multiply_operator ::= '*' | '/' | 'MOD'
power_expression ::= unary_expression {'**' unary_expression}
unary_expression ::= [unary_operator] primary_expression
unary_operator ::= '-' | 'NOT'
primary_expression ::= constant | variable | '(' expression ')'
| function_name '(' [st_function_inputs] ')'

ANNEX G - Index (continued)

st_function_inputs ::= st_function_input {',' st_function_input}

st_function_input ::= [variable_name ':='] expression

SEMANTICS: These definitions have been arranged to show a top-down derivation of expression structure. The precedence of operations is then implied by a "bottom-up" reading of the definitions of the various kinds of expressions. Further discussion of the semantics of these definitions is given in 3.3.1.

B.3.2 Statements

PRODUCTION RULE:

statement_list ::= statement ';' {statement ';'}

statement ::= NIL | assignment_statement | subprogram_control_statement |
selection_statement
| iteration_statement

SEMANTICS: See 3.3.2.

B.3.2.1 Assignment statements

PRODUCTION RULE:

assignment_statement ::= variable ':=' expression

SEMANTICS: See 3.3.2.1.

B.3.2.2 Subprogram control statements

PRODUCTION RULES:

subprogram_control_statement ::= fb_invocation | 'RETURN'

fb_invocation ::= fb_name '(' [fb_input_assignment {',' fb_input_assignment}] ')'

fb_input_assignment ::= variable_name ':=' expression

SEMANTICS: See 3.3.2.2.

B.3.2.3 Selection statements

PRODUCTION RULES:

selection_statement ::= if_statement | case_statement

if_statement ::= 'IF' expression 'THEN' statement_list
{'ELSIF' expression 'THEN' statement_list}
['ELSE' statement_list]
'END_IF'

case_statement ::= 'CASE' expression 'OF'
case_element {case_element}
['ELSE' statement_list]
'END_CASE'

case_element ::= case_list ':' statement_list

case_list ::= case_list_element {',' case_list_element}

ANNEX G - Index (continued)

case_list_element ::= subrange | signed_integer

SEMANTICS: See 3.3.2.3.

B.3.2.4 Iteration statements

PRODUCTION RULES:

iteration_statement ::= for_statement | while_statement | repeat_statement | exit_statement

for_statement ::= 'FOR' control_variable ':' for_list 'DO' statement_list 'END_FOR'

control_variable ::= identifier

for_list ::= expression 'TO' expression ['BY' expression]

while_statement ::= 'WHILE' expression 'DO' statement_list 'END_WHILE'

repeat_statement ::= 'REPEAT' statement_list 'UNTIL' expression 'END_REPEAT'

exit_statement ::= 'EXIT'

SEMANTICS: See 3.3.2.4.

ANNEX G - Index (continued)

ANNEX G - Index (continued)

ANNEX C - Delimiters and Keywords (normative)

The usages of delimiters and keywords in IEC 1131-3 is summarized in tables C.1 and C.2. National standards organizations can publish tables of translations for the textual portions of the delimiters listed in table C.1 and the keywords listed in table C.2.

Table C.1 - Delimiters

Delimiters	Clause	Usage
Space	2.1.4	As specified in 2.1.4.
(* *)	2.1.5	Begin comment End comment
+	2.2.1 3.3.1	Leading sign of decimal literal Addition operator
-	2.2.1 2.2.3.2 3.3.1 4.1.1	Leading sign of decimal literal Year-month-day separator Subtraction, negation operator Horizontal line
#	2.2.1 2.2.3	Based number separator Time literal separator
.	2.2.1 2.4.1.1 2.4.1.2 2.5.2.1	Integer/fraction separator Hierarchical address separator Structure element separator Function block structure separator
e or E	2.2.1	Real exponent delimiter
'	2.2.2	Start and end of character string
\$	2.2.2	Start of special character in strings
2.2.3 - Time literal delimiters, including: t#, T#, d, D, h, H, m, M, s, S, ms, MS DATE#, date#, D#, d#, TIME_OF_DAY#, time_of_day# TOD#, tod#, DATE_AND_TIME#, date_and_time#, DT#, dt#		
:	2.2.3.2 2.3.3.1 2.4.2 2.6.2 2.7 2.7 2.7 3.2.1 4.1.2	Time of day separator Type name/specification separator Variable/type separator Step name terminator RESOURCE name/type separator PROGRAM name/type separator Access name/path/type separator Instruction label terminator Network label terminator

(continued on following page)

ANNEX G - Index (continued)

Table C.1 - Delimiters (continued)

Delimiters	Clause	Usage
:=	2.3.3.1 2.7.1 3.3.2.1	Initialization operator Input connection operator Assignment operator
() () [] [] () () () () ()	2.3.3.1 2.3.3.1 2.4.1.2 2.4.2 2.4.2 3.2.2 3.3.1 3.3.1 3.3.2.2	Enumeration list delimiters Subrange delimiters Array subscript delimiters String length delimiters Multiple initialization Instruction List modifier/operator Function arguments Subexpression hierarchy Function block input list delimiters
,	2.3.3.1 2.3.3.2 2.4.1 2.4.2 2.5.2.1 2.5.2.1 3.2.1 3.3.1 3.3.2.3	Enumeration list separator Initial value separator Array subscript separator Declared variable separator Function block initial value separator Function block input list separator Operand list separator Function argument list separator CASE value list separator
;	2.3.3.1 3.3	Type declaration separator Statement separator
..	2.3.3.1 3.3.2.3	Subrange separator CASE range separator
%	2.4.1.1	Direct representation prefix
=>	2.7.1	Output connection operator
3.3.1 - Infix operators, including: **, NOT, *, /, MOD, +, -, <, >, <= >=, =, <>, &, AND, XOR, OR		
or !	4.1.1	Vertical lines (note)

NOTE - "!" is only allowed when "|" does not exist in a national character set.

ANNEX G - Index (continued)

Table C.2 - Keywords

Keywords	Clause
ACTION...END_ACTION	2.6.4.1
ARRAY...OF	2.3.3.1
AT	2.4.3
CASE...OF...ELSE...END_CASE	3.3.2.3
CONFIGURATION...END_CONFIGURATION	2.7.1
CONSTANT	2.4.3
Data type names	2.3
EN, ENO	2.5.1.2
EXIT	3.3.2.4
FALSE	2.2.1
F_EDGE	2.5.2.2
FOR...TO...BY...DO...END_FOR	3.3.2.4
FUNCTION...END_FUNCTION	2.5.1.3
Function names	2.5.1
FUNCTION_BLOCK...END_FUNCTION_BLOCK	2.5.2.2
Function Block names	2.5.2
IF...THEN...ELSIF...ELSE...END_IF	3.3.2.3
INITIAL_STEP...END_STEP	2.6.2
PROGRAM...WITH...	2.7.1
PROGRAM...END_PROGRAM	2.5.3

(continued on following page)

ANNEX G - Index (continued)

Table C.2 - Keywords (continued)

Keywords	Clause
R_EDGE	2.5.2.2
READ_ONLY, READ_WRITE	2.7.1
REPEAT...UNTIL...END_REPEAT	3.3.2.4
RESOURCE...ON...END_RESOURCE	2.7.1
RETAIN	2.4.3
RETURN	3.3.2.2
STEP...END_STEP	2.6.2
STRUCT...END_STRUCT	2.3.3.1
TASK	2.7.2
Textual operators (IL language)	3.2.2 note
(ST language)	3.3.1 note
TRANSITION...FROM...TO...END_TRANSITION	2.6.3
TRUE	2.2.1
TYPE...END_TYPE	2.3.3.1
VAR...END_VAR VAR_INPUT...END_VAR VAR_OUTPUT...END_VAR VAR_IN_OUT...END_VAR VAR_EXTERNAL...END_VAR	2.4.2
VAR_ACCESS...END_VAR	2.7.1
VAR_GLOBAL...END_VAR	2.7.1
WHILE...DO...END_WHILE	3.3.2.4
WITH	2.7.1

NOTE - The use of these keywords is restricted as defined in subclause 2.1.3 only within program organization units programmed in the respective languages.

ANNEX G - Index (continued)

ANNEX D - Implementation-dependent parameters (normative)

The implementation-dependent parameters defined in IEC 1131-3, and the primary reference clause for each, are listed in table D.1.

Table D.1 - Implementation-dependent parameters

Clause	Parameters
1.5.1	Error handling procedures
2.1.1	National characters used # or „pounds Sterling“ sign \$ or „currency“ sign or !
2.1.2	Maximum length of identifiers
2.1.5	Maximum comment length
2.2.3.1	Range of values of duration
2.3.1	Range of values for variables of type TIME Precision of representation of seconds in types TIME_OF_DAY and DATE_AND_TIME
2.3.3	Maximum number of array subscripts Maximum array size Maximum number of structure elements Maximum structure size Maximum number of variables per declaration
2.3.3.1	Maximum number of enumerated values
2.3.3.2	Default maximum length of STRING variables Maximum allowed length of STRING variables
2.4.1.1	Maximum number of hierarchical levels Logical or physical mapping
2.4.1.2	Maximum number of subscripts Maximum range of subscript values Maximum number of levels of structures
2.4.2	Initialization of system inputs
2.4.3	Maximum number of variables per declaration
2.5	Information to determine execution times of program organization units
2.5.1.1	Method of function representation (names or symbols)
2.5.1.3	Maximum number of function specifications
2.5.1.5	Maximum number of inputs of extensible functions
2.5.1.5.1	Effects of type conversions on accuracy

(continued on following page)

ANNEX G - Index (continued)

Table D.1 - Implementation-dependent parameters (continued)

Clause	Parameters
2.5.1.5.2	Accuracy of functions of one variable Implementation of arithmetic functions
2.5.2	Maximum number of function block specifications and instantiations
2.5.2.3.3	Pvmin, Pvmax of counters
2.5.2.3.4	Effect of a change in the value of a PT input during a timing operation
2.5.3	Program size limitations
2.6	Timing and portability effects of execution control elements
2.6.2	Precision of step elapsed time Maximum number of steps per SFC
2.6.3	Maximum number of transitions per SFC and per step
2.6.4	Action control mechanism
2.6.4.2	Maximum number of action blocks per step
2.6.5	Graphic indication of step state Transition clearing time Maximum width of diverge/converge constructs
2.7.1	Contents of RESOURCE libraries
2.7.2	Maximum number of tasks Task interval resolution Pre-emptive or non-pre-emptive scheduling
3.3.1	Maximum length of expressions Partial evaluation of Boolean expressions
3.3.2	Maximum length of statements
3.3.2.3	Maximum number of CASE selections
3.3.2.4	Value of control variable upon termination of FOR loop
4.1.1	Graphic/semigraphic representation Restrictions on network topology
4.1.3	Evaluation order of feedback loops
4.3.3	Means for specifying order of network execution

ANNEX G - Index (continued)

ANNEX E - Error Conditions (normative)

The error conditions defined in IEC 1131-3, and the primary reference clause for each, are listed in table E.1. These errors may be detected during preparation of the program for execution or during execution of the program. The manufacturer shall specify the disposition of these errors according to the provisions of subclause 1.5.1 of this part.

Table E.1 - Error conditions

Clause	Error conditions
2.3.3.1	Value of a variable exceeds the specified subrange
2.4.2	Length of initialization list does not match number of array entries
2.5.1	Improper use of directly represented or external variables in functions
2.5.1.5.1	Type conversion errors
2.5.1.5.2	Numerical result exceeds range for data type Division by zero
2.5.1.5.4	Mixed input data types to a selection function Selector (K) out of range for MUX function
2.5.1.5.5	Invalid character position specified Result exceeds maximum string length
2.5.1.5.5	CONCAT result too long
2.5.1.5.6	Result exceeds range for data type
2.5.2.2	No parameter value specified for a function block instance used as input parameter
2.5.2.2	No parameter value specified for a VAR_IN_OUT parameter
2.6.2	Zero or more than one initial steps in SFC network User program attempts to modify step state or time
2.6.2.5	Simultaneously true, non-prioritized transitions in a selection divergence
2.6.3	Side effects in evaluation of transition condition
2.6.4.5	Action control contention error
2.6.5	Unsafe or unreachable SFC
2.7.1	Data type conflict in VAR_ACCESS
2.7.2	Tasks require too many processor resources Execution deadline not met Other task scheduling conflicts
3.2.2	Numerical result exceeds range for data type
3.2.2	Current result and operand not of same data type
3.3.1	Division by zero Invalid data type for operation
3.3.2.1	Return from function without value assigned
3.3.2.4	Iteration fails to terminate

ANNEX G - Index (continued)

4.1.1	Same identifier used as connector label and element name
4.1.3	Uninitialized feedback variable

ANNEX G - Index (continued)

ANNEX G - Index (continued)**ANNEX F - Examples** (informative)**F.1 Function WEIGH**

Example function WEIGH provides the functions of BCD-to-binary conversion of a gross-weight input from a scale, the binary integer subtraction of a tare weight which has been previously converted and stored in the memory of the programmable controller, and the conversion of the resulting net weight back to BCD form, e.g., for an output display. The "EN" input is used to indicate that the scale is ready to perform the weighing operation.

The "ENO" output indicates that an appropriate command exists (e.g., from an operator pushbutton), the scale is in proper condition for the weight to be read, and each function has a correct result.

A textual form of the declaration of this function is:

```

FUNCTION WEIGH : WORD      (* BCD encoded *)
  VAR_INPUT  (* "EN" input is used to indicate "scale ready" *)
    weigh_command : BOOL;
    gross_weight  : WORD ; (* BCD encoded *)
    tare_weight   : INT  ;
  END_VAR
(* Function Body *)
END_FUNCTION              (* Implicit "ENO" *)

```

The body of function WEIGH in the IL language is:

```

                LD      weigh_command
                JMPC    WEIGH_NOW
                ST      ENO          (* No weighing, 0 to "ENO" *)
                RET
WEIGH_NOW:     LD      gross_weight
                BCD_TO_INT
                SUB     tare_weight
                INT_TO_BCD          (* Return evaluated weight *)

```

The body of function WEIGH in the ST language is:


```

IF weigh_command THEN
  WEIGH := INT_TO_BCD (BCD_TO_INT(gross_weight) - tare_weight);
END_IF ;


```

ANNEX G - Index (continued)


An equivalent graphical declaration of function WEIGH is:

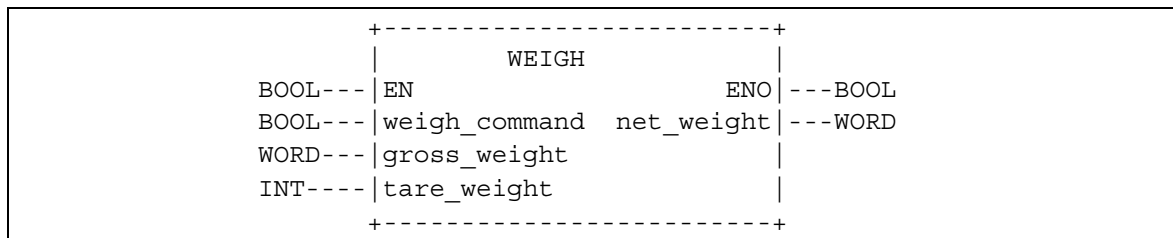

The function body in the LD language is:

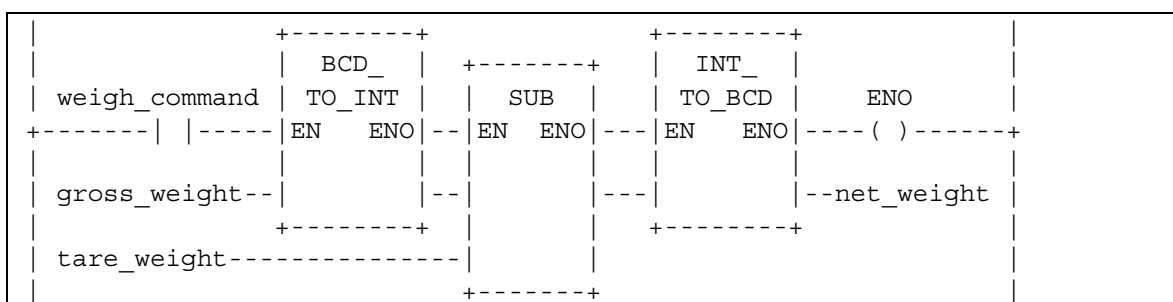

The function body in the FBD language is:

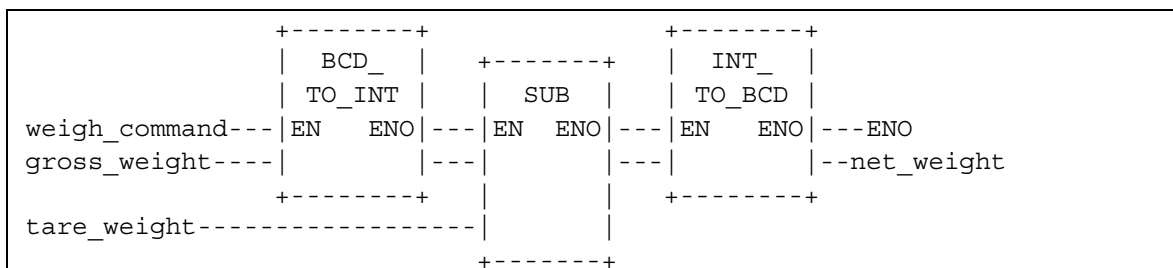

F.2 Function block CMD_MONITOR

Example function block CMD_MONITOR illustrates the control of an operative unit which is capable of responding to a Boolean command (the CMD output) and returning a Boolean feedback signal (the FDBK input) indicating successful completion of the commanded action. The function block provides for manual control via the MAN_CMD input, or automated control via the AUTO_CMD input, depending on the state of the AUTO_MODE input (0 or 1 respectively). Verification of the MAN_CMD input is provided via the MAN_CMD_CHK input, which must be 0 in order to enable the MAN_CMD input.

If confirmation of command completion is not received on the FDBK input within a predetermined time specified by the T_CMD_MAX input, the command is cancelled and an alarm condition is signalled via the ALRM output. The alarm condition may be cancelled by the ACK (acknowledge) input, enabling further operation of the command cycle.

ANNEX G - Index (continued)

A textual form of the declaration of function block CMD_MONITOR is:

```

FUNCTION_BLOCK CMD_MONITOR
  VAR_INPUT AUTO_CMD : BOOL ; (* Automated command *)
           AUTO_MODE : BOOL ; (* AUTO_CMD enable *)
           MAN_CMD : BOOL ; (* Manual Command *)
           MAN_CMD_CHK : BOOL ; (* Negated MAN_CMD to debounce *)
           T_CMD_MAX : TIME ; (* Max time from CMD to FDBK *)
           FDBK : BOOL ; (* Confirmation of CMD completion
                           by operative unit *)
           ACK : BOOL ; (* Acknowledge/cancel ALRM *)
  END_VAR
  VAR_OUTPUT CMD : BOOL ; (* Command to operative unit *)
           ALRM : BOOL ; (* T_CMD_MAX expired without FDBK *)
  END_VAR
  VAR CMD_TMR : TON ; (* CMD-to-FDBK timer *)
           ALRM_FF : SR ; (* Note over-riding "S" input: *)
  END_VAR (* Command must be cancelled before
           "ACK" can cancel alarm *)

(* Function Block Body *)
END_FUNCTION_BLOCK

```

An equivalent graphical declaration is:

```

+-----+
|  CMD_MONITOR  |
|  BOOL---|AUTO_CMD  CMD|---BOOL
|  BOOL---|AUTO_MODE  ALRM|---BOOL
|  BOOL---|MAN_CMD
|  BOOL---|MAN_CMD_CHK
|  TIME---|T_CMD_MAX
|  BOOL---|FDBK
|  BOOL---|ACK
+-----+

```

The body of function block CMD_MONITOR in the ST language is:

```

CMD := AUTO_CMD & AUTO_MODE
      OR MAN_CMD & NOT MAN_CMD_CHK & NOT AUTO_MODE ;
CMD_TMR (IN := CMD, PT := T_CMD_MAX);
ALRM_FF (S1 := CMD_TMR.Q & NOT FDBK, R := ACK);
ALRM := ALRM_FF.Q1;

```



ANNEX G - Index (continued)

The body of function block CMD_MONITOR in the IL language is:

```


LD      T_CMD_MAX
ST      CMD_TMR.PT      (* Store an input to the TON FB *)
LD      AUTO_CMD
AND     AUTO_MODE
OR(     MAN_CMD
AND     AUTO_MODE
N
AND     MAN_CMD_CHK
N
)
ST      CMD
IN      CMD_TMR      (* Invoke the TON FB *)
LD      CMD_TMR.Q
AND     FDBK
N
ST      ALRM_FF.S1    (* Store an input to the SR FB *)
LD      ACK
R       ALRM_FF      (* Invoke the SR FB *)
LD      ALRM_FF.Q1
ST      ALRM
    
```

The body of function block CMD_MONITOR in the LD language is:

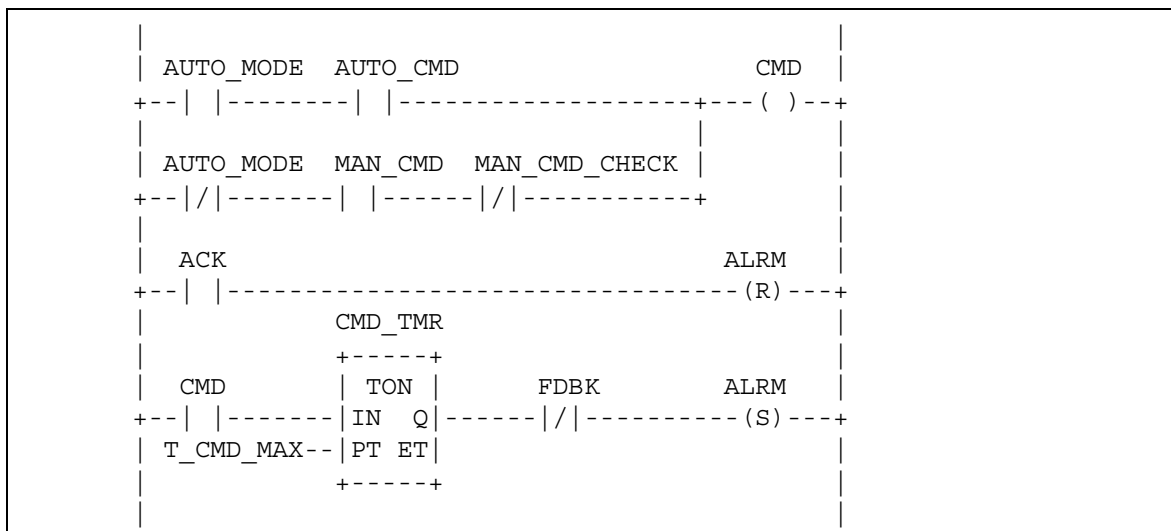

ANNEX G - Index (continued)


The body of function block CMD_MONITOR in the FBD language is:

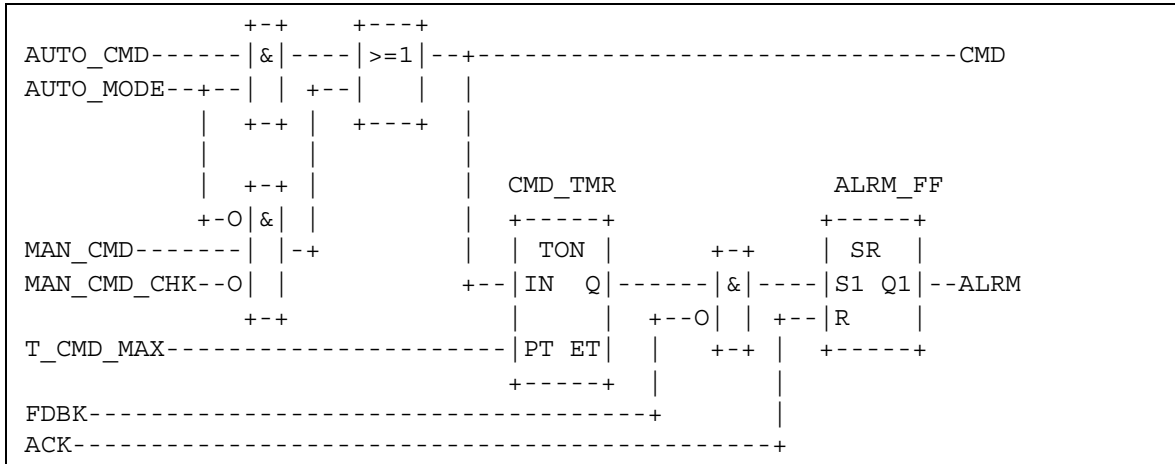

F.3 Function block FWD_REV_MON

Example function block FWD_REV_MON illustrates the control of an operative unit capable of two-way positioning action, e.g., a motor-operated valve. Both automated and manual control modes are possible, with alarm capabilities provided for each direction of motion, as described for function block CMD_MONITOR above. In addition, contention between forward and reverse commands causes the cancellation of both commands and signalling of an alarm condition. The Boolean OR of all alarm conditions is made available as a KLAXON output for operator signaling.

A graphical declaration of this function block is:

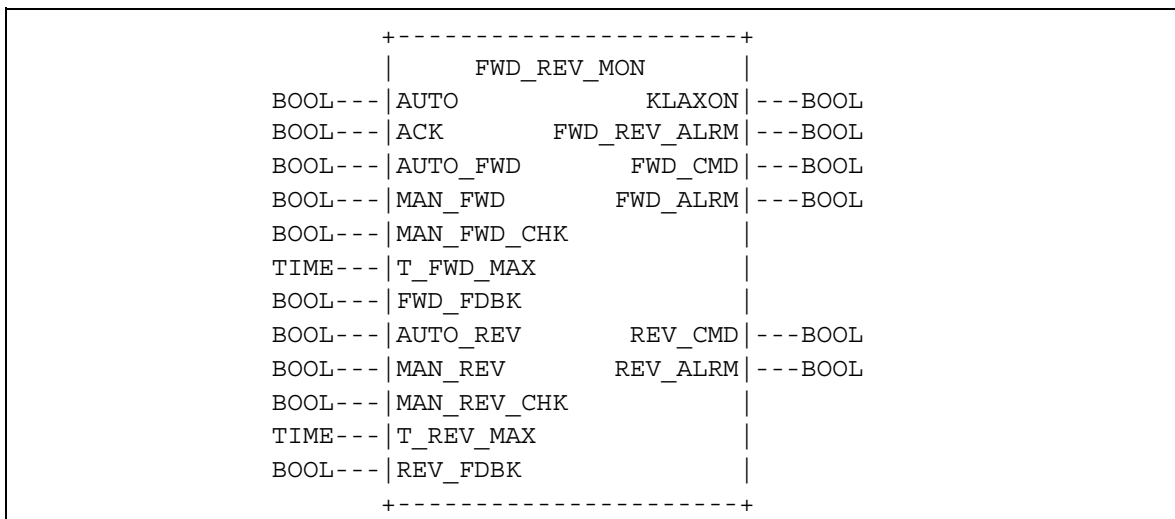

ANNEX G - Index (continued)

A textual form of the declaration of function block FWD_REV_MON is:

```
FUNCTION_BLOCK FWD_REV_MON
VAR_INPUT AUTO : BOOL ;(* Enable automated commands *)
  ACK : BOOL ;      (* Acknowledge/cancel all alarms *)
  AUTO_FWD : BOOL ; (* Automated forward command *)
  MAN_FWD : BOOL ;  (* Manual forward command *)
  MAN_FWD_CHK : BOOL ; (* Negated MAN_FWD for debouncing *)
  T_FWD_MAX : TIME ; (* Maximum time from FWD_CMD to FWD_FDBK *)
  FWD_FDBK : BOOL ; (* Confirmation of FWD_CMD completion *)
                    (* by operative unit *)
  AUTO_REV : BOOL ; (* Automated reverse command *)
  MAN_REV : BOOL ;  (* Manual reverse command *)
  MAN_REV_CHK : BOOL ; (* Negated MAN_REV for debouncing *)
  T_REV_MAX : TIME ; (* Maximum time from REV_CMD to REV_FDBK *)
  REV_FDBK : BOOL ; (* Confirmation of REV_CMD completion *)
END_VAR
VAR_OUTPUT KLAXON : BOOL ;      (* Any alarm active *)
  FWD_REV_ALRM : BOOL; (* Forward/reverse command conflict *)
  FWD_CMD : BOOL ;     (* "Forward" command to operative unit *)
  FWD_ALRM : BOOL ;    (* T_FWD_MAX expired without FWD_FDBK *)
  REV_CMD : BOOL ;     (* "Reverse" command to operative unit *)
  REV_ALRM : BOOL ;    (* T_REV_MAX expired without REV_FDBK *)
END_VAR
VAR FWD_MON : CMD_MONITOR; (* "Forward" command monitor *)
  REV_MON : CMD_MONITOR;   (* "Reverse" command monitor *)
  FWD_REV_FF : SR ;        (* Forward/Reverse contention latch *)
END_VAR
(* Function Block body *)
END_FUNCTION_BLOCK
```

ANNEX G - Index (continued)

The body of function block FWD_REV_MON can be written in the ST language as:

```
(* Evaluate internal function blocks *)
FWD_MON      (AUTO_MODE      := AUTO,
              ACK             := ACK,
              AUTO_CMD        := AUTO_FWD,
              MAN_CMD         := MAN_FWD,
              MAN_CMD_CHK     := MAN_FWD_CHK,
              T_CMD_MAX       := T_FWD_MAX,
              FDBK            := FWD_FDBK);
REV_MON      (AUTO_MODE      := AUTO,
              ACK             := ACK,
              AUTO_CMD        := AUTO_REV,
              MAN_CMD         := MAN_REV,
              MAN_CMD_CHK     := MAN_REV_CHK,
              T_CMD_MAX       := T_REV_MAX,
              FDBK            := REV_FDBK);
FWD_REV_FF (S1 := FWD_MON.CMD & REV_MON.CMD, R := ACK);
(* Transfer data to outputs *)
FWD_REV_ALARM := FWD_REV_FF.Q1;
FWD_CMD := FWD_MON.CMD & NOT FWD_REV_ALARM;
FWD_ALARM := FWD_MON.ALARM;
REV_CMD := REV_MON.CMD & NOT FWD_REV_ALARM;
REV_ALARM := REV_MON.ALARM;
KLAXON := FWD_ALARM OR REV_ALARM OR FWD_REV_ALARM;
```


ANNEX G - Index (continued)

The body of function block FWD_REV_MON in the IL language is:

```
LD      AUTO                                (* Load common inputs *)
ST      FWD_MON.AUTO_MODE
ST      REV_MON.AUTO_MODE
LD      ACK
ST      FWD_MON.ACK
ST      REV_MON.ACK
ST      FWD_REV_FF.R
LD      AUTO_FWD                            (* Load inputs to FWD_MON *)
ST      FWD_MON.AUTO_CMD
LD      MAN_FWD
ST      FWD_MON.MAN_CMD
LD      MAN_FWD_CHK
ST      FWD_MON.MAN_CMD_CHK
LD      T_FWD_MAX
ST      FWD_MON.T_CMD_MAX
LD      FWD_FDBK
ST      FWD_MON.FDBK
CAL     FWD_MON                            (* Activate FWD_MON *)
LD      AUTO_REV                            (* Load inputs to REV_MON *)
ST      REV_MON.AUTO_CMD
LD      MAN_REV
ST      REV_MON.MAN_CMD
LD      MAN_REV_CHK
ST      REV_MON.MAN_CMD_CHK
LD      T_REV_MAX
ST      REV_MON.T_CMD_MAX
LD      REV_FDBK
ST      REV_MON.FDBK
CAL     REV_MON                            (* Activate REV_MON *)
LD      FWD_MON.CMD                        (* Check for contention *)
AND     REV_MON.CMD
S1      FWD_REV_FF                        (* Latch contention condition *)
LD      FWD_REV_FF.Q
ST      FWD_REV_ALRM                      (* Contention alarm *)
LD      FWD_MON.CMD                        (* "Forward" command and alarm *)
ANDN    FWD_REV_ALRM
ST      FWD_CMD
LD      FWD_MON.ALRM
ST      FWD_ALRM
LD      REV_MON.CMD                        (* "Reverse" command and alarm *)
ANDN    FWD_REV_ALRM
ST      REV_CMD
LD      REV_MON.ALRM
ST      REV_ALRM
OR      FWD_ALRM                          (* OR all alarms *)
OR      FWD_REV_ALRM
ST      KLAXON
```


ANNEX G - Index (continued)

The body of function block FWD_REV_MON in the FBD language is:

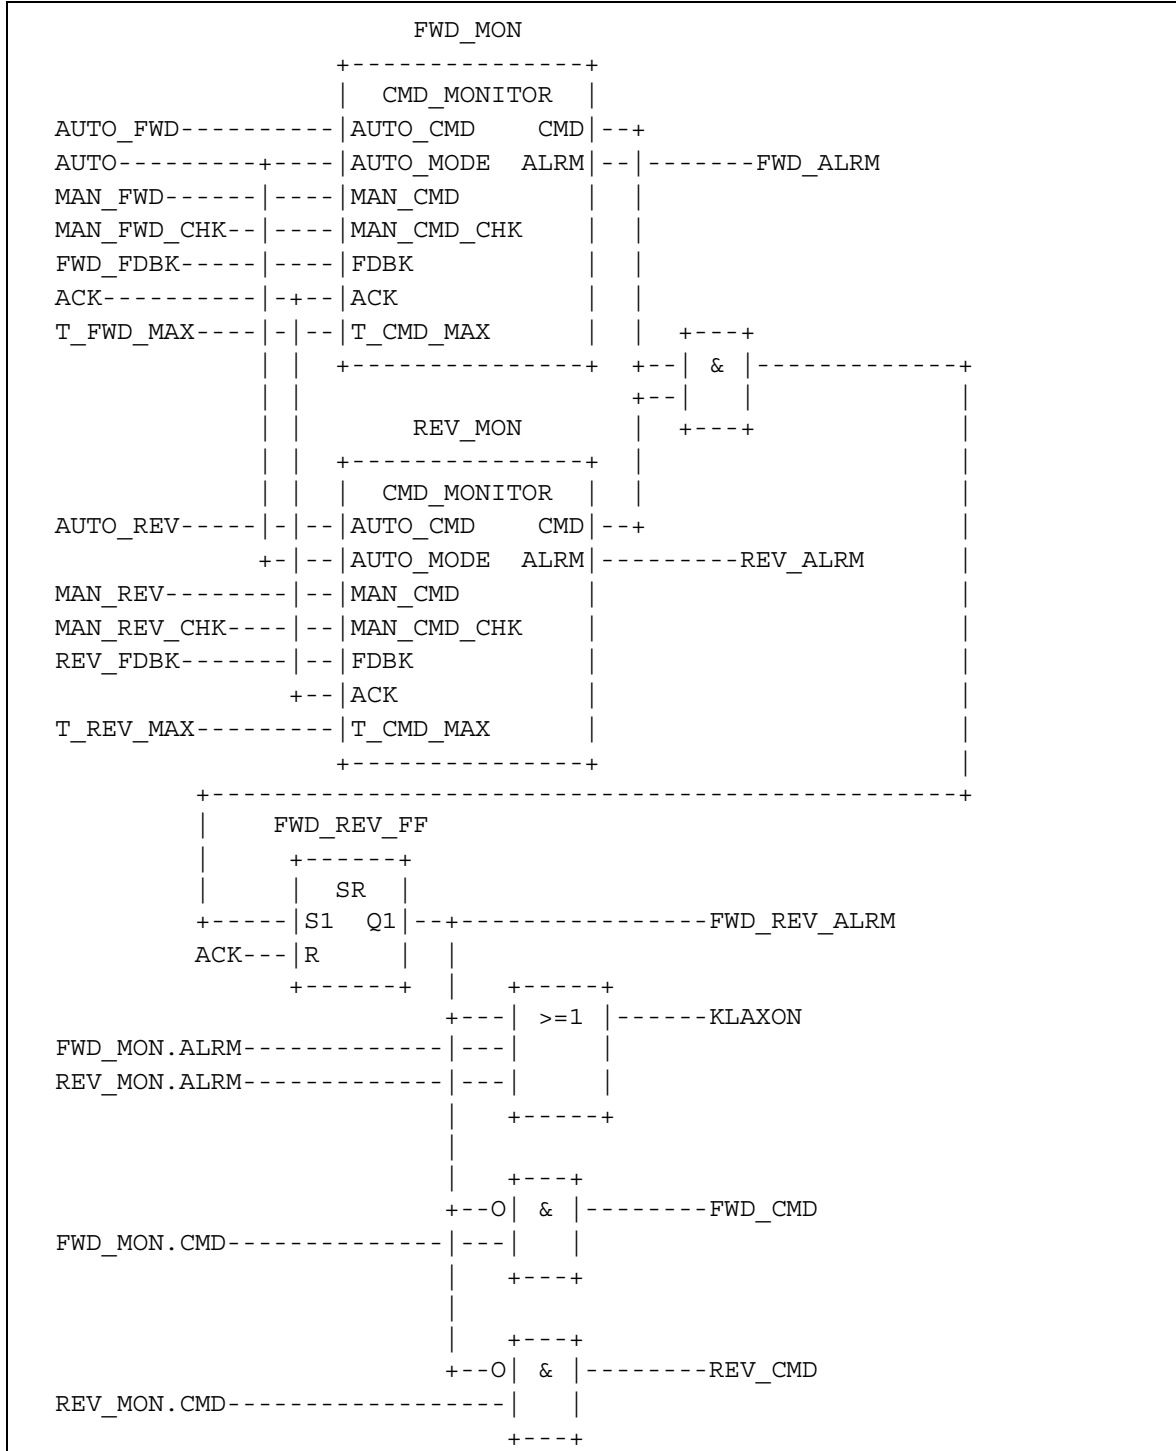

ANNEX G - Index (continued)


The body of function block FWD_REV_MON in the LD language is:

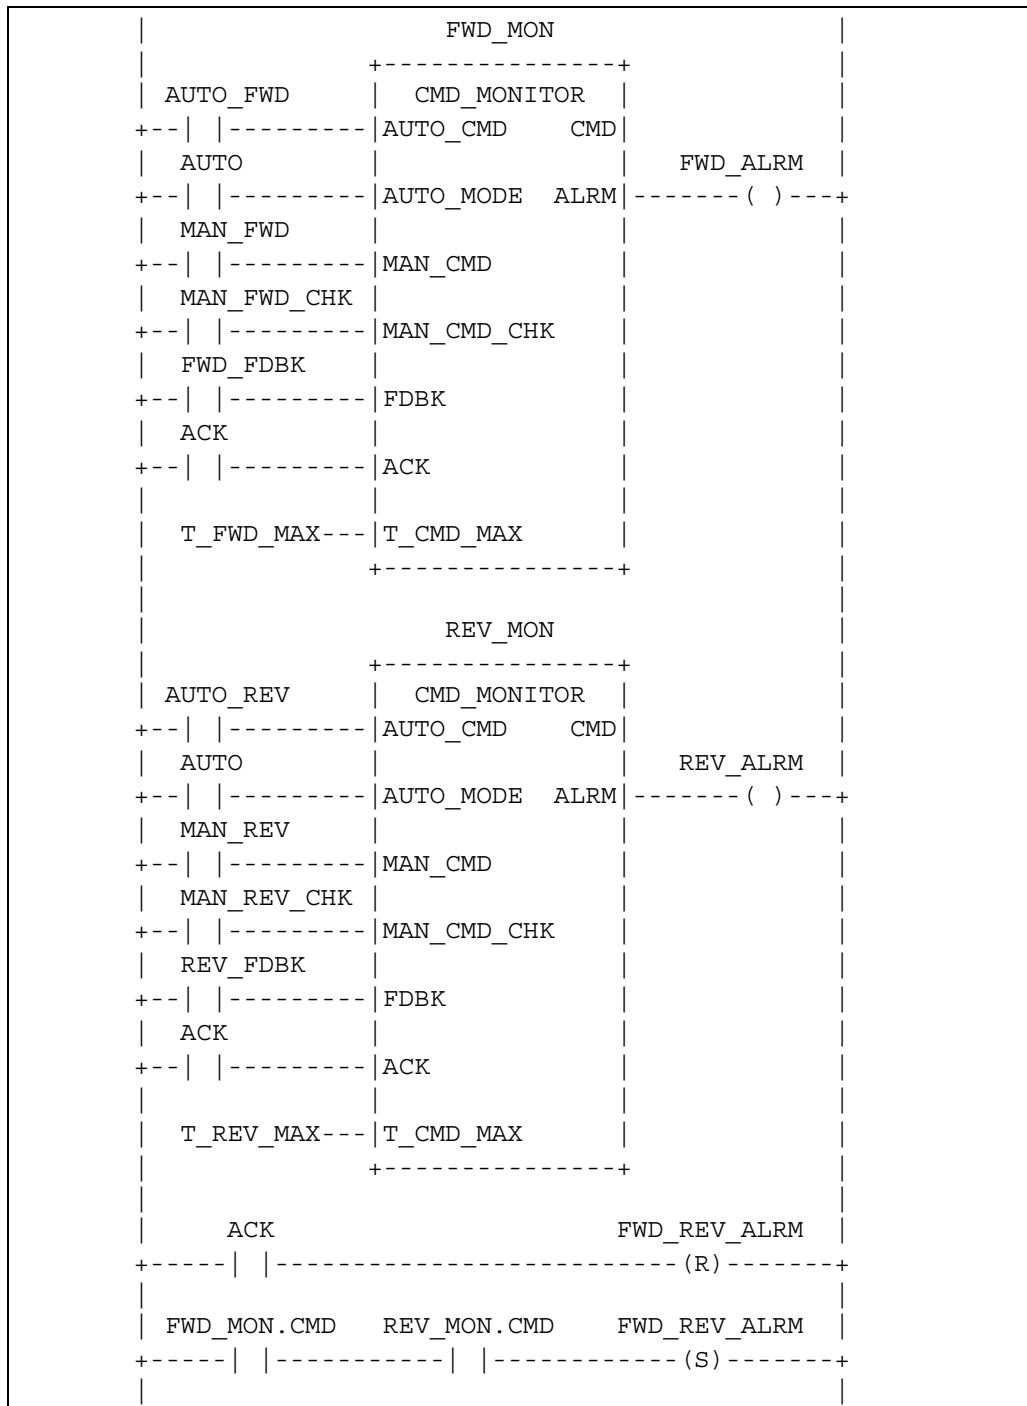

(continued on following page)

ANNEX G - Index (continued)

(FWD_REV_MON function block body - LD language - continued)

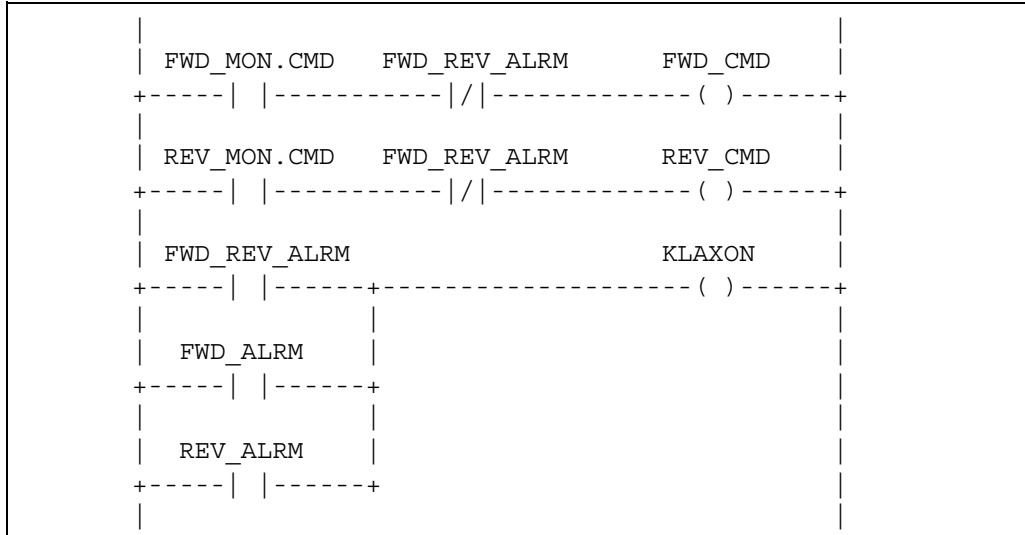

F.4 Function block STACK_INT

This function block provides a stack of up to 128 integers. The usual stack operations of PUSH and POP are provided by edge-triggered Boolean inputs. An overriding reset (R1) input is provided; the maximum stack depth (N) is determined at the time of resetting. In addition to the top-of-stack data (OUT), Boolean outputs are provided indicating stack empty and stack overflow states.

A textual form of the declaration of this function block is:

```

FUNCTION_BLOCK STACK_INT
  VAR_INPUT PUSH, POP: BOOL R_EDGE; (* Basic stack operations *)
    R1 : BOOL ; (* Over-riding reset *)
    IN : INT ; (* Input to be pushed *)
    N : INT ; (* Maximum depth after reset *)
  END_VAR
  VAR_OUTPUT EMPTY : BOOL := 1 ; (* Stack empty *)
    OFLO : BOOL := 0 ; (* Stack overflow *)
    OUT : INT := 0 ; (* Top of stack data *)
  END_VAR
  VAR STK : ARRAY[0..127] OF INT; (* Internal stack *)
    NI : INT :=128 ; (* Storage for N upon reset *)
    PTR : INT := -1 ; (* Stack pointer *)
  END_VAR
  (* Function Block body *)
END_FUNCTION_BLOCK

```


ANNEX G - Index (continued)

A graphical declaration of function block STACK_INT is:

```

+-----+
|  STACK_INT  |
|  |  |  |  |  |
|  |  |  |  |  |
|  |  |  |  |  |
|  |  |  |  |  |
|  |  |  |  |  |
|  |  |  |  |  |
|  |  |  |  |  |
+-----+
(* Internal variable declarations *)
VAR STK : ARRAY[0..127] OF INT ; (* Internal Stack *)
    NI : INT :=128 ;           (* Storage for N upon Reset *)
    PTR : INT := -1 ;         (* Stack Pointer *)
END_VAR

```

The function block body in the ST language is:

```

IF R1 THEN
    OFLO := 0; EMPTY := 1; PTR := -1;
    NI := LIMIT (MN:=1,IN:=N,MX:=128); OUT := 0;
ELSIF POP & NOT EMPTY THEN
    OFLO := 0; PTR := PTR-1; EMPTY := PTR < 0;
    IF EMPTY THEN OUT := 0;
    ELSE OUT := STK[PTR];
    END_IF ;
ELSIF PUSH & NOT OFLO THEN
    EMPTY := 0; PTR := PTR+1; OFLO := (PTR = NI);
    IF NOT OFLO THEN OUT := IN ; STK[PTR] := IN;
    ELSE OUT := 0;
    END_IF ;
END_IF ;
END_IF ;

```

The function block body in the LD language is:

```


|          R1          |
+---| |---->>RESET
|
|  POP  EMPTY
+--| |---|/|---->>POP_STK
|
|  PUSH  OFLO
+--| |---|/|---->>PUSH_STK
|
+-----<RETURN>

```

(continued on following page)

ANNEX G - Index (continued)

(STACK_INT function block body - LD language - continued)

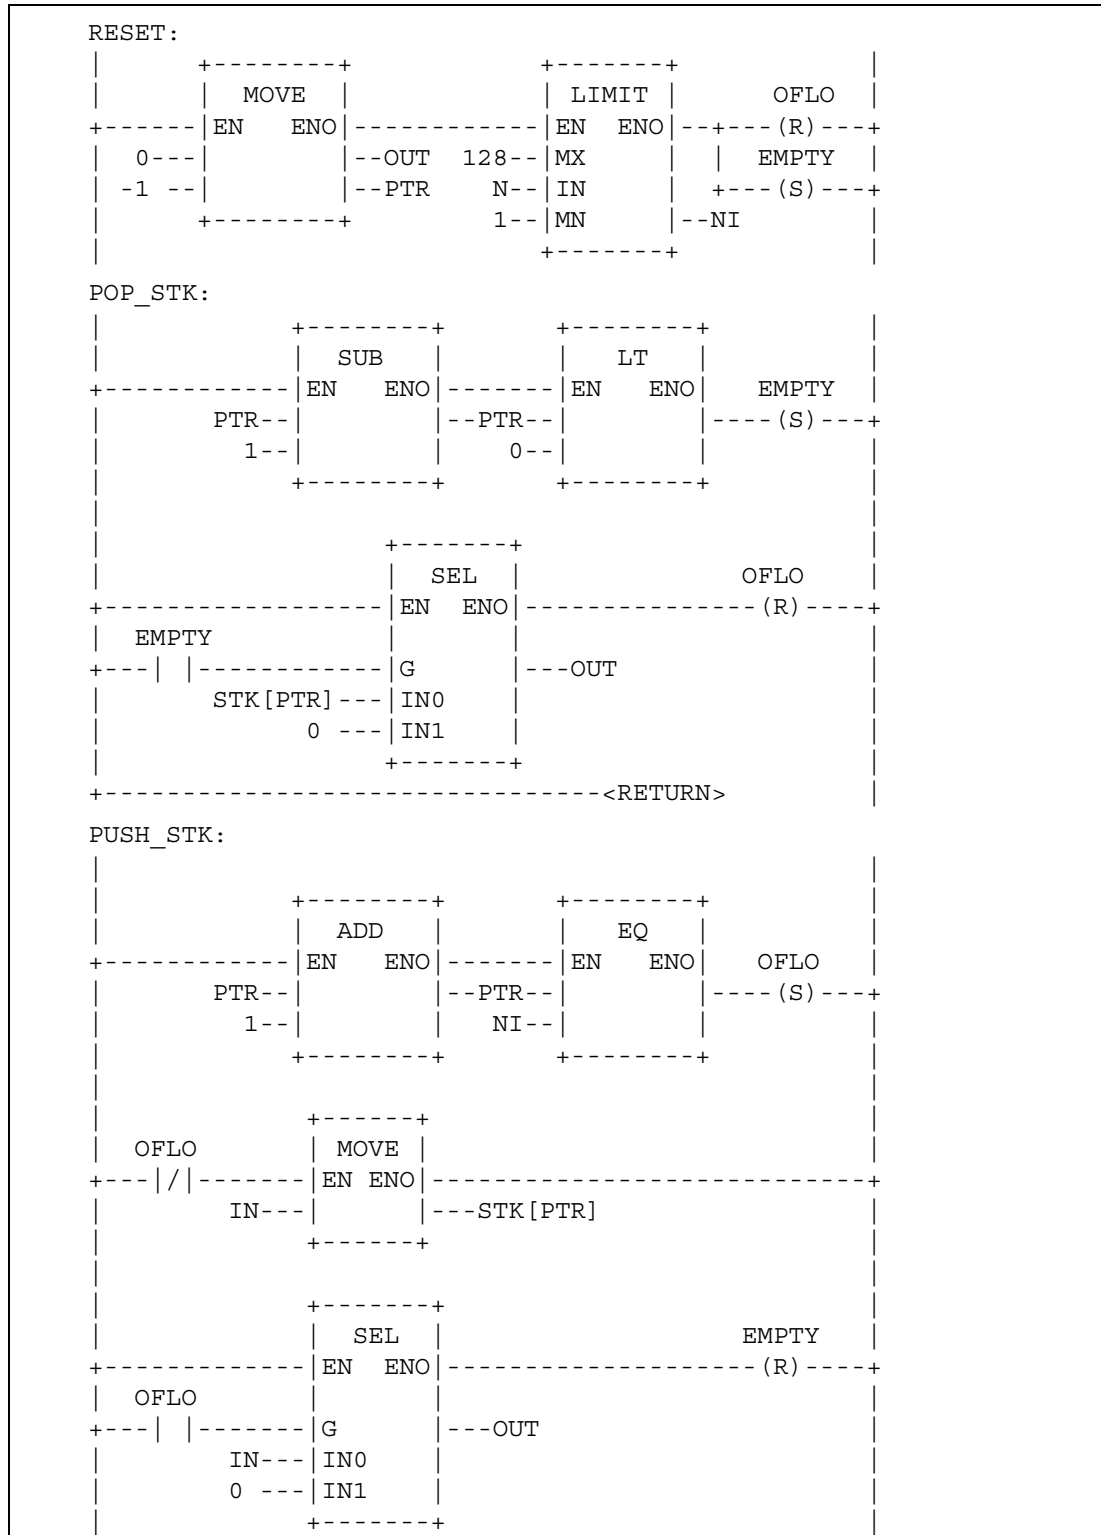


ANNEX G - Index (continued)

The body of function block STACK_INT in the IL language is:

	LD	R1	(* Dispatch on operations *)
	JMPC	RESET	
	LD	POP	
	ANDN	EMPTY	(* Don't pop empty stack *)
	JMPC	POP_STK	
	LD	PUSH	
	ANDN	OFLO	(* Don't push overflowed stack *)
	JMPC	PUSH_STK	
	RET		(* Return if no operations active *)
RESET:	LD	0	(* Stack reset operations *)
	ST	OFLO	
	LD	1	
	ST	EMPTY	
	LD	-1	
	ST	PTR	
	CAL	LIMIT(MN:=1,IN:=N,MX:=128)	
	ST	NI	
	JMP	ZRO_OUT	
POP_STK:	LD	0	
	ST	OFLO	(* Popped stack is not overflowing *)
	LD	PTR	
	SUB	1	
	ST	PTR	
	LT	0	(* Empty when PTR < 0 *)
	ST	EMPTY	
	JMPC	ZRO_OUT	
	LD	STK[PTR]	
	JMP	SET_OUT	
PUSH_STK:	LD	0	
	ST	EMPTY	(* Pushed stack is not empty *)
	LD	PTR	
	ADD	1	
	ST	PTR	
	EQ	NI	(* Overflow when PTR = NI *)
	ST	OFLO	
	JMPC	ZRO_OUT	
	LD	IN	
	ST	STK[PTR]	(* Push IN onto STK *)
	JMP	SET_OUT	
ZRO_OUT:	LD	0	(* OUT=0 for EMPTY or OFLO *)
SET_OUT:	ST	OUT	

ANNEX G - Index (continued)

The body of function block STACK_INT in the FBD language is:

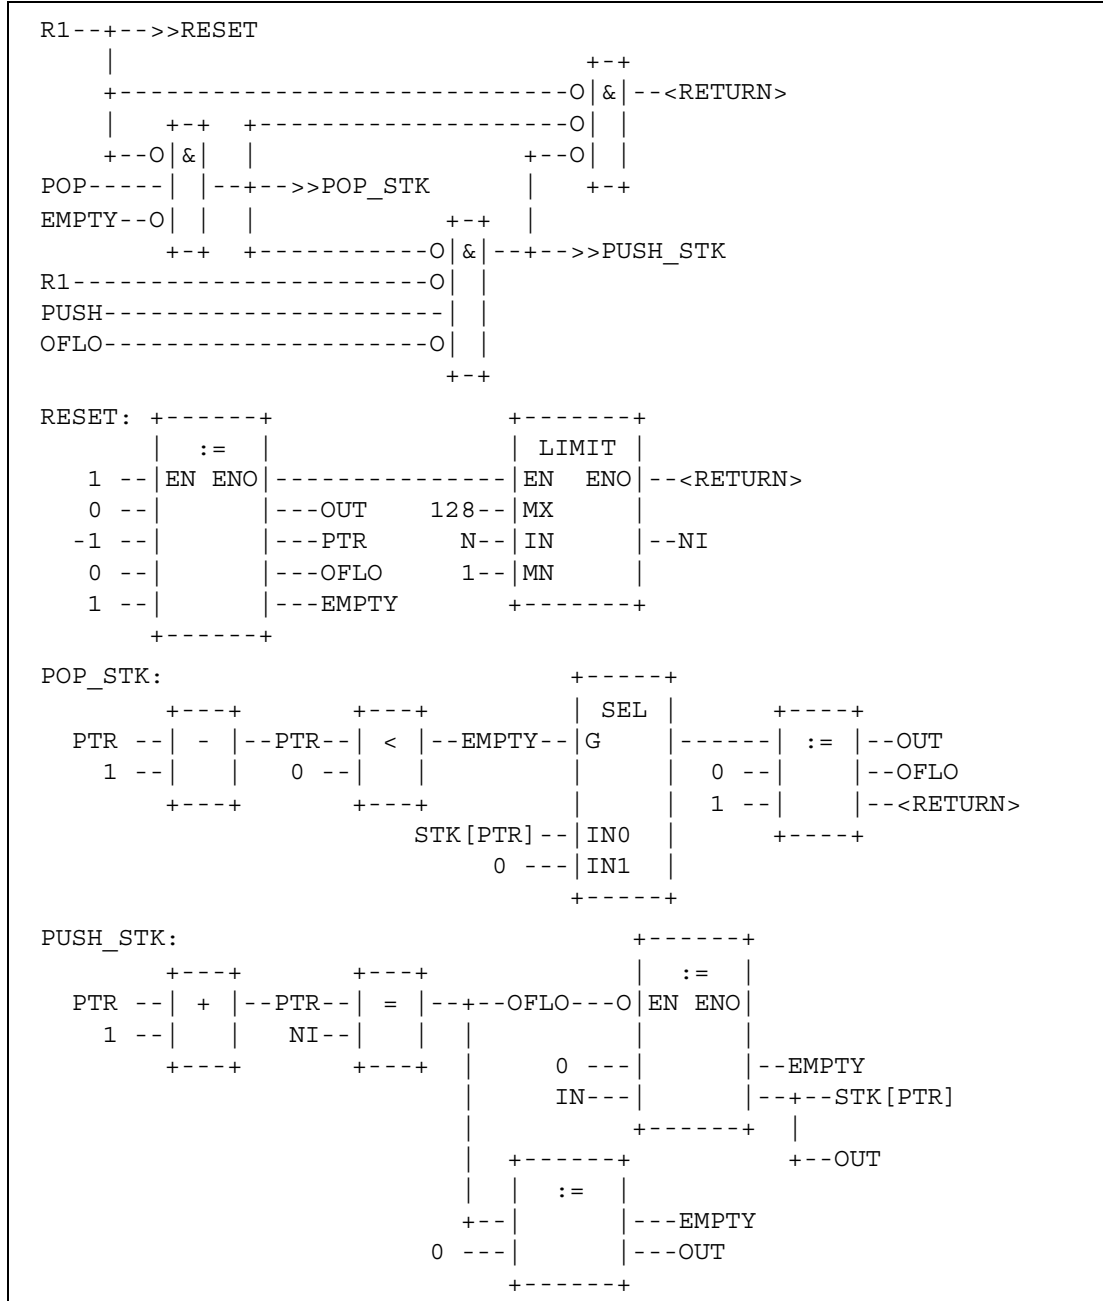

ANNEX G - Index (continued)

F.5 Function block MIX_2_BRIX

Function block MIX_2_BRIX is to control the mixing of two bricks of solid material, brought one at a time on a belt, with weighed quantities of two liquid components, A and B, as shown in figure F.1. A "Start" (ST) command, which may be manual or automatic, initiates a measurement and mixing cycle beginning with simultaneous weighing and brick transport as follows:

- Liquid A is weighed up to mark "a" of the weighing unit, then liquid B is weighed up to mark "b", followed by filling of the mixer from weighing unit C;
- Two bricks are transported by belt into the mixer.

The cycle ends with the mixer rotating and finally tipping after a predetermined time "t1". Rotation of the mixer continues while it is emptying.

The scale reading "WC" is given as four BCD digits, and will be converted to type INT for internal operations. It is assumed that the tare (empty weight) "z" has been previously determined.

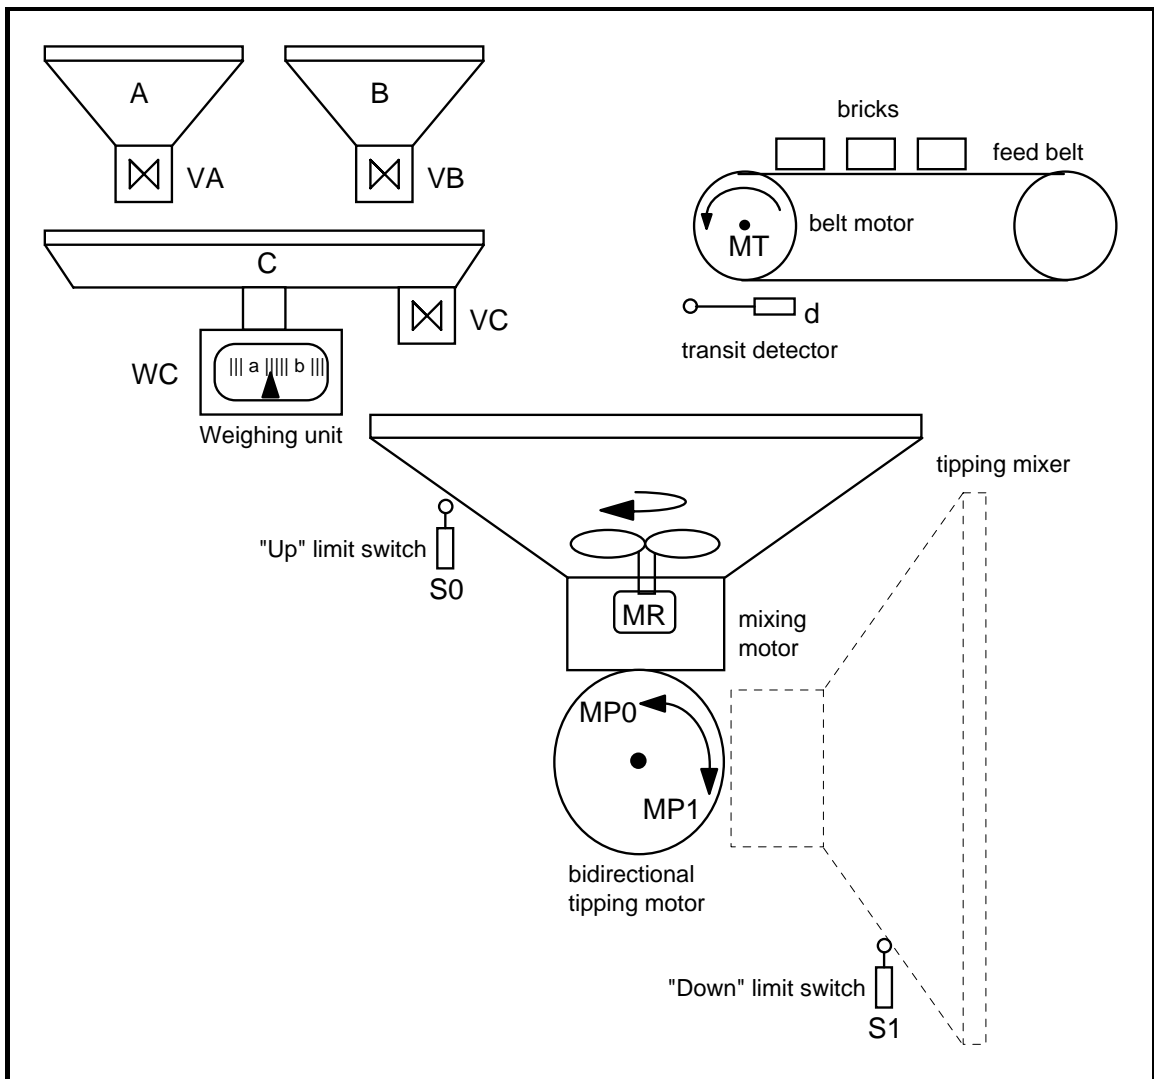


Figure F.1 - Function block MIX_2_BRIX - Physical model

ANNEX G - Index (continued)

The textual form of the declaration of this function block is:

```

FUNCTION_BLOCK MIX_2_BRIX
VAR_INPUT
  ST : BOOL ;      (* "Start" command *)
  d  : BOOL ;      (* Transit detector *)
  S0 : BOOL ;      (* "Mixer up" limit switch *)
  S1 : BOOL ;      (* "Mixer down" limit switch *)
  WC : WORD ;      (* Current scale reading in BCD *)
  z  : INT ;       (* Tare (empty) weight *)
  WA : INT ;       (* Desired weight of A *)
  WB : INT ;       (* Desired weight of B *)
  t1 : TIME ;      (* Mixing time *)
END_VAR
VAR_OUTPUT
  DONE ,
  VA ,          (* Valve "A" : 0 - close, 1 - open *)
  VB ,          (* Valve "B" : 0 - close, 1 - open *)
  VC ,          (* Valve "C" : 0 - close, 1 - open *)
  MT ,          (* Feed belt motor *)
  MR ,          (* Mixer rotation motor *)
  MP0 ,         (* Tipping motor "up" command *)
  MP1 : BOOL;  (* Tipping motor "down" command *)
END_VAR
(* Function block body *)
END_FUNCTION_BLOCK

```

A graphical declaration is:

```


+-----+
| MIX_2_BRIX |
|-----|
| ST      |  DONE |---|
| d      |  VA    |---|
| S0     |  VB    |---|
| S1     |  VC    |---|
| WC     |  MT    |---|
| z      |  MR    |---|
| WA     |  MP0   |---|
| WB     |  MP1   |---|
| t1     |      |
|-----|
+-----+

```

ANNEX G - Index (continued)

The body of function block MIX_2_BRIX using graphical SFC elements with transition conditions in the ST language is:

ANNEX G - Index (continued)

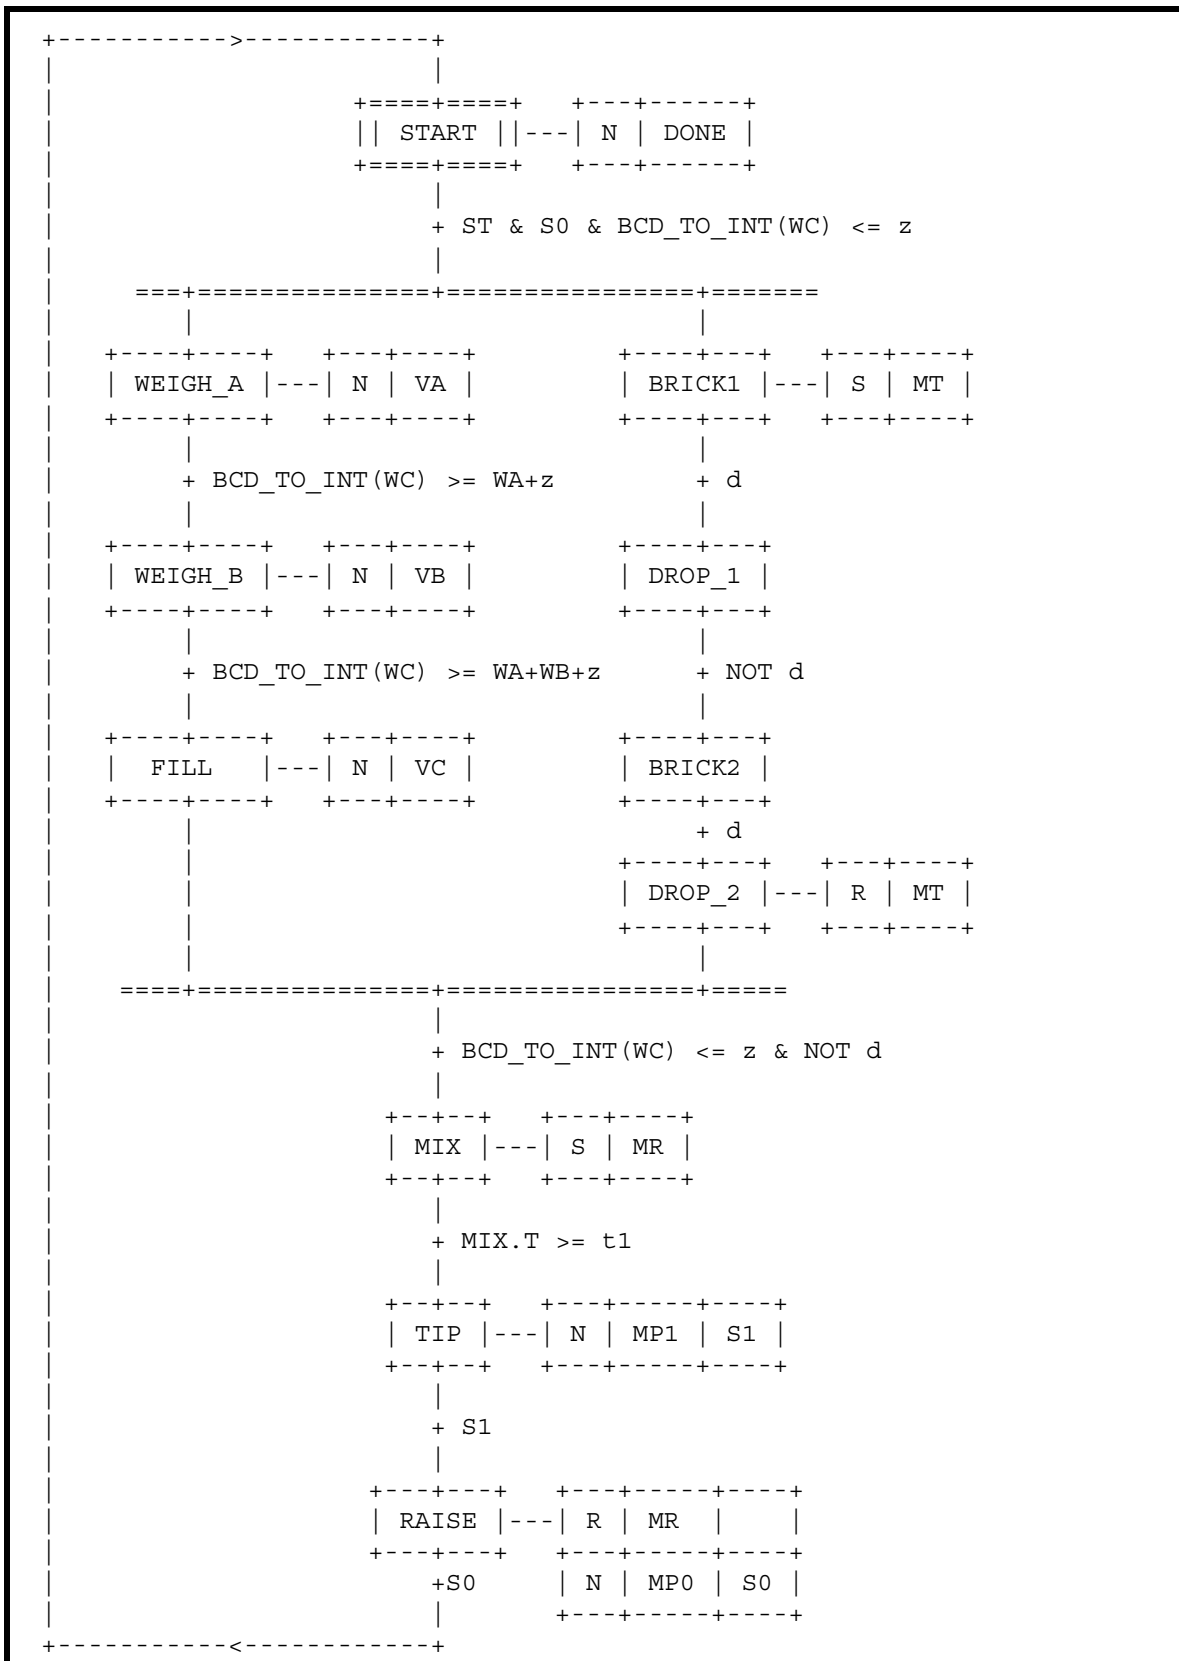

ANNEX G - Index (continued)

The body of function block MIX_2_BRIX in a textual SFC representation using ST language elements is:

```
INITIAL_STEP START: DONE(N); END_STEP
TRANSITION FROM START TO (WEIGH_A, BRICK1)
    := ST & S0 & BCD_TO_INT(WC) <= z;
END_TRANSITION
STEP WEIGH_A: VA(N); END_STEP
TRANSITION FROM WEIGH_A TO WEIGH_B := BCD_TO_INT(WC) >= WA+z ;
END_TRANSITION
STEP WEIGH_B: VB(N); END_STEP
TRANSITION FROM WEIGH_B TO FILL := BCD_TO_INT(WC) >= WA+WB+z ;
END_TRANSITION
STEP FILL: VC(N); END_STEP
STEP BRICK1: MT(S); END_STEP
TRANSITION FROM BRICK1 TO DROP_1 := d ; END_TRANSITION
STEP DROP_1: END_STEP
TRANSITION FROM DROP_1 TO BRICK2 := NOT d ; END_TRANSITION
STEP BRICK2: END_STEP
TRANSITION FROM BRICK2 TO DROP_2 := d ; END_TRANSITION
STEP DROP_2: MT(R); END_STEP
TRANSITION FROM (FILL,DROP_2) TO MIX
    := BCD_TO_INT(WC) <= z & NOT d ;
END_TRANSITION
STEP MIX: MR(S); END_STEP
TRANSITION FROM MIX TO TIP := MIX.T >= t1 ; END_TRANSITION
STEP TIP: MP1(N); END_STEP
TRANSITION FROM TIP TO RAISE := S1 ; END_TRANSITION
STEP RAISE: MR(R); MP0(N); END_STEP
TRANSITION FROM RAISE TO START := S0 ; END_TRANSITION
```

ANNEX G - Index (continued)

F.6 Analog signal processing

The purpose of this portion of of this annex is to illustrate the application of the programming languages defined in this standard to accomplish the basic measurement and control functions of process-computer aided automation. The blocks shown below are not restricted to analog signals; they may be used to process any variables of the appropriate types. Similarly, other functions and function blocks defined in this standard (e.g., mathematical functions) can be used for the processing of variables which may appear as analog signals at the programmable controller's I/O terminals.

These function blocks can be typed with respect to the input and output variables shown below as REAL (e.g., XIN, XOUT) by appending the appropriate data type name, e.g., LAG1_LREAL. The default data type for these variables is REAL.

These examples are given for illustrative purposes only. Manufacturers may have varying implementations of analog signal processing elements. The inclusion of these examples is not intended to preclude the standardization of such elements by the appropriate standards bodies.

F.6.1 Function block LAG1

This function block implements a first-order lag filter.

```

          +-----+
          |   LAG1   |
    BOOL---| RUN     |
    REAL---| XIN     XOUT |---REAL
    TIME---| TAU     |
    TIME---| CYCLE   |
          +-----+
  
```


```

FUNCTION_BLOCK LAG1
  VAR_INPUT
    RUN : BOOL ;      (* 1 = run, 0 = reset *)
    XIN : REAL ;      (* Input variable *)
    TAU : TIME ;      (* Filter time constant *)
    CYCLE : TIME ;    (* Sampling time interval *)
  END_VAR
  VAR_OUTPUT XOUT : REAL ; END_VAR (* Filtered output *)
  VAR K : REAL ;      (* Smoothing constant, 0.0<=K<1.0 *)
  END_VAR
  IF RUN THEN XOUT := XOUT + K * (XIN - XOUT) ;
  ELSE XOUT := XIN ;
      K := TIME_TO_REAL(CYCLE) / TIME_TO_REAL(CYCLE + TAU) ;
  END_IF ;
END_FUNCTION_BLOCK
  
```

ANNEX G - Index (continued)

F.6.2 Function block DELAY


This function block implements an N-sample delay.

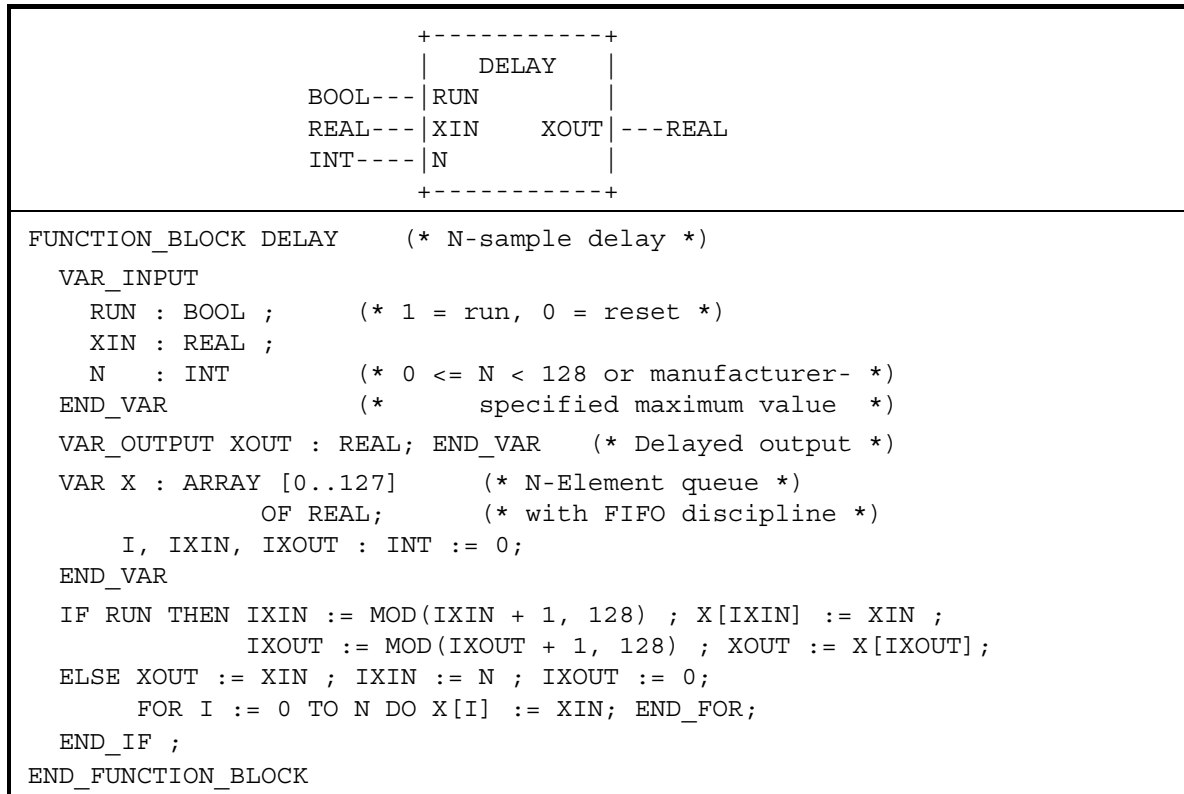

ANNEX G - Index (continued)

F.6.3 Function block AVERAGE

This function block implements a running average over N samples.



```
FUNCTION_BLOCK AVERAGE
```

```
VAR_INPUT
```

```
EN : BOOL ;      (* 1 = run, 0 = reset *)
```

```
XIN : REAL ;     (* Input variable *)
```

```
N   : INT ;      (* 0 <= N < 128 or manufacturer- *)
```

```
END_VAR          (* specified maximum value *)
```

```
VAR_OUTPUT XOUT : REAL ; END_VAR (* Averaged output *)
```

```
VAR SUM   : REAL := 0.0; (* Running sum *)
```

```
  FIFO : DELAY ;      (* N-Element FIFO *)
```

```
END_VAR
```

```
SUM := SUM - FIFO.XOUT ;
```

```
FIFO (RUN := RUN , XIN := XIN, N := N) ;
```

```
SUM := SUM + FIFO.XOUT ;
```

```
IF RUN THEN XOUT := SUM/N ;
```

```
ELSE SUM := N*XIN ; XOUT := XIN ;
```


```
END_IF ;
```

```
END_FUNCTION_BLOCK
```

ANNEX G - Index (continued)

F.6.4 Function block INTEGRAL


This function block implements integration over time.

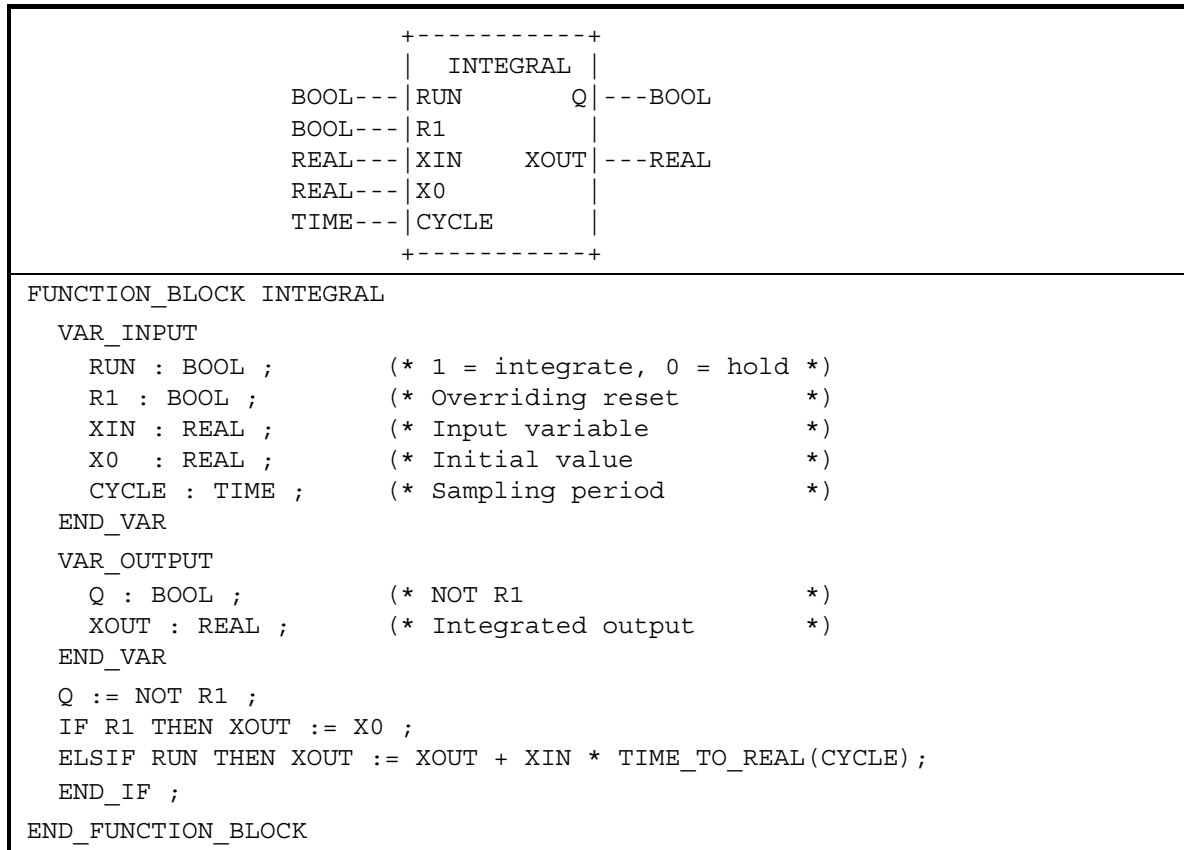

ANNEX G - Index (continued)


F.6.5 Function block DERIVATIVE

This function block implements differentiation with respect to time.

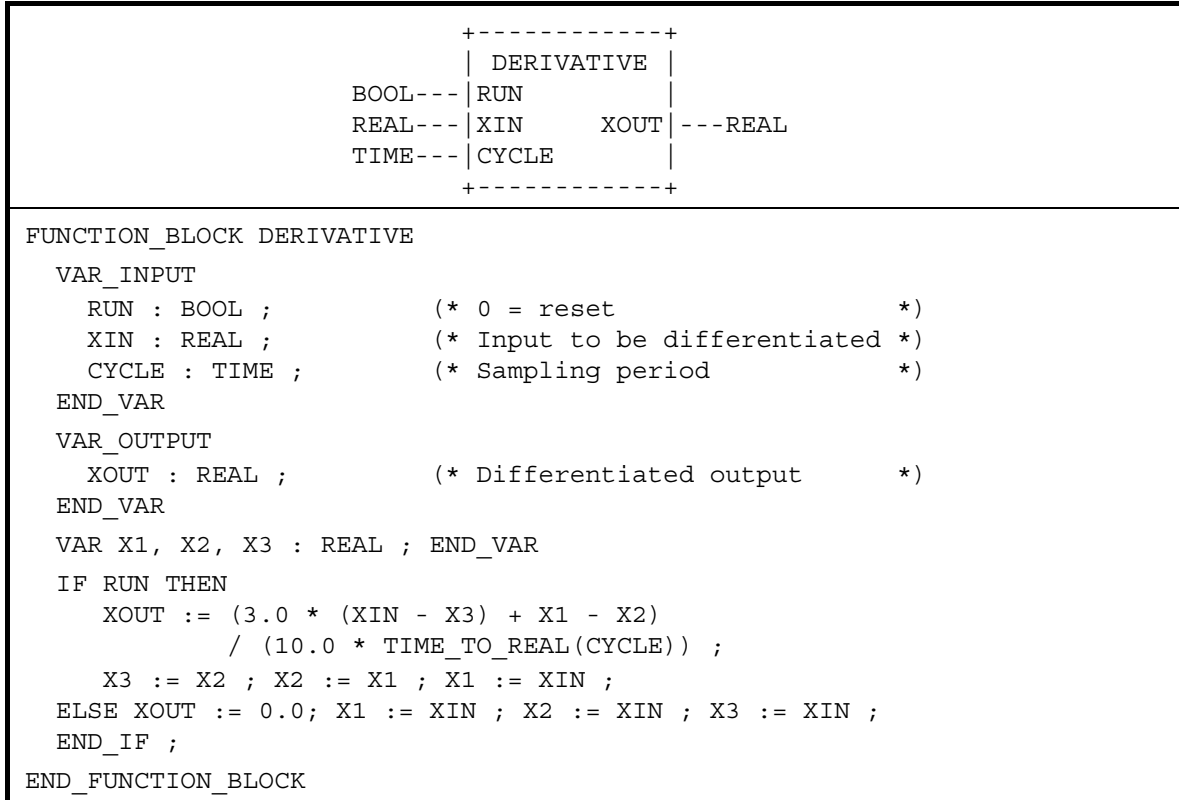

F.6.6 Function block HYSTERESIS


This function block implements Boolean hysteresis on the difference of REAL inputs.

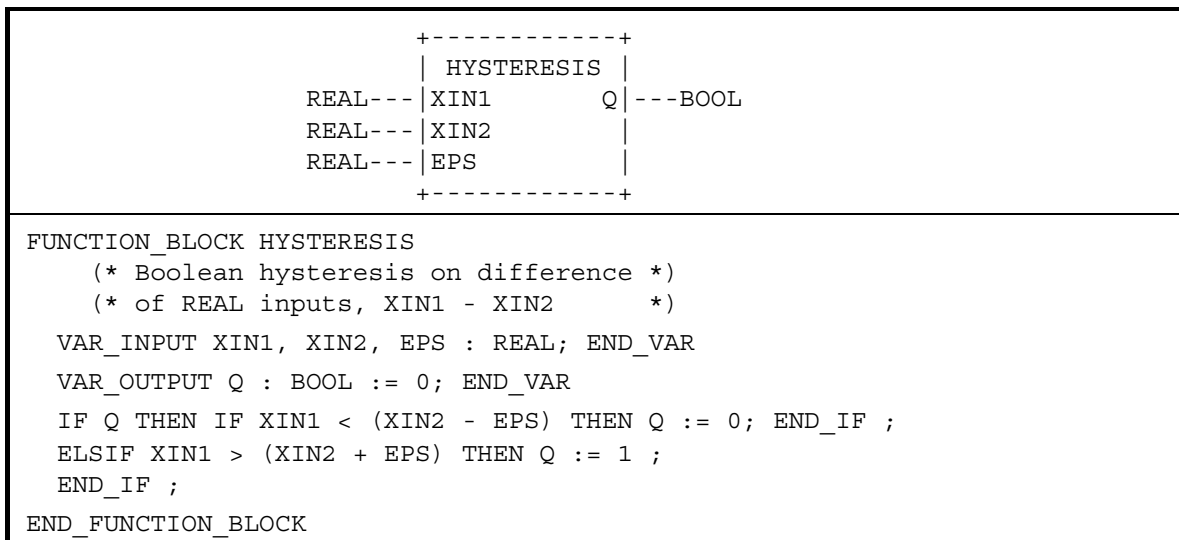

ANNEX G - Index (continued)

F.6.7 Function block LIMITS_ALARM

This function block implements a high/low limit alarm with hysteresis on both outputs.

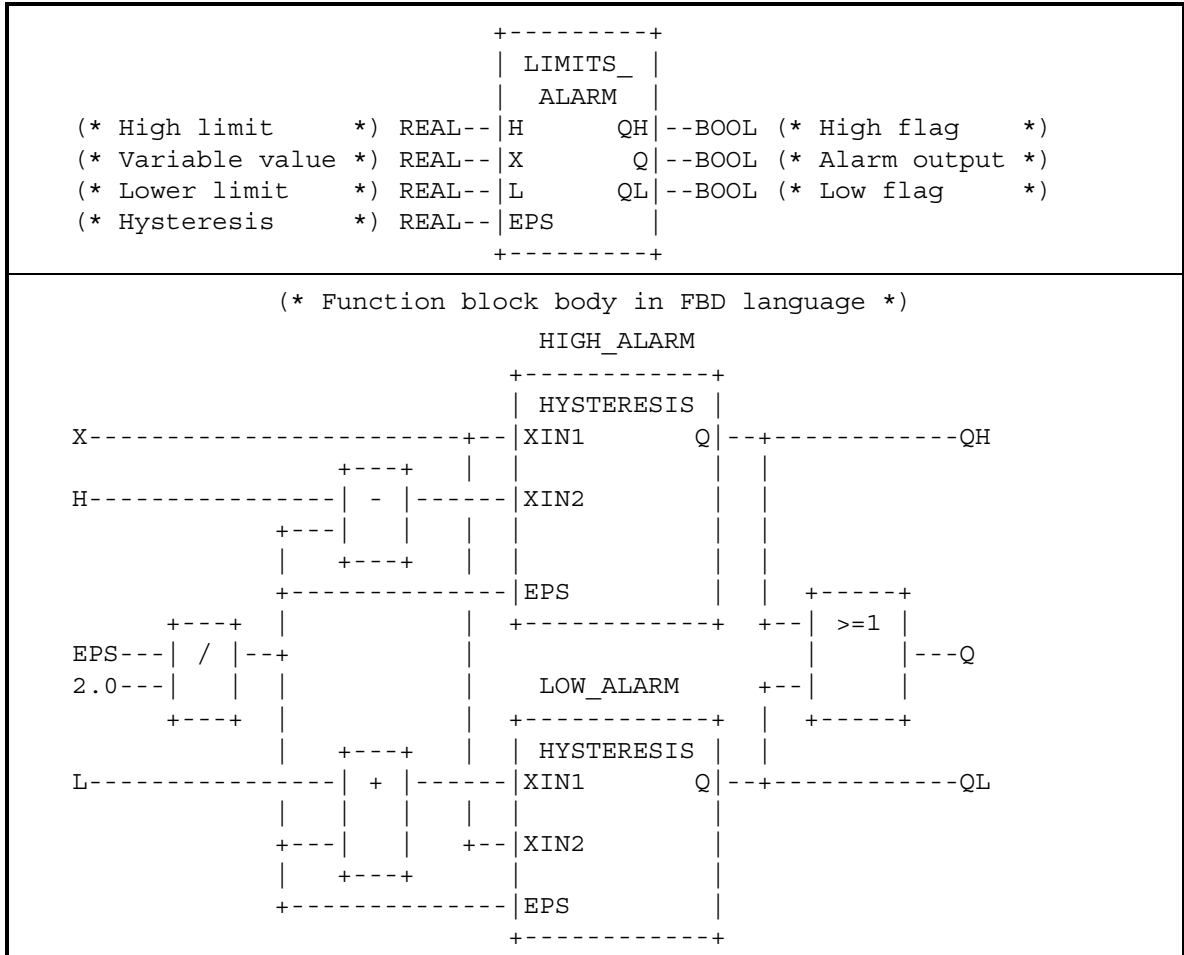

ANNEX G - Index (continued)**F.6.8 Structure ANALOG_LIMITS**


This data type implements the declarations of parameters for analog signal monitoring.

```
TYPE ANALOG_LIMITS :  
  STRUCT  
    HS : REAL ;      (* High end of signal range *)  
    HM : REAL ;      (* High end of measurement range *)  
    HA : REAL ;      (* High alarm threshold *)  
    HW : REAL ;      (* High warning threshold *)  
    NV : REAL ;      (* Nominal value *)  
    EPS : REAL ;     (* Hysteresis *)  
    LW : REAL ;      (* Low warning threshold *)  
    LA : REAL ;      (* Low alarm threshold *)  
    LM : REAL ;      (* Low end of measurement range *)  
    LS : REAL ;      (* Low end of signal range *)  
  END_STRUCT  
END_TYPE
```


ANNEX G - Index (continued)

F.6.9 Function block ANALOG_MONITOR


This function block implements analog signal monitoring.

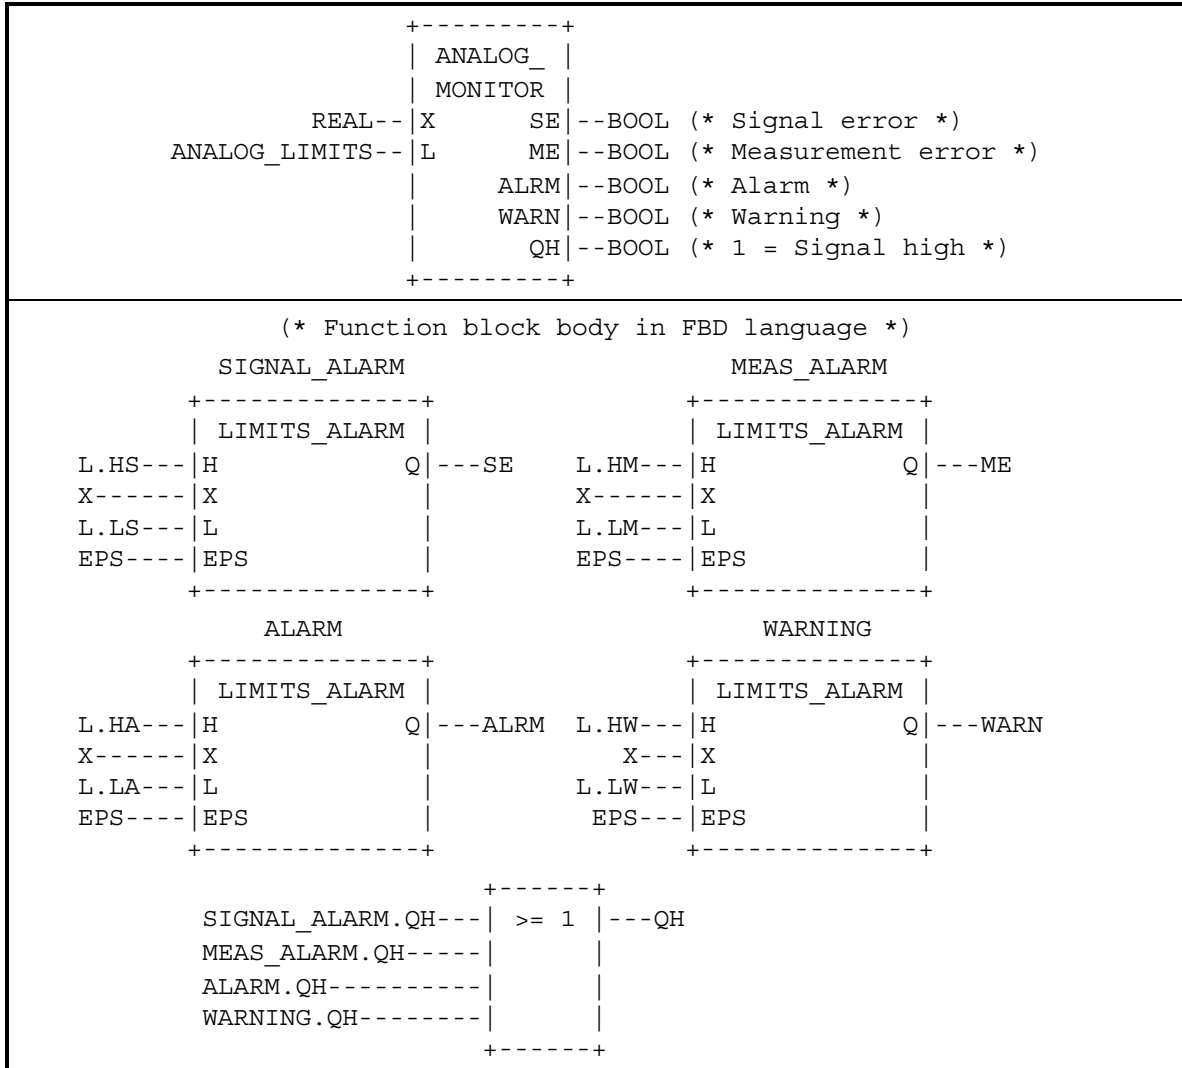

ANNEX G - Index (continued)

F.6.10 Function block PID

This function block implements Proportional + Integral + Derivative control action. The functionality is derived by functional composition of previously declared function blocks.

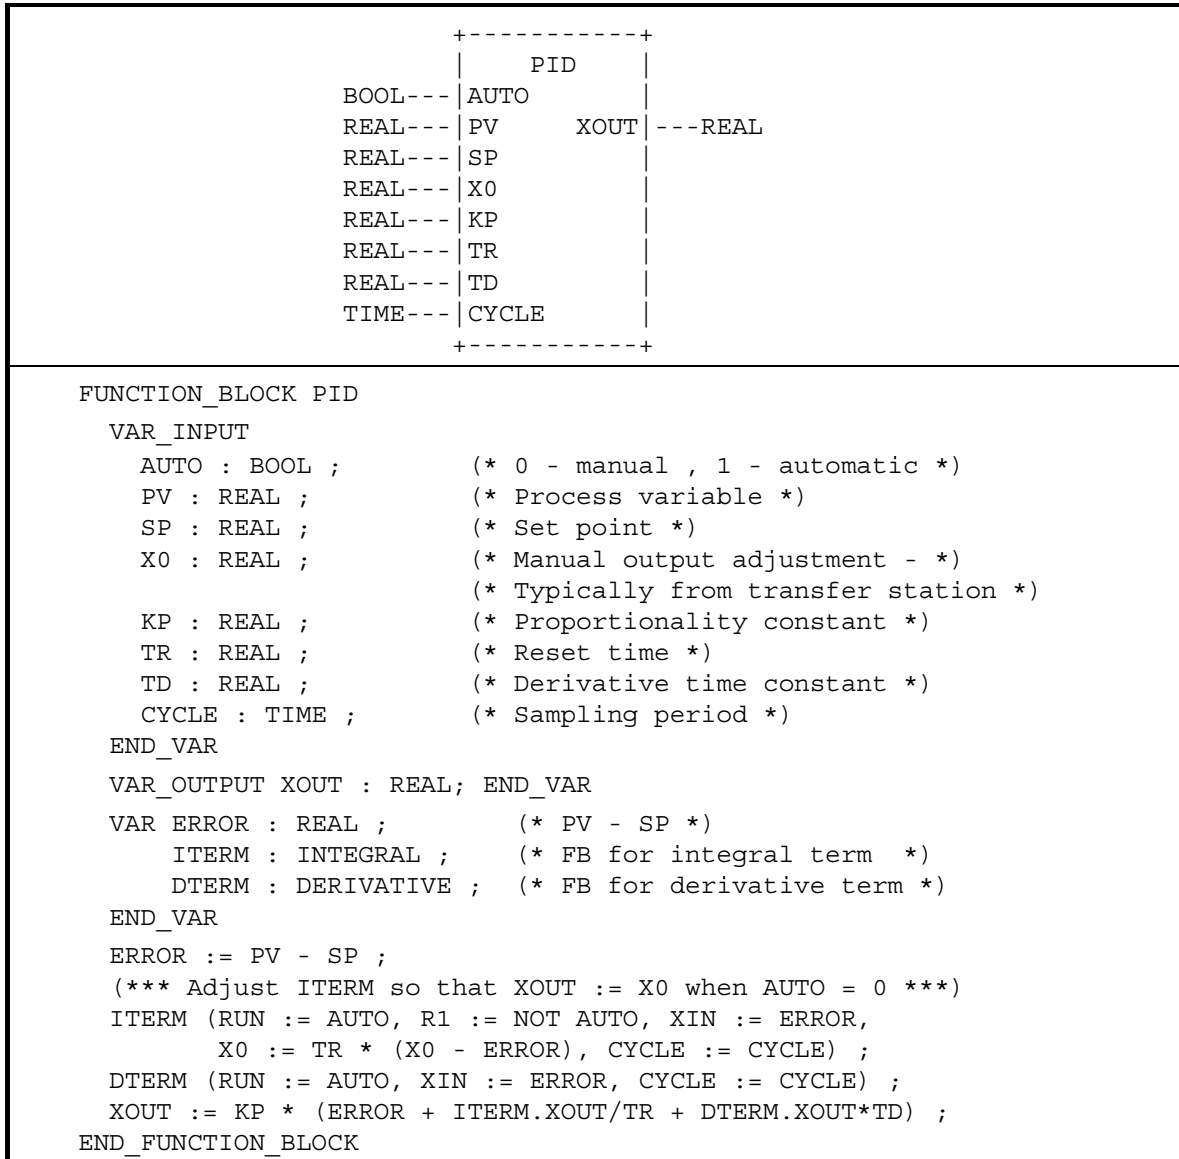

ANNEX G - Index (continued)

F.6.11 Function block DIFFEQ

This function block implements a general difference equation.

	+-----+	
	DIFFEQ	
	RUN	
BOOL---	XIN XOUT	---REAL
REAL---		
ARRAY[1..] OF REAL---	A	
	M	
INT----		
ARRAY[0..] OF REAL---	B	
INT----	N	
	+-----+	


```

FUNCTION_BLOCK DIFFEQ
VAR_INPUT
  RUN : BOOL ;          (* 1 = run, 0 = reset *)
  XIN : REAL ;
  A : ARRAY[1..] OF REAL ; (* Input coefficients *)
  M : INT ;             (* Length of input history *)
  B : ARRAY[0..] OF REAL ; (* Output coefficients *)
  N : INT ;            (* Length of output history *)
END_VAR
VAR_OUTPUT XOUT : REAL := 0.0 ; END_VAR
VAR (* NOTE : Manufacturer may specify other array sizes *)
  XI : ARRAY [0..128] OF REAL ; (* Input history *)
  XO : ARRAY [0..128] OF REAL ; (* Output history *)
  I : INT ;
END_VAR
XO[0] := XOUT ; XI[0] := XIN ;
XOUT := B[0] * XIN ;
IF RUN THEN
  FOR I := M TO 1 BY -1 DO
    XOUT := XOUT + A[I] * XO[I] ; XO[I] := XO[I-1] ;
  END_FOR ;
  FOR I := N TO 1 BY -1 DO
    XOUT := XOUT + B[I] * XI[I] ; XI[I] := XI[I-1] ;
  END_FOR ;
ELSE
  FOR I := 1 TO M DO XO[I] := 0.0 ; END_FOR ;
  FOR I := 1 TO N DO XI[I] := 0.0 ; END_FOR ;
END_IF ;
END_FUNCTION_BLOCK
    
```

ANNEX G - Index (continued)

F.6.12 Function block RAMP

This function block implements a time-based ramp.

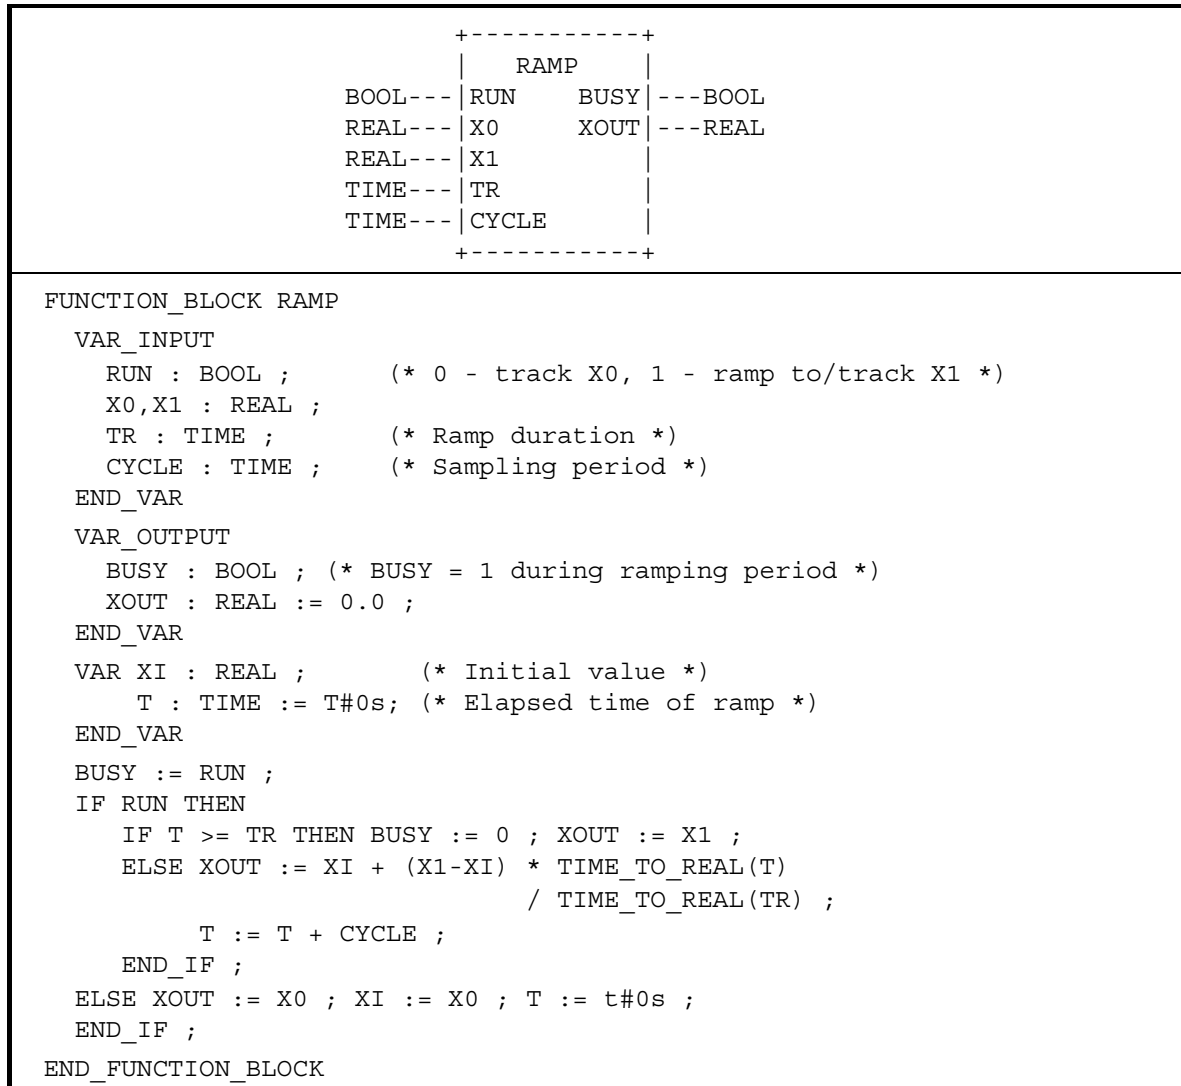

ANNEX G - Index (continued)

F.6.13 Function block TRANSFER

This function block implements a manual transfer station with bumpless transfer.

<pre> +-----+ TRANSFER AUTO XIN XOUT ---REAL FAST_RATE SLOW_RATE FAST_UP SLOW_UP FAST_DOWN SLOW_DOWN CYCLE +-----+ </pre>
<pre> FUNCTION_BLOCK TRANSFER VAR_INPUT AUTO : BOOL ; (* 1 - track X0, 0 - ramp or hold *) XIN : REAL ; (* Typically from PID Function Block *) FAST_RATE, SLOW_RATE : REAL ; (* Up/down ramp slopes *) FAST_UP, SLOW_UP, (* Typically pushbuttons *) FAST_DOWN, SLOW_DOWN : BOOL; CYCLE : TIME ; (* Sampling period *) END_VAR VAR_OUTPUT XOUT : REAL ; END_VAR VAR XFER_RAMP : INTEGRAL ; RAMP_RATE : REAL ; END_VAR RAMP_RATE := 0.0 ; IF NOT AUTO THEN IF FAST_UP THEN RAMP_RATE := FAST_RATE; END_IF; IF SLOW_UP THEN RAMP_RATE := RAMP_RATE + SLOW_RATE; END_IF; IF FAST_DOWN THEN RAMP_RATE := RAMP_RATE - FAST_RATE; END_IF; IF SLOW_DOWN THEN RAMP_RATE := RAMP_RATE - SLOW_RATE; END_IF; END_IF ; XFER_RAMP (RUN := 1, CYCLE := CYCLE, R1 := AUTO, XIN := RAMP_RATE, X0 := XIN) ; XOUT := XFER_RAMP.XOUT; END_FUNCTION_BLOCK </pre>

ANNEX G - Index (continued)**F.7 Program GRAVEL**

A control system is to be used to measure an operator-specified amount of gravel from a silo into an intermediate bin, and to convey the gravel after measurement from the bin into a truck.

The quantity of gravel to be transferred is specified via a thumbwheel with a range of 0 to 99 units. The amount of gravel in the bin is indicated on a digital display.

For safety reasons, visual and audible alarms must be raised immediately when the silo is empty. The signalling functions are to be implemented in the control program.

A graphic representation of the control problem is shown in figure F.2, while the variable declarations for the control program are given in figure F.3.

As shown in figure F.4, the operation of the system consists of a number of major states, beginning with filling of the bin upon command from the FILL push button. After the bin is filled, the truck loading sequence begins upon command by the LOAD pushbutton when a truck is present on the ramp. Loading consists of a "run-in" period for starting the conveyor, followed by dumping of the bin contents onto the conveyor. After the bin has emptied, the conveyor "runs out" for a predetermined time to assure that all gravel has been loaded to the truck. The loading sequence is stopped and re-initialized if the truck leaves the ramp or if the automatic control is stopped by the OFF push button.

Figure F.5 shows the OFF/ON sequence of automatic control states, as well as the generation of display blinking pulses and conveyor motor gating when the control is ON.

Bin level monitoring, operator interface and display functions are defined in figure F.6.

A textual version of the body of program GRAVEL is given in figure F.7, using the ST language with SFC elements.

An example configuration for program GRAVEL is given in figure F.8.

ANNEX G - Index (continued)

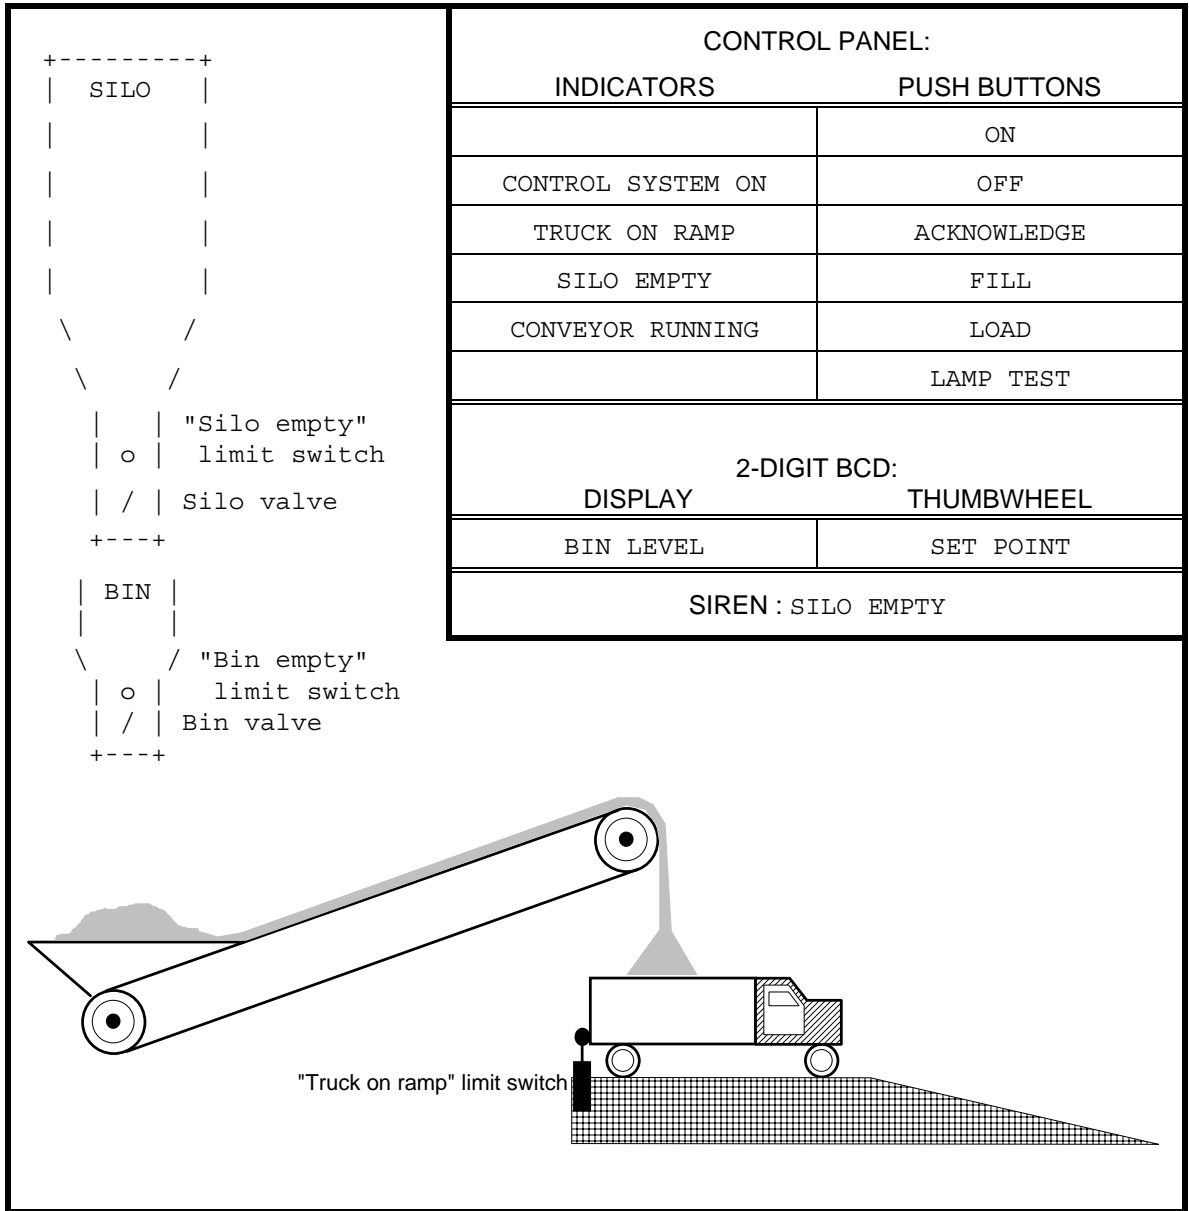


Figure F.2 - Gravel measurement and loading system

ANNEX G - Index (continued)

```

PROGRAM GRAVEL  (* Gravel measurement and loading system *)
VAR_INPUT
  OFF_PB          : BOOL ;
  ON_PB           : BOOL ;
  FILL_PB         : BOOL ;
  SIREN_ACK       : BOOL ;
  LOAD_PB         : BOOL ; (* Load truck from bin *)
  JOG_PB          : BOOL ;
  LAMP_TEST       : BOOL ;
  TRUCK_ON_RAMP   : BOOL ; (* Optical sensor *)
  SILO_EMPTY_LS   : BOOL ;
  BIN_EMPTY_LS    : BOOL ;
  SETPOINT        : BYTE ; (* 2-digit BCD *)
END_VAR
VAR_OUTPUT
  CONTROL_LAMP    : BOOL ;
  TRUCK_LAMP      : BOOL ;
  SILO_EMPTY_LAMP : BOOL ;
  CONVEYOR_LAMP   : BOOL ;
  CONVEYOR_MOTOR  : BOOL ;
  SILO_VALVE      : BOOL ;
  BIN_VALVE       : BOOL ;
  SIREN           : BOOL ;
  BIN_LEVEL       : BYTE ;
END_VAR
VAR
  BLINK_TIME : TIME; (* BLINK ON/OFF time *)
  PULSE_TIME : TIME; (* LEVEL_CTR increment interval *)
  RUNOUT_TIME: TIME; (* Conveyor running time after loading *)
  RUN_IN_TIME: TIME; (* Conveyor running time before loading *)
  SILENT_TIME: TIME; (* Siren silent time after SIREN_ACK *)
  OK_TO_RUN  : BOOL; (* 1 = Conveyor is allowed to run *)
  (* Function Blocks *)
  BLINK: TON; (* Blinker OFF period timer / ON output *)
  BLANK: TON; (* Blinker ON period timer / blanking pulse *)
  PULSE: TON; (* LEVEL_CTR pulse interval timer *)
  SIREN_FF: RS;
  SILENCE_TMR: TP; (* Siren silent period timer *)
END_VAR
VAR RETAIN LEVEL_CTR : CTU ; END_VAR
  (* Program body *)
END_PROGRAM

```

Figure F.3 - Declarations for Program GRAVEL

ANNEX G - Index (continued)

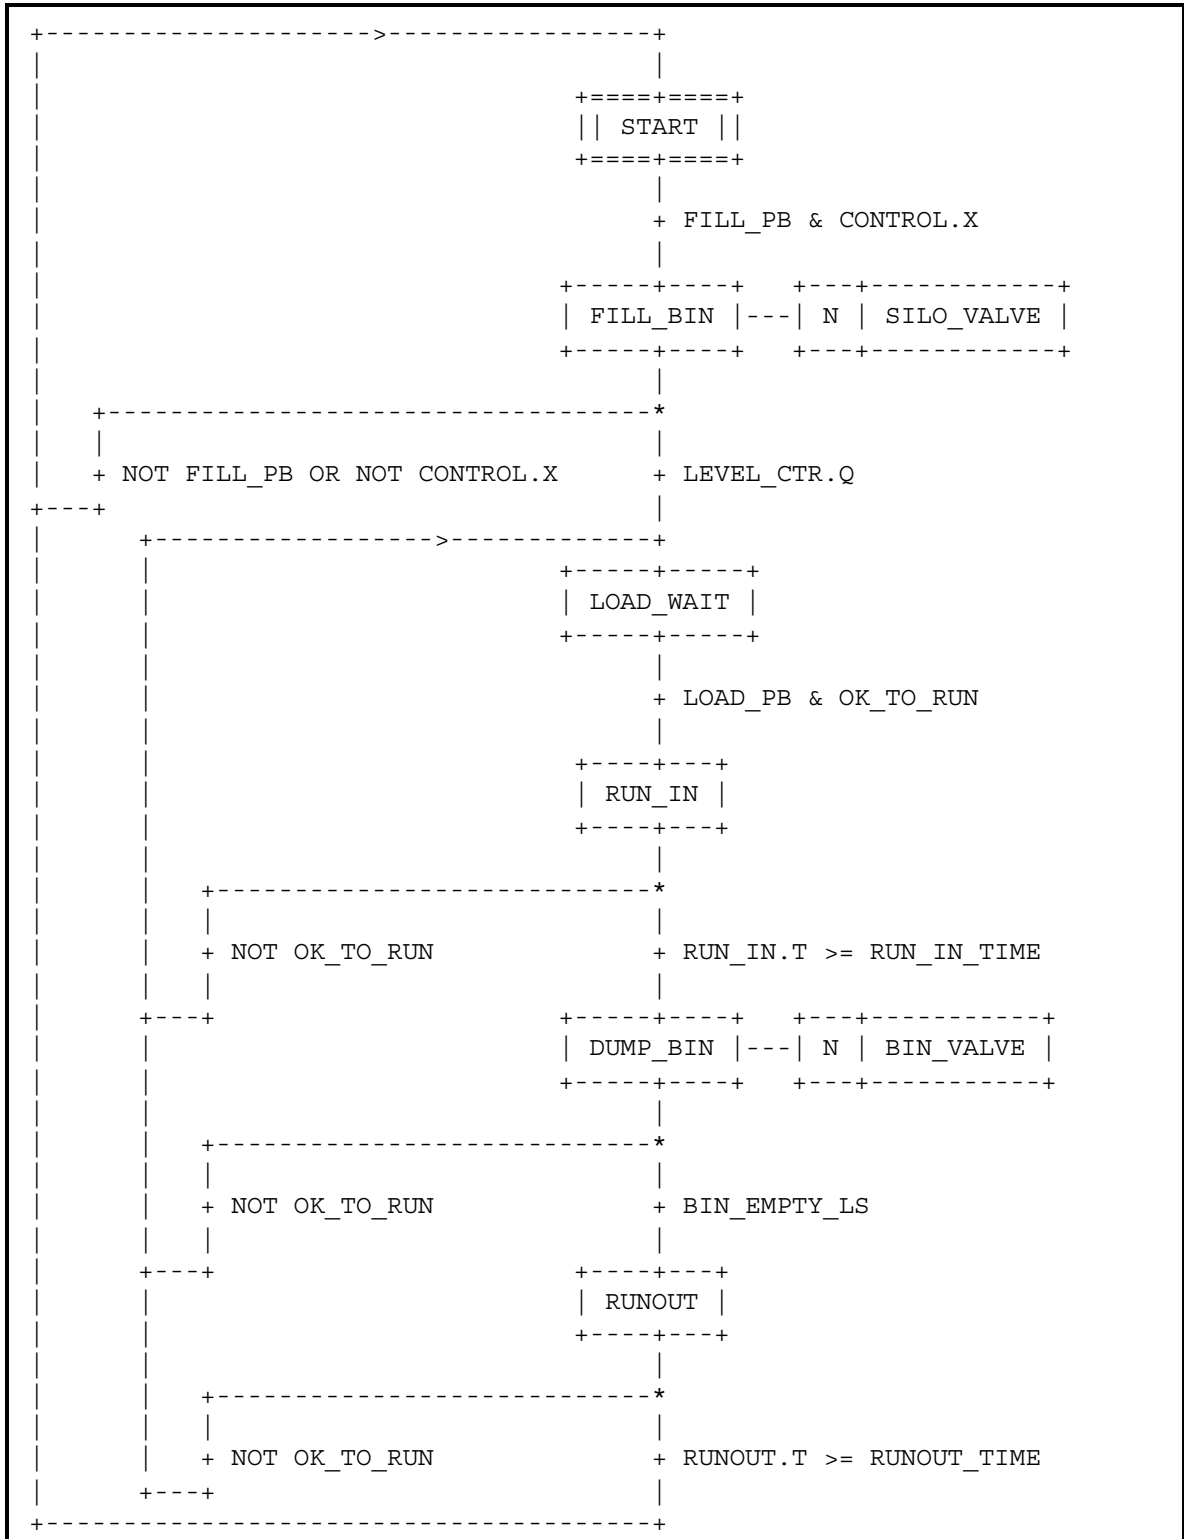


Figure F.4 - SFC of program GRAVEL body

ANNEX G - Index (continued)

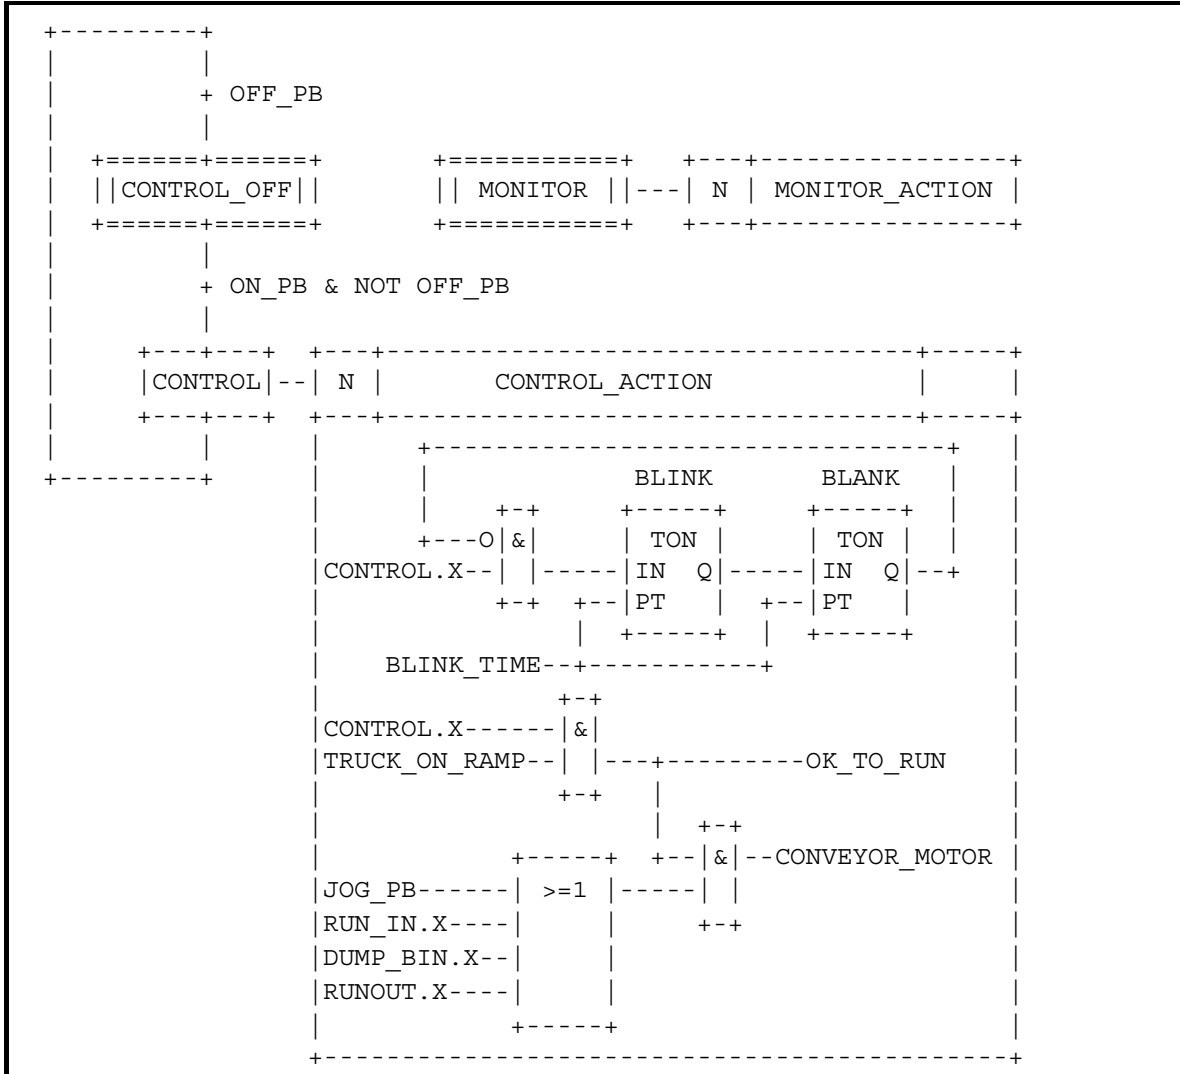


Figure F.5 - Body of program GRAVEL (continued)
Control state sequencing and monitoring

ANNEX G - Index (continued)

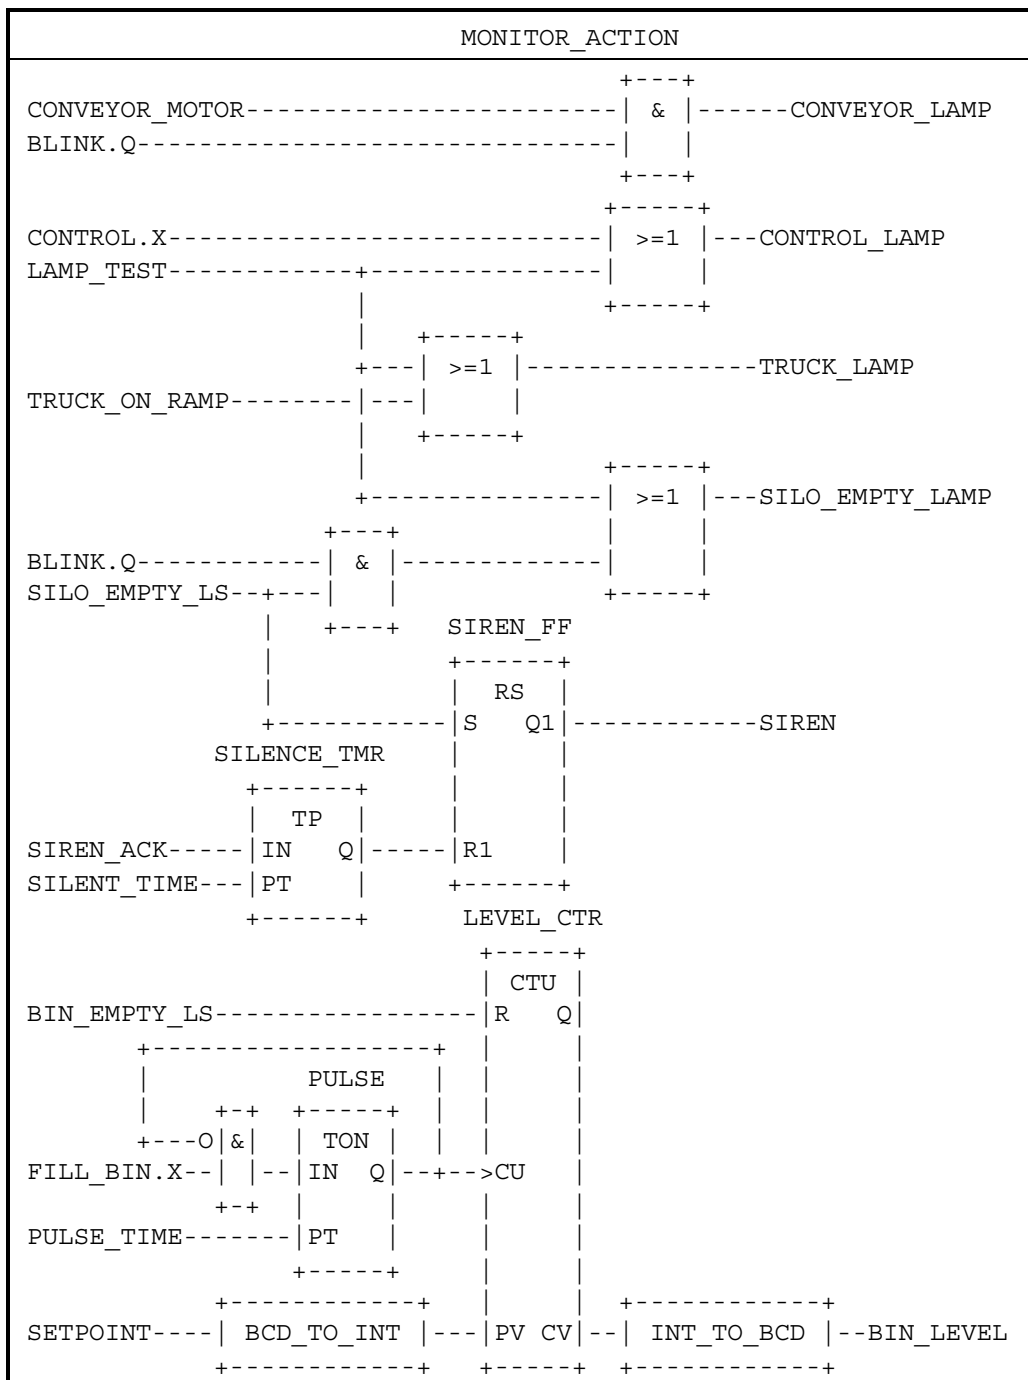


Figure F.6 - Body of action MONITOR_ACTION in FBD language

ANNEX G - Index (continued)

```
(* Major operating states *)
INITIAL_STEP START : END_STEP
TRANSITION FROM START TO FILL_BIN
    := FILL_PB & CONTROL.X ; END_TRANSITION
STEP FILL_BIN: SILO_VALVE(N); END_STEP
TRANSITION FROM FILL_BIN TO START
    := NOT FILL_PB OR NOT CONTROL.X ; END_TRANSITION
TRANSITION FROM FILL_BIN TO LOAD_WAIT := LEVEL_CTR.Q ;
END_TRANSITION
STEP LOAD_WAIT : END_STEP
TRANSITION FROM LOAD_WAIT TO RUN_IN
    := LOAD_PB & OK_TO_RUN ; END_TRANSITION
STEP RUN_IN : END_STEP
TRANSITION FROM RUN_IN TO LOAD_WAIT := NOT OK_TO_RUN ;
END_TRANSITION
TRANSITION FROM RUN_IN TO DUMP_BIN
    := RUN_IN.T > RUN_IN_TIME;
END_TRANSITION
STEP DUMP_BIN: BIN_VALVE(N); END_STEP
TRANSITION FROM DUMP_BIN TO LOAD_WAIT := NOT OK_TO_RUN ;
END_TRANSITION
TRANSITION FROM DUMP_BIN TO RUNOUT := BIN_EMPTY_LS ;
END_TRANSITION
STEP RUNOUT : END_STEP
TRANSITION FROM RUNOUT TO LOAD_WAIT := NOT OK_TO_RUN ;
END_TRANSITION
TRANSITION FROM RUNOUT TO START
    := RUNOUT.T >= RUNOUT_TIME ; END_TRANSITION
```

**Figure F.7 - Body of program GRAVEL in textual SFC representation
using ST language elements
(continued on following page)**

ANNEX G - Index (continued)

```
(* Control state sequencing *)
INITIAL_STEP CONTROL_OFF: END_STEP
TRANSITION FROM CONTROL_OFF TO CONTROL
    := ON_PB & NOT OFF_PB ; END_TRANSITION
STEP CONTROL: CONTROL_ACTION(N) ; END_STEP
ACTION CONTROL_ACTION:
    BLINK(EN:=CONTROL.X & NOT BLANK.Q, PT := BLINK_TIME) ;
    BLANK(EN:=BLINK.Q, PT := BLINK_TIME) ;
    OK_TO_RUN := CONTROL.X & TRUCK_ON_RAMP ;
    CONVEYOR_MOTOR :=
        OK_TO_RUN & OR(JOG_PB, RUN_IN.X, DUMP_BIN.X, RUNOUT.X) ;
END_ACTION
TRANSITION FROM CONTROL TO CONTROL_OFF := OFF_PB ;
END_TRANSITION
(* Monitor Logic *)
INITIAL_STEP MONITOR: MONITOR_ACTION(N) ; END_STEP
ACTION MONITOR_ACTION:
    CONVEYOR_LAMP := CONVEYOR_MOTOR & BLINK.Q ;
    CONTROL_LAMP := CONTROL.X OR LAMP_TEST ;
    TRUCK_LAMP := TRUCK_ON_RAMP OR LAMP_TEST ;
    SILO_EMPTY_LAMP := BLINK.Q & SILO_EMPTY_LS OR LAMP_TEST ;
    SILENCE_TMR(EN:=SIREN_ACK, PT:=SILENT_TIME) ;
    SIREN_FF(S:=SILO_EMPTY_LS, R1:=SILENCE_TMR.Q) ;
    SIREN := SIREN_FF.Q1 ;
    PULSE(EN:=FILL_BIN.X & NOT PULSE.Q, PT:=PULSE_TIME) ;
    LEVEL_CTR(EN := BIN_EMPTY_LS, CU := PULSE.Q,
        PV := BCD_TO_INT(SETPOINT)) ;
    BIN_LEVEL := INT_TO_BCD(LEVEL_CTR.CV) ;
END_ACTION
```

Figure F.7 - Body of program GRAVEL in textual SFC representation using ST language elements (continued)

ANNEX G - Index (continued)

```
CONFIGURATION GRAVEL_CONTROL
RESOURCE PROC1 ON PROC_TYPE_Y
PROGRAM G : GRAVEL
(* Inputs *)
(OFF_PB      := %I0.0 ,
 ON_PB       := %I0.1 ,
 FILL_PB     := %I0.2 ,
 SIREN_ACK   := %I0.3 ,
 LOAD_PB     := %I0.4 ,
 JOG_PB      := %I0.5 ,
 LAMP_TEST   := %I0.7 ,
 TRUCK_ON_RAMP := %I1.4 ,
 SILO_EMPTY_LS := %I1.5 ,
 BIN_EMPTY_LS := %I1.6 ,
 SETPOINT    := %IB2 ,
(* Outputs *)
CONTROL_LAMP => %Q4.0,
TRUCK_LAMP   => %Q4.2,
SILO_EMPTY_LAMP => %Q4.3,
CONVEYOR_LAMP => %Q5.3,
CONVEYOR_MOTOR => %Q5.4,
SILO_VALVE   => %Q5.5,
BIN_VALVE    => %Q5.6,
SIREN        => %Q5.7,
BIN_LEVEL    => %B6) ;
END_RESOURCE
END_CONFIGURATION
```

Figure F.8 - Example configuration for program GRAVEL

ANNEX G - Index (continued)

F.8 Program AGV

As illustrated in figure F.9, a program is to be devised to control an automatic guided vehicle (AGV). The AGV is to travel between two extreme positions, left (indicated by limit switch S3) and right (indicated by limit switch S4). The normal position of the AGV is on the left.

The AGV is to execute one cycle of left-to-right and return motion when the operator actuates pushbutton S1, and two cycles when the operator actuates pushbutton S2. It is also possible to pass from a single to a double cycle by actuating pushbutton S2 during a single cycle. Finally, non-repeat locking is to be provided if either S1 or S2 remains actuated.

Figure F.10 illustrates the graphical declaration of program AGV, while figure F.11 shows a typical configuration for this program. Figure F.12 shows the AGV program body, consisting of a main control sequence and a single-cycle control sequence.

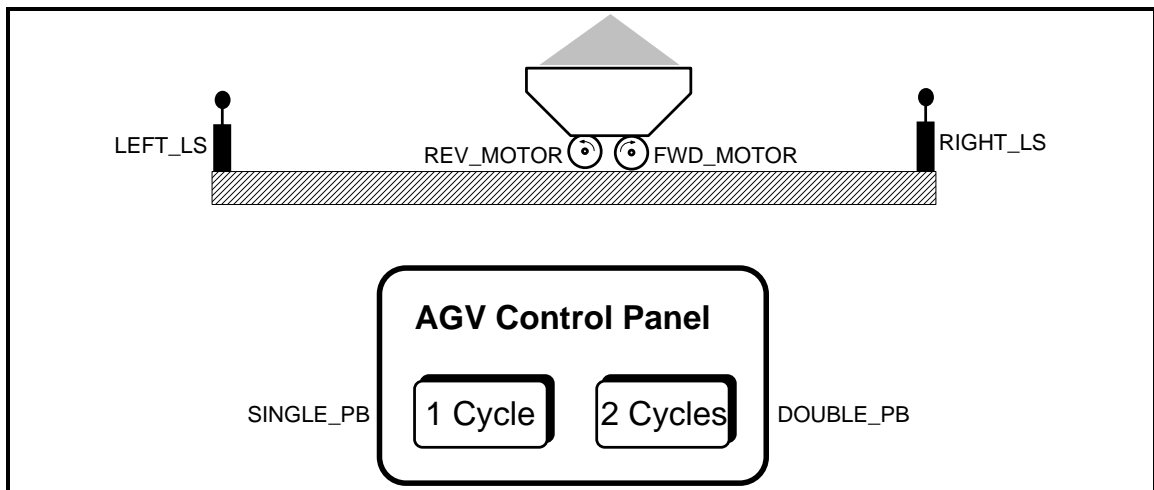


Figure F.9 - Physical model for program AGV

ANNEX G - Index (continued)

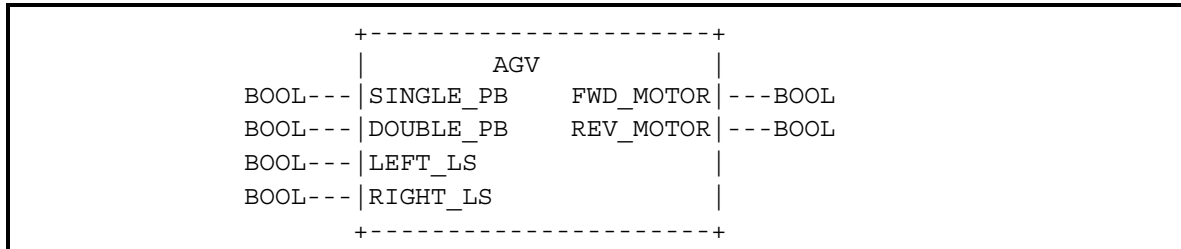


Figure F.10 - Graphical declaration of program AGV

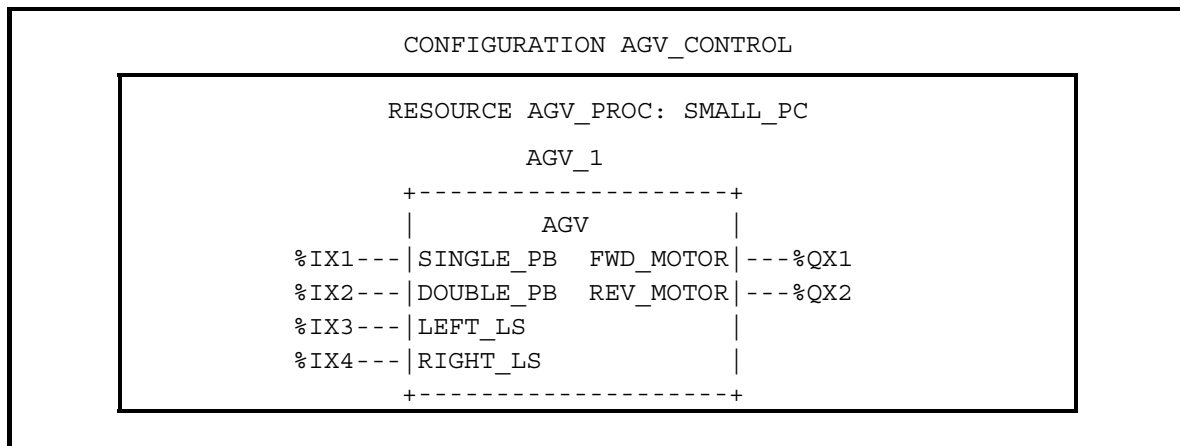


Figure F.11 - A graphical configuration of program AGV

ANNEX G - Index (continued)

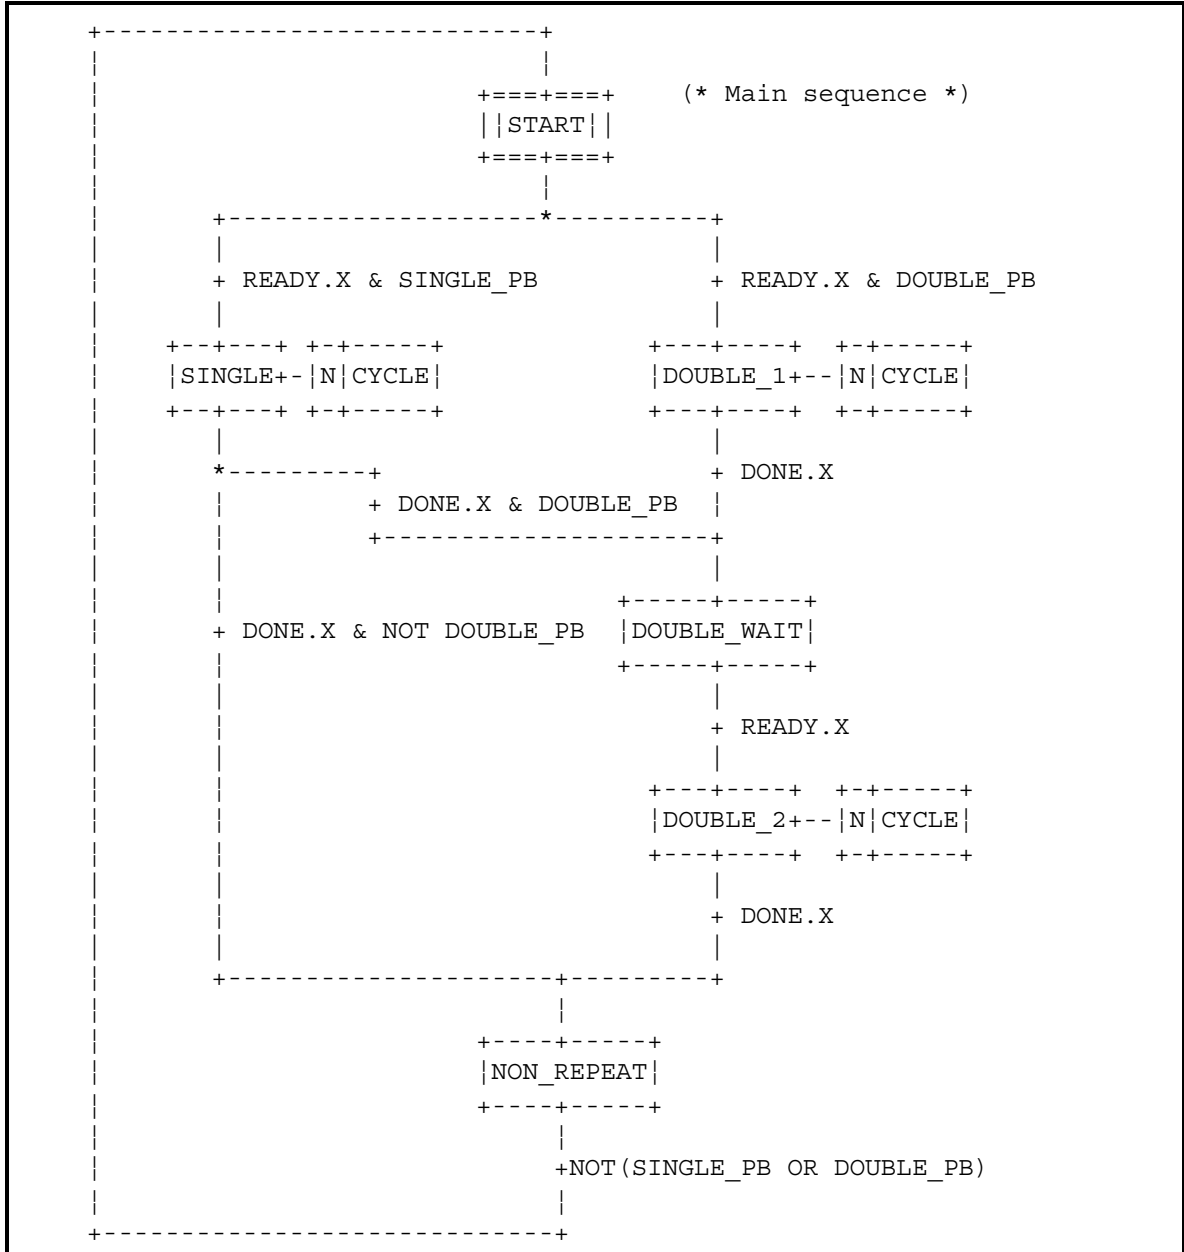


Figure F.12 - Body of program AGV
(continued on following page)

ANNEX G - Index (continued)

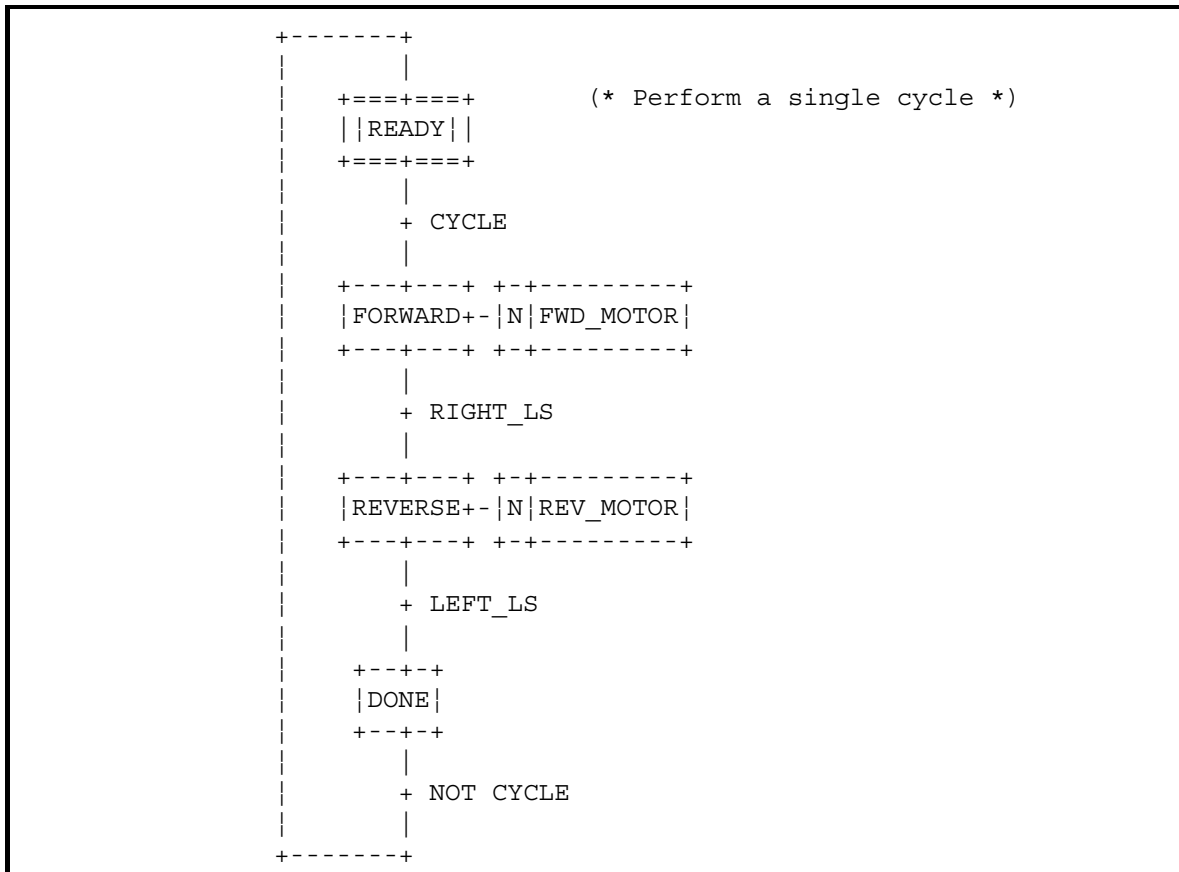


Figure F.12 - Body of program AGV (continued)

ANNEX G - Index (continued)

ANNEX G - Index (continued)**ANNEX G - Index** (informative)

Primary references for delimiters and keywords are given in annex C. The point of definition of a term is shown in **bold face** type.

- absolute time, 29
- access path, 105, 107-9
 - communication, 15-18
 - keyword, 40
 - loading/deletion, 15
 - programming, 19-20
- action, 77, 83-92, 118, 120
 - control, 88-92
 - qualifiers, 88
- action block, 83, 86, 87, 88
- active association, 88, 89
- activity flow, 128
- aggregate, **10**
- argument, 44, 61, 120, 121, 122
- array, 44
 - access path, 107
 - declaration, 33-34, 41
 - initialization, 33, 42-43
 - location assignment, 41
 - usage, 38, 127
- assignment, 45, 46, 47, 79
 - FOR loop variable values, 126
 - function block parameters, 62
 - of input values, 125
 - operator, 33, 79
 - statement, 124, 125
- based number, **10**, 27-28
- basic code table, 24
- bistable function block, 70-71
- bit string
 - comparison, 54
 - data types, 30-32
 - functions, 54-55
 - initial value assignment, 42-43
 - variable declaration, 40-41
- body
 - function, 46, **47**, 48, 125
 - function block, 61-76

ANNEX G - Index (continued)

program organization unit, 130

ANNEX G - Index (continued)

Boolean

- AND, in ladder diagrams, 135
- data type, 30-32
- default initial value, 34
- edge detection, 63, 72
- expression, 79, 122, 126, 127
- functions, 54-55, 89
- input, action control, 88, 89
- input, RETURN, 132
- literals, 27-28
- negation, 45, 119
- operators, 120, 123
- OR, LD vs. FBD, 138
- output, 132
- signal, 132
- values, power flow, 134
- variable, 38, 77, 78, 83, 84, 87, 88, 110, 126, 132
- variable, in ladder diagrams, 135, 137

byte (data element size), 38

BYTE (data type), 30-32, 34

call

- operator, 120, 121

case (of characters), 24, 25, 29

CASE statement, 124, 126

character code, 24, 26, 28, 58

character set, 9, 24-25, 77, 99, 128, 136

character string

- character positions in, 58
- comparison, 58
- data type, 30-32
- functions, 58-59
- initialization, 42-43
- literals, 28
- variable declaration, 40-41

cold restart, 39, 40, 41, 42, 43

comment, 26, 119

comparison

- bit strings, 54
- character strings, 58
- functions, 54, 59

compilation, 22

ANNEX G - Index (continued)

- compliance, 21-23
 - action declarations, 83
 - EXIT statement, 125
 - PC systems, 21
 - programs, 23
 - sequential function chart (SFC), 104
 - step/action association, 86
 - syntax, 22
- concatenation
 - action blocks, 86, 87
 - hierarchical addresses, 37
 - time data, 60
- conditional
 - call, 121
 - instruction, 120
 - jump, 132
 - return, 132
- configuration, 14-15
 - communication, 15-18
 - elements, 105-17
 - initialization, 15
 - programming, 19-20
 - starting and stopping, 15
- connection, 17, 76
- connector, 79, 81, 128, 129
- contact, 135-36
- counter, 73
- data type
 - compliance, 22
 - declaration, 33-34
 - elementary, 30-32
 - generic, 32, 48, 49
 - initialization, 34-35
 - of an expression, 122
 - of functions, 47
 - of input parameters, 47
 - of internal variables, 47
 - programming, 19-20
 - usage, 36
- date and time, 74
 - data types, 30-32
 - default initial values, 34
 - functions, 59
 - literals, 30
- decimal number (decimal literal), 27-28, 128
- declaration, 19-20
 - access paths, 107-9
 - actions, 83-85, 88
 - configurations, 105-17

ANNEX G - Index (continued)

- data types, 33-34
 - function blocks, 61, 62-69
 - functions, 47-48, 125
 - programs, 76
 - resources, 107-9
 - tasks, 110-17
 - variables, 39-40, 137
- default value, 48
- FOR increment, 126
 - function block inputs, 63
 - of data types, 34-35
 - of variables, 39, 42-43
 - task interval, 110
- delimiter
- comments, 26
 - LD network, 134
 - network label, 128
 - time literals, 29-30
- direct representation, 37-38, 76, 107, 108
- in programs, 76
 - initial value assignment, 42-43
 - variable declaration, 40-41
- double word, 30-32
- size prefix, 38
- duration
- data type (TIME), 30-32
 - literals, 29
 - of action qualifiers, 88
 - of step activity, 93
- edge detection, 63, 66
- function blocks, 72
- EN/ENO (enable) variables, 46, 47
- errors, 44, 48, 78, 89, 93, 125, 127, 128
- documentation, 22
 - handling, 22, 23, 46
 - reporting, 22

ANNEX G - Index (continued)

- evaluation
 - of assignment statements, 125
 - of CASE expressions, 126
 - of expressions, 122-23
 - of function blocks, 111
 - of functions, 44, 53, 123, 125
 - of instructions, 119-21
 - of language elements, 111
 - of network elements, 130
 - of networks, 61, 130-31, 135, 138
 - of programs, 111
 - of transitions, 94, 95, 96, 97
- execution
 - of actions, 77, 88
 - of EXIT statements, 127
 - of function blocks, 61, 72, 110
 - of functions, 44, 46-47
 - of instructions, 119-21
 - of iteration statements, 126-27
 - of loop elements, 130
 - of programs, 132
 - of selection statements, 126
- execution control element, 77, 110, 130, 132-33, 135
- extensions, **22**, 24, 26, 37
 - documentation, 22
 - processing, 22
 - usage, 23
- falling edge, 63, 65, 72
- feedback
 - path, 130, 131
 - variable, 130
- FOR statement, 126-27
- function, 44-60
 - compliance, 22
 - control statements, 125-26
 - extensible, 50
 - in LD language, 135
 - overloaded, 48, 49, 52, 54
 - programming, 19-20
 - return value, 125
 - signal flow, 128
 - typing, 48

ANNEX G - Index (continued)

- function block, 14-15, 61-76
 - action control, 88-92
 - communication, 15-18, 76
 - compliance, 22
 - control statements, 125-26
 - in LD language, 135
 - instance, 110
 - operation, 73, 74
 - programming, 19-20
 - retentive, 78
 - SFC structuring, 77
 - signal flow, 128
 - type, 61
- function block diagram (FBD), 14, 138
 - execution control, 132-33
 - loops in, 130
 - signal flow in, 128
- function block diagram (fbd)
 - action blocks in, 87
- generic data types, 32, 48, 49
- global variable, 105
 - communication, 15, 17
 - declaration, 39-40, 76, 107-9
 - function block instance, 61
 - initial value assignment, 42-43
 - initialization, 15
 - loading/deletion, 15
 - programming, 19-20
- hierarchical addressing, 37
- identifier, 25, 47, 61, 77, 79, 123, 128
- implementation-dependent
 - feature, 22, 23, 39, 41, 126
 - parameter, 21, 33, 37, 38, 50, 73, 93
 - side effects, 62
- initial
 - state, 77
 - step, 77, 78, 93
- initial value
 - assignment, 42-43
 - default, 34-35
 - feedback variable, 130
 - FOR loop variable, 126
 - function block variables, 63, 125
- initialization, 15, 39
 - function blocks, 62-69, 93
 - programs, 76, 93
 - SFC networks, 93

ANNEX G - Index (continued)

- steps, 78
- input
 - declaration, 39-40, 47-48, 62-69
 - dynamic, 63
 - extensible, 50
 - initialization, 39
 - instance name, 61
 - location prefix, 38
 - negated, 45
 - operators (IL language), 121
 - overloaded, 48, 49
 - parameter, 44, 61, 125
 - parameter, read/write privileges, 62
 - program, 108
 - string, 51
 - variable, 61, 76, 107, 135
- input/output
 - parameter, 62-69
 - variable, 61
- instance
 - function block, 61, 63, 65, 110
 - name, 61, 63, 65
- instantiation
 - action control, 89
 - function block, 76
 - program, 76
- instruction, 79, 83, 119-21
- integer
 - data types, 30-32, 126
 - literal, 12, 27-28, 128
- invocation
 - by tasks, 110
 - function block, 61, 62, 63, 121, 124, 125-26, 125
 - of actions, 77
 - of functions, 44, 45, 121, 122-23
 - of non-PC language elements, 19
 - recursive, 44
 - return from, 132
- iteration, 125, 126-27

ANNEX G - Index (continued)

keyword, 26

- Boolean literals, 27, 79
- data types, 30-32
- ELSE statement, 126
- FOR statement, 126
- function block declaration, 63
- function declaration, 47
- IF statement, 126
- program declaration, 76
- REPEAT statement, 127
- time literals, 29-30
- transition, 79
- variable declaration, 39-40
- WHILE statement, 127

label, 119, 120

- connector, 128
- network, 128, 130, 132

ladder diagram, 134-37

- evaluation, 130-31
- execution control, 132-33
- network, 79

language element, 9, 14-15

- compliance, 21-23
- programming, 19-20, 76

library, 19-20, 107

literal, 27-30, 119, 122, 134

logical location, 37, 39, 40

long real, 30-32

long word, 30-32

memory, 135

memory (user data storage)

- allocation, 39-40, 137
- direct representation, 37-38
- initial value assignment, 42-43
- initialization, 39

named element, 38, 125, 128

network, 88, **128**

- direction of flow, 128
- evaluation, 61, 130-31, 135, 138
- function block diagram (FBD), 79, 83
- label, 132
- ladder diagram (LD), 79, 134
- sequential function chart (SFC), 77, 91, 93

numeric literals, 27-28

off-delay, **13**, 74-75

ANNEX G - Index (continued)

- on-delay, 13, 74-75
- operand
 - function as, 44
 - of an expression, 122-23
 - of an instruction, 119-21
- operator
 - assignment, 33, 79, 125
 - Instruction List, 119-21
 - overloaded, 48
 - precedence, 122, 123
 - Structured Text (ST), 122-23
 - symbols, 53, 55, 56, 57
- output
 - action control, 88
 - declaration, 62-69
 - function block, 124, 138
 - graphical representation, 45, 61
 - location prefix, 38
 - negated, 45
 - network, 138
 - parameter(s), 45, 61
 - parameter, read/write privileges, 62
 - program, 108
 - string, 51
 - typed, 48
 - values, 61
 - variable declaration, 39-40
 - variables, 61, 76, 107, 135
- overloading, 32, 48
 - of operators, 120, 122
- parameter
 - actual, 45, 49, 135
 - formal, 45, 49, 61, 135
 - formal, declaration, 47-48, 62-69, 76
 - input, 44, 61, 125
 - output, 45, 61
 - passing, 39, 63
- parentheses, 26, 33, 38, 42, 79, 120, 123, 125
- power flow, 87, 128, 132, 134, 135
- power rails, 128, 132, 134
- pre-emptive scheduling, 110-17
- priority
 - of tasks, 110-17
 - of transitions, 94, 95, 96, 97

ANNEX G - Index (continued)

- program, 14-15, 19-20, 76
 - communication, 15-18
 - compliance, 23
 - declaration, 39, 61, 68, 76, 108
 - retentive, 78
 - scheduling, 110-17
 - semaphore use in, 71
 - SFC structuring, 77
- program organization unit, 44, 61
 - compliance, 21
 - declaration, 39, 44
 - initial state, 77
 - jumps in, 132
 - networks in, 128, 130, 135, 138
 - scheduling, 110-17
 - SFC partitioning of, 77
 - state, 77
- programming, 15, 19-20, 134, 138
- real literal, 27-28
- resource, 14-15, 76
 - communication, 18
 - declaration, 107-9
 - global variables in, 107
 - initialization, 15, 39
 - programming, 19-20
 - starting and stopping, 15, 110
- retentive data
 - declaration, 39-40, 76, 137
 - in function blocks, 63
 - in steps, 78
 - initial value assignment, 42
 - initialization, 39
 - keyword, 40
 - type assignment, 40-41
- return, 120, 121, 124, 125, 132
- rising edge, 63, 65, 72, 74, 110
- rung, 83, 134
- scope
 - global, 107
 - of actions, 83
 - of declarations, 39
 - of function block instances, 61
 - of networks, 128
 - of steps, 77
 - of transitions, 80
- selection
 - functions, 54, 59

ANNEX G - Index (continued)

- statements, 126
- semantics
 - Instruction List (IL), 119-21
 - Structured Text (ST), 122-27
- semigraphic representation, 9, 63, 109, 128, 129
- sequential function chart (SFC)
 - activity flow, 128
 - compliance, 104
 - convergence, simultaneous, 93
 - divergence, selection, 94, 95, 96, 97
 - divergence, simultaneous, 93
 - elements, 14, 70, 71, 77-92, 118, 127, 128
 - elements, compatibility of, 104
 - errors, 93
 - evolution, 93-103
 - programming, 19
- signal flow, 128, 138
- single data element, 36, 37-38
- step, 77-78
 - action association, 86
 - activation, 93
 - active, 77, 78, 88, 93
 - deactivation, 77, 85, 93
 - duration, 93
 - elapsed time, 77, 78
 - flag, 77, 78
 - inactive, 77, 134
 - initial, 77, 78, 93
 - initialization, 78
 - retentive, 78
 - state, 77, 93, 94, 95, 96, 97, 100, 101
- structured data type, 61
 - declaration, 33-34
 - initialization, 34-35
 - usage, 36
- structured variable, **38**, 44
 - access path, 107
 - assignment, 125
 - declaration, 41
 - initialization, 42-43
 - step elements, 77
- subscripting, 38
 - array initialization, 42
- symbolic representation, 37, 40
- synchronization
 - interprocess, 127
 - of function blocks, 110-17
- syntax, 14

ANNEX G - Index (continued)

- documentation, 22
- step/transition, 93
- task, 14-15, 110-17
 - declaration, 107-9
 - programming, 19-20
- TIME data type, 30-32, 77, 78, 88
 - default initial value, 34
 - function blocks, 74
 - functions, 60
- time literal, 29-30
- time of day
 - data types, 30-32
 - default initial value, 34
 - functions, 60
 - keywords, 30
 - literals, 29-30
- timer, 74-75
- transition, 77, 79-82
 - clearing, 93, 101
 - clearing time, 93
 - condition, 77, 79-82, 83, 93
 - enabled, 93, 100
 - evaluation, 94, 95, 96, 97
 - priority, 94, 95, 96, 97
 - symbol, 93
- type conversion
 - functions, 49, 50-51
- underline character, 25, 27, 48
- unsigned integer, 128
 - data types, 30

ANNEX G - Index (continued)

variable, 37-43
 declaration, 47-48, 62-69
 usage, 36
WAIT function, 83, 127
warm restart, 39
wired OR, 138

ANNEX H - Software compliance testing (informative)

This topic is under consideration for future standardization.

-- END OF PART 3 --